

United States Army
Fort Monmouth, New Jersey

Underground Storage Tank Closure and Site Investigation Report

***Building 475
Main Post-East Area***

**NJDEP UST Registration No. 90010-52
DICAR No. 97-02-19-1352-57**

January 2000

**UNDERGROUND STORAGE TANK
CLOSURE AND SITE INVESTIGATION REPORT**

BUILDING 475

**MAIN POST-EAST AREA
NJDEP UST REGISTRATION NO. 90010-52**

JANUARY 2000

PREPARED FOR:

**UNITED STATES ARMY, FORT MONMOUTH, NEW JERSEY
DIRECTORATE OF PUBLIC WORKS
BUILDING 167
FORT MONMOUTH, NJ 07703**

PREPARED BY:

**VERSAR
1900 FROST ROAD
SUITE 110
BRISTOL, PA 19007**

PROJECT NO. 4435-018

TABLE OF CONTENTS

EXECUTIVE SUMMARY	iv
1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES	1
1.1 OVERVIEW	1
1.2 SITE DESCRIPTION	2
1.2.1 Geological/Hydrogeological Setting	2
1.3 HEALTH AND SAFETY	4
1.4 REMOVAL OF UNDERGROUND STORAGE TANK	4
1.4.1 General Procedures	4
1.4.2 Underground Storage Tank Excavation and Cleaning	4
1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL	5
1.6 MANAGEMENT OF EXCAVATED SOILS	5
2.0 SITE INVESTIGATION ACTIVITIES	6
2.1 OVERVIEW	6
2.2 FIELD SCREENING/MONITORING	6
2.3 SOIL SAMPLING	7
2.4 GROUNDWATER SAMPLING	7
3.0 CONCLUSIONS AND RECOMMENDATIONS	8
3.1 SOIL SAMPLING RESULTS	8
3.2 GROUNDWATER SAMPLING RESULTS	8
3.3 CONCLUSIONS AND RECOMMENDATIONS	9

TABLE OF CONTENTS (CONTINUED)

TABLES

Table 1	Summary of Post-Excavation Sampling Activities
Table 2	Post-Excavation Soil Sampling Results
Table 3	Groundwater Sampling Results

FIGURES

Figure 1	Site Location Map
Figure 1A	Geological Map
Figure 2	Site Map
Figure 3	Cross Sectional View
Figure 4	Soil Sampling Location Map
Figure 5	Groundwater Sampling Location Map

APPENDICES

Appendix A	NJDEP Standard Reporting Form
Appendix B	Site Assessment Summary
Appendix C	Waste Manifest
Appendix D	UST Disposal Certificate
Appendix E	Soil Analytical Data Package
Appendix F	Groundwater Analytical Data Package
Appendix G	Photographs
Appendix H	Electronic Data Deliverables

EXECUTIVE SUMMARY

UST Closure

On February 19, 1997, a steel underground storage tank (UST) was closed by removal in accordance with New Jersey Department of Environmental Protection (NJDEP) closure procedures at the Main Post-East area of the U.S. Army Fort Monmouth, Fort Monmouth, New Jersey. The UST, NJDEP Registration No. 0090010-52 (Fort Monmouth ID No. 475), was located southeast of Building 475. UST No. 0090010-52 was a 1,080-gallon #2 fuel oil UST.

Site Assessment

The site assessment was performed by U.S. Army personnel in accordance with the NJDEP *Technical Requirements for Site Remediation* (N.J.A.C. 7:26E) and the NJDEP *Field Sampling Procedures Manual*. The sampling and laboratory analysis conducted during the site assessment were performed in accordance with Section 7:26E-2.1 of the *Technical Requirements for Site Remediation*. Soils surrounding the tank were screened visually and with air monitoring equipment for evidence of contamination. Following removal, the UST was inspected for corrosion holes. No holes or punctures were noted in the UST. Stained soil was observed at the east end of the tank, adjacent to the fill port. The NJDEP hotline was notified and the case was assigned DICAR No. 97-02-19-1352-57. Approximately 60 cubic yards of potentially contaminated soil were removed from the excavated area and stored at the Fort Monmouth petroleum contaminated soil staging area. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from non-detect to 401.00 mg/kg. Groundwater was encountered at 6.0 feet below ground surface and sheen was observed on groundwater.

All post excavation soil samples collected from the UST excavation at Building 475 contained TPHC concentrations below the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 milligrams per kilogram (mg/kg) (N.J.A.C. 7:26D and revisions dated February 3, 1994). Following receipt of all post-excavation soil sampling results, the excavation was backfilled to grade with a combination of uncontaminated excavated soil and certified clean fill. The excavation site was then restored to its original condition.

In response to the observation of sheen on groundwater, two (2) groundwater samples were collected at Building 475. On November 6, 1999, and December 11, 1999, Building 475 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). All groundwater analytical results were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 90010-52 at Building 475.

1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES

1.1 OVERVIEW

One underground storage tank (UST), New Jersey Department of Environmental Protection (NJDEP) Registration No. 90010-52, was closed at Building 475 at the Main Post-East area of U.S. Army Fort Monmouth, Fort Monmouth, New Jersey on February 19, 1997. Refer to the site location map on Figure 1. This report presents the results of the Department of Public Works' (DPW) implementation of the UST Decommissioning/Closure Plan approved by the NJDEP. The UST was a steel 1,080-gallon tank containing No. 2 fuel oil.

Decommissioning activities for UST No. 90010-52 complied with all applicable Federal, State, and Local laws and ordinances in effect at the date of decommissioning. These laws included but were not limited to N.J.A.C. 7:14B-1 et seq., N.J.A.C. 5:23-1 et seq., and Occupational Safety and Health Administration (OSHA) 1910.146 & 1910.120. All permits including but not limited to the NJDEP approved Decommissioning/Closure Plan were posted onsite for inspection. The decommissioning activities were conducted by DPW personnel who are registered and certified by the NJDEP for performing UST closure activities. Closure of UST No. 90010-52 proceeded under the approval of the NJDEP Bureau of Federal Case Management (NJDEP-BFCM). The Standard Reporting Form and signed Site Assessment Summary form for UST No. 90010-52 are included in Appendices A and B, respectively.

After removal of the potentially contaminated soil, the site was assessed. Based on inspecting the UST, field screening of remaining subsurface soils, and reviewing analytical results of soil samples and groundwater samples, the DPW has concluded that no significant historical discharges are associated with the UST or associated piping.

This UST Closure and Site Investigation Report has been prepared by Versar, to assist the U.S. Army DPW in complying with the NJDEP regulations. The applicable NJDEP regulations at the date of closure were the *Interim Closure Requirements for Underground Storage Tank Systems* (N.J.A.C. 7:14B-1 et seq. October 1990 and revisions dated November 1, 1991).

This report was prepared using information collected at the time of closure. Section 1 of this UST Closure and Site Investigation Report provides a summary of the UST decommissioning activities. Section 2 of this report describes the site investigation activities. Conclusions and recommendations, including the results of the soil sampling and groundwater investigation, are presented in the final section of this report.

1.2 SITE DESCRIPTION

Building 475 is located in the Main Post-East area of the Fort Monmouth Army Base. UST No. 0090010-52 was located southeast of Building 475 and appurtenant copper piping ran approximately five (5) feet northwest from the excavation to Building 475. A site map is provided on Figure 2.

1.2.1 Geological/Hydrogeological Setting

The following is a description of the geological/hydrogeological setting of the area surrounding Building 475. Included is a description of the regional geology of the area surrounding Fort Monmouth as well as descriptions of the local geology and hydrogeology of the Main Post area. A geological map is provided on Figure 1A.

Regional Geology

Monmouth County lies within the New Jersey Section of the Atlantic Coastal Plain physiographic province. The Main Post, Charles Wood, and the Evans areas are located in what may be referred to as the Outer Coastal Plain subprovince, or the Outer Lowlands.

In general, New Jersey Coastal Plain formations consist of a seaward-dipping wedge of unconsolidated deposits of clay, silt, and gravel. These formations typically strike northeast-southwest with a dip ranging from 10 to 60 feet per mile and were deposited on Precambrian and lower Paleozoic rocks (Zapeczka, 1989). These sediments, predominantly derived from deltaic, shallow marine, and continental shelf environments, date from Cretaceous through the Quaternary Periods. The mineralogy ranges from quartz to glauconite.

The formations record several major transgressive/regressive cycles and contain units which are generally thicker to the southeast and reflect a deeper water environment. More than 20 regional geologic units are present within the sediments of the Coastal Plain. Regressive, upward coarsening deposits are usually aquifers (e.g., Englishtown and Kirkwood Formations, and the Cohanse Sand) while the transgressive deposits act as confining units (e.g., the Merchantville, Marshalltown, and Navesink Formations). The individual thicknesses for these units vary greatly (i.e., from several feet to several hundred feet). The Coastal Plain deposits thicken to the southeast from the Fall Line to greater than 6,500 feet in Cape May County (Brown and Zapeczka, 1990).

Local Geology

Based on the regional geologic map (Jablonski, 1968), the Cretaceous age Red Bank and Tinton Sands outcrop at the Main Post area. The Red Bank sand conformably overlies the Navesink Formation and dips to the southeast at 35 feet per mile. The upper member (Shrewsbury) of the Red Bank sand is a yellowish-gray to reddish brown clayey, medium-to-coarse-grained sand that contains abundant rock fragments, minor mica and glauconite (Jablonski). The lower member (Sandy Hook) is a dark gray to black, medium-to-fine grained sand with abundant clay, mica, and glauconite.

The Tinton sand conformably overlies the Red Bank Sand and ranges from a clayey medium to very coarse grained feldspathic quartz and glauconite sand to a glauconitic coarse sand. The color varies from dark yellowish orange or light brown to moderate brown and from light olive to grayish olive. Glauconite may constitute 60 to 80 percent of the sand fraction in the upper part of the unit (Minard, 1969). The upper part of the Tinton is often highly oxidized and iron oxide encrusted (Minard).

Hydrogeology

The water table aquifer in the Main Post area is identified as part of the "composite confining units," or minor aquifers. The minor aquifers include the Navesink formation, Red Bank Sand, Tinton Sand, Hornerstown Sand, Vincentown Formation, Manasquan Formation, Shark River Formation, Piney Point Formation, and the basal clay of the Kirkwood Formation.

Based on records of wells drilled in the Main Post area, water is typically encountered at depths of 2 to 9 feet below ground surface (bgs). According to Jablonski, wells drilled in the Red Bank and Tinton Sands may produce 2 to 25 gallons per minute (gpm). Some well owners have reported acidic water that requires treatment to remove iron.

Due to the proximity of the Atlantic Ocean to Fort Monmouth, shallow groundwater may be tidally influenced and may flow toward creeks and brooks as the tide goes out, and away from creeks and brooks as the tide comes in. However, an abundance of clay lenses and sand deposits were noted in borings installed throughout Fort Monmouth. Therefore, the direction of shallow groundwater should be determined on a case-by-case basis.

Shallow groundwater is locally influenced within the Main Post area by the following factors:

- tidal influence (based on proximity to the Atlantic Ocean, rivers, and tributaries)
- topography
- nature of the fill material within the Main Post area
- presence of clay and silt lenses in the natural overburden deposits
- local groundwater recharge areas (i.e., streams, lakes)

Due to the fluvial nature of the overburden deposits (i.e., sand and clay lenses), shallow groundwater flow direction is best determined on a case-by-case basis. This is consistent with lithologies observed in borings installed within the Main Post area, which primarily consisted of fine-to-medium grained sands, with occasional lenses or laminations of gravel silt and/or clay.

Building 475 is located approximately 800 feet southwest of Parkers Creek, the nearest water body. Based on the Main Post topography, the groundwater flow in the area of Building 475 is anticipated to be to the northeast.

1.3 HEALTH AND SAFETY

Before, during, and after all decommissioning activities, hazards at the work site which may have posed a threat to the Health and Safety of all personnel who were involved with, or were affected by, the decommissioning of the UST system were minimized. All areas, which posed, or may have been suspected to pose a vapor hazard were monitored by a qualified individual utilizing an organic vapor analyzer (OVA). The individual ascertained if the area was properly vented to render the area safe, as defined by OSHA.

1.4 REMOVAL OF UNDERGROUND STORAGE TANK

1.4.1 General Procedures

- The contractor performing the closure prior to excavation activities identified all underground obstructions (utilities, etc.).
- All activities were carried out with the greatest regard to safety and health and the safeguarding of the environment.
- All excavated soils were visually examined and screened with an OVA for evidence of contamination. Potentially contaminated soils were identified and logged during closure activities.
- Surface materials (i.e., asphalt, concrete, etc.) were excavated and staged separately from all soil and recycled in accordance with all applicable regulations and laws.
- A Sub-Surface Evaluator from the DPW was present during all site assessment activities.

1.4.2 Underground Storage Tank Excavation and Cleaning

Prior to UST decommissioning activities, surficial soil was removed to expose the UST and associated piping. All free product present in the piping was drained into the UST, and the UST was purged to remove vapors prior to cutting and removal of the piping. After removal of the associated piping, a manway was made in the UST to allow for proper cleaning. The UST was completely emptied of all liquids prior to removal from the ground. Approximately 155 gallons of liquid from the UST and its associated piping were transported by Lionetti Oil Recovery Co. Inc to the Lionetti Oil Recovery Co. Inc. facility, a NJDEP-approved petroleum recycling and disposal company located in Old Bridge, New Jersey. Refer to Appendix C for the waste manifest.

The UST was cleaned prior to removal from the excavation in accordance with the NJDEP regulations. After the UST was removed from the excavation, it was staged on polyethylene sheeting and examined for holes. No holes or punctures were noted in the UST during the inspection by the Sub-Surface Evaluator. Soils surrounding the UST were screened visually and with an OVA for evidence of contamination. Stained soil was observed at the east end of the tank, adjacent to the fill port. Approximately 60 cubic yards of potentially contaminated soil were removed from the excavated area and transported to the Main Post petroleum contaminated soil holding area. Soil screening was also performed along the piping associated with the UST. No contamination was noted anywhere along the piping length. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from non-detect to 401.00 mg/kg. Groundwater was encountered at 6.0 feet below ground surface and sheen was observed on groundwater. See Figure 3 for a cross-sectional view of the excavated area.

1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL

The tank was transported in compliance with all applicable regulations and laws to Mazza and Sons, Inc. Please refer to Appendix D for the UST Disposal Certificate and Appendix G for photographs of the tank.

The UST was labeled prior to transport with the following information:

- Site of origin
- Contact person
- NJDEP UST Facility ID number
- Former contents
- Destination site
- Date

1.6 MANAGEMENT OF EXCAVATED SOILS

Based on OVA air monitoring and TPHC analysis results from the post-excavation soil samples, approximately 60 cubic yards of potentially contaminated soil were removed from the UST excavation. All potentially contaminated soils were stockpiled separately from other excavated material and were placed on and covered with polyethylene sheets. Potentially contaminated soils were transported to the soil staging area. Soils that did not exhibit signs of contamination were used as backfill following the removal of the UST. Groundwater was encountered at 6.0 feet below ground surface and sheen was observed on groundwater.

2.0 SITE INVESTIGATION ACTIVITIES

2.1 OVERVIEW

The Site Investigation was managed and carried out by U.S. Army DPW personnel. All analyses were performed and reported by U.S. Army Fort Monmouth Environmental Laboratory, a NJDEP-certified testing laboratory. All sampling was performed under the direct supervision of a NJDEP Certified Sub-Surface Evaluator according to the methods described in the NJDEP *Field Sampling Procedures Manual* (1992). Sampling frequency and parameters analyzed complied with the NJDEP document *Interim Closure Requirements for Underground Storage Tank Systems* (October 1990 and revisions dated November 1, 1991) which was the applicable regulation at the date of the closure. The Fort Monmouth DPW Environmental Office maintains all records of the Site Investigation activities.

The following Parties participated in Closure and Site Investigation Activities:

- Project Manager: Eugene Lesinski
Employer: U.S. Army, Fort Monmouth
Phone Number: (732) 532-6224
NJDEP Certification No.: 14537
- Analytical Laboratory: U.S. Army Fort Monmouth Environmental laboratory
Contact Person: Daniel K. Wright
Phone Number: (908) 532-4359
NJDEP Company Certification No.: 13461
- Hazardous Waste Hauler: Lorco Petroleum Services
Contact Person: Anibal Vasquez
Phone Number: (908) 532-6223

2.2 FIELD SCREENING/MONITORING

Field screening was performed by a NJDEP Certified Sub-Surface Evaluator using an OVA and visual observations to identify potentially contaminated material. Approximately 60 cubic yards of potentially petroleum contaminated soil were removed from the excavated area and transported to the Fort Monmouth petroleum contaminated soil holding area. Soils were removed from the excavation until no evidence of contamination remained. Groundwater was encountered at 6.0 feet below ground surface and sheen was observed on groundwater.

2.3 SOIL SAMPLING

On February 24, 1997, following the removal of the UST and associated piping, post-excavation soil samples A, B, C, D, E, F, G, H, I, J, and DUP G were collected from a total of ten (10) locations of the UST excavation. Sidewall samples A, B, C, D, E, and F were collected at a depth of 5.5 feet bgs. Excavation floor samples G, H, I, and DUP G were collected at a depth of 8.5 feet bgs. Piping sample J was collected at a depth of 1.0 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

On March 17, 1997, following the removal of potentially contaminated soil from the east end of the excavation area, post-excavation soil samples A, B, and DUP A were collected from a total of three (3) locations of the UST excavation. Sidewall samples A and DUP A were collected at a depth of 5.5 feet bgs. Excavation floor sample B was collected at a depth of 8.5 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

DPW personnel in accordance with the NJDEP Technical Requirements and the NJDEP Field Sampling Procedures Manual performed the site assessment. A summary of sampling activities including parameters analyzed is provided in Table 1. The post-excavation soil samples were collected using NJDEP *Field Sampling Procedures Manual* (1992) standard sampling procedures. Following soil sampling activities, the samples were chilled and delivered to U.S. Army Fort Monmouth Environmental Laboratory located in Fort Monmouth, New Jersey, for analysis.

2.4 GROUNDWATER SAMPLING

On November 6, 1999, and December 11, 1999, Building 475 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). Sampling and analysis were performed in accordance with the NJDEP *Field Sampling Procedures Manual* and the *Technical Requirements For Site Remediation*. Refer to Appendix F for the field sampling documentation.

3.0 CONCLUSIONS AND RECOMMENDATIONS

3.1 SOIL SAMPLING RESULTS

To evaluate soil conditions following removal of the UST and associated piping, post-excavation soil samples were collected on February 24, 1997, and March 17, 1997 from a total of thirteen (13) locations. All samples were analyzed for TPHC and total solids. The post-excavation sampling results were compared to the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 mg/kg (N.J.A.C. 7:26D and revisions dated February 3, 1994). A summary of the analytical results and comparison to the NJDEP soil cleanup criteria is provided in Table 2 and the soil sampling locations are shown on Figure 4. The analytical data package is provided in Appendix E.

All post-excavation soil samples collected on February 24, 1997, and March 17, 1997, from the UST excavation and from below piping associated with the UST contained concentrations of TPHC below the NJDEP soil cleanup criteria. Soil samples, which were collected after the removal of the potentially contaminated soil, contained TPHC concentrations ranging from non-detect to 401.00 mg/kg.

3.2 GROUNDWATER SAMPLING RESULTS

No compounds were detected in the sample collected from Building 475 on November 6, 1999.

The sample collected from Building 475 on December 11, 1999, contained 2-butanone at 5.64 ug/l. No other compounds were detected. 2-butanone was also detected in the Dup at a concentration of 5.32 ug/l. No other compounds were detected in the Dup.

A summary of the analytical results and comparison to the NJDEP groundwater cleanup criteria is provided in Table 3 and the groundwater sampling locations are shown on Figure 5. The analytical data package is provided in Appendix F. The full data package, including quality control, is on file at U.S. Army Fort Monmouth, Fort Monmouth, New Jersey.

Groundwater samples collected on November 6, 1999, and December 11, 1999, were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

3.3 CONCLUSIONS AND RECOMMENDATIONS

The analytical results for all post-excavation soil samples collected from the UST closure excavation at Building 475 were below the NJDEP soil cleanup criteria for total organic contaminants.

Based on the post-excavation sampling results, soil with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST or associated piping.

Based on the analytical results of the groundwater samples collected at Building 475 on November 6, 1999, and December 11, 1999, groundwater quality at Building 475 was either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 90010-52 at Building 475.

TABLES

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
 BUILDING 475, MAIN POST-EAST AREA
 FORT MONMOUTH, NEW JERSEY

Page 1 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
A	2/24/97	2/28/97	Soil	Post-Excavation	TPHC	OQA-QAM-025
B	2/24/97	2/28/97	Soil	Post-Excavation	TPHC	OQA-QAM-025
C	2/24/97	2/28/97	Soil	Post-Excavation	TPHC	OQA-QAM-025
D	2/24/97	2/28/97	Soil	Post-Excavation	TPHC	OQA-QAM-025
E	2/24/97	2/28/97	Soil	Post-Excavation	TPHC	OQA-QAM-025
F	2/24/97	2/28/97	Soil	Post-excavation	TPHC	OQA-QAM-025
G	2/24/97	2/28/97	Soil	Post-Excavation	TPHC	OQA-QAM-025
H	2/24/97	2/28/97	Soil	Post-excavation	TPHC	OQA-QAM-025
I	2/24/97	2/28/97	Soil	Post-Excavation	TPHC	OQA-QAM-025
J	2/24/97	2/28/97	Soil	Post-excavation	TPHC	OQA-QAM-025
DUPG	2/24/97	2/28/97	Soil	Post-excavation	TPHC	OQA-QAM-025

Note:

- * TPHC Total Petroleum Hydrocarbons
- ** Sample was further remediated and resampled

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 475, MAIN POST-EAST AREA
FORT MONMOUTH, NEW JERSEY

Page 2 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
A	3/17/97	3/19/97	Soil	Post-Excavation	TPHC	OQA-QAM-025
B	3/17/97	3/19/97	Soil	Post-Excavation	TPHC	OQA-QAM-025
DUPA	3/17/97	3/19/97	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

TABLE 1

SUMMARY OF SAMPLING ACTIVITIES
BUILDING 475, MAIN POST-EAST AREA
FORT MONMOUTH, NEW JERSEY

Page 3 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	Sampling Method**
4927.01	11/6/99	11/10/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
5010.01	12/11/99	12/13/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
5010.02	12/11/99	12/13/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
5010.03	12/11/99	12/13/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP

Note:

- *VOCs: Volatile Organic Compounds plus 15 tentatively identified compounds
*SVOCs: Semivolatile organic compounds plus 15 tentatively identified compounds
**PPNDP: Passively Placed Narrow Diameter Point

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 475, MAIN POST-EAST AREA
 FORT MONMOUTH, NEW JERSEY

Page 1 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
A/5.5=	2360.01	2/24/97	2/24/97	Total Solid	--	--	89.21 %	--	--
				TPHC	172	yes	ND	10,000	No
B/5.5=	2360.02	2/24/97	2/24/97	Total Solid	--	--	83.05 %	--	--
				TPHC	187	Yes	ND	10,000	No
C/5.5=	2360.03	2/24/97	2/24/97	Total Solid	--	--	86.92 %	--	--
				TPHC	172	Yes	ND	10,000	No
D/5.5=	2360.04	2/24/97	2/24/97	Total Solid	--	--	88.39 %	--	--
				TPHC	173	yes	1985.93	10,000	No
E/5.5=	2360.05	2/24/97	2/24/97	Total Solid	--	--	88.42 %	--	--
				TPHC	171	yes	ND	10,000	No
F/5.5=	2360.06	2/24/97	2/24/97	Total Solid	--	--	86.86 %	--	--
				TPHC	174	yes	ND	10,000	No
G/8.5=	2360.07	2/24/97	2/24/97	Total Solid	--	--	79.96 %	--	--
				TPHC	193	yes	ND	10,000	No
H/8.5=	2360.08	2/24/97	2/24/97	Total Solid	--	--	77.33 %	--	--
				TPHC	193	yes	ND	10,000	No
I/8.5=	2360.09	2/24/97	2/24/97	Total Solid	--	--	79.11 %	--	--
				TPHC	197	yes	ND	10,000	No
J/1.0=	2360.10	2/24/97	2/24/97	Total Solid	--	--	81.24 %	--	--
				TPHC	188	yes	ND	10,000	No
DUPG/8.5=	2360.11	2/24/97	2/24/97	Total Solid	--	--	81.68 %	--	--
				TPHC	189	yes	ND	10,000	No

Note:

* Total Solid results are expressed as a percentage.

** NJDEP Residential Direct Contact soil cleanup criteria for total organics

*** Sample was further remediated and resampled

ND not detected above stated method detection limit

TPHC Total Petroleum Hydrocarbons

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 475, MAIN POST-EAST AREA
 FORT MONMOUTH, NEW JERSEY

Page 2 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
A/5.5=	2393.01	3/17/97	3/19/97	Total Solid	--	--	89.32 %	--	--
				TPHC	176	yes	155.34	10,000	No
B/8.5=	2393.02	3/17/97	3/19/97	Total Solid	--	--	85.69 %	--	--
				TPHC	180	Yes	401.00	10,000	No
DUPA/5.5=	2393.03	3/17/97	3/19/97	Total Solid	--	--	89.41 %	--	--
				TPHC	171	Yes	148.14	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
- ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
- ND Not detected above stated method detection limit
- TPHC Total Petroleum Hydrocarbons

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 11/6/99 Location: 475 Lab Sample ID: 4927.01(475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 11/6/99 Location: 475 Lab Sample ID: 4927.01(475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 11/6/99Location: 475Lab Sample ID: 4927.01(475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 11/6/99Location: 475Lab Sample ID: 4927.01(475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Ben-zidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.01(Trip Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.01(Trip Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.02(Field Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.02(Field Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.03(Bldg 475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	5.46 ug/L	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.03(Bldg 475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.04(DUP 475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	5.32 ug/L	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.04(DUP 475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/11/99Location: 475Lab Sample ID: 5010.02(Field Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.02(Field Blank)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.03(Bldg 475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.03(Bldg 475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/11/99Location: 475Lab Sample ID: 5010.04(Dup 475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/11/99 Location: 475 Lab Sample ID: 5010.04(Dup 475)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzdine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

FIGURES

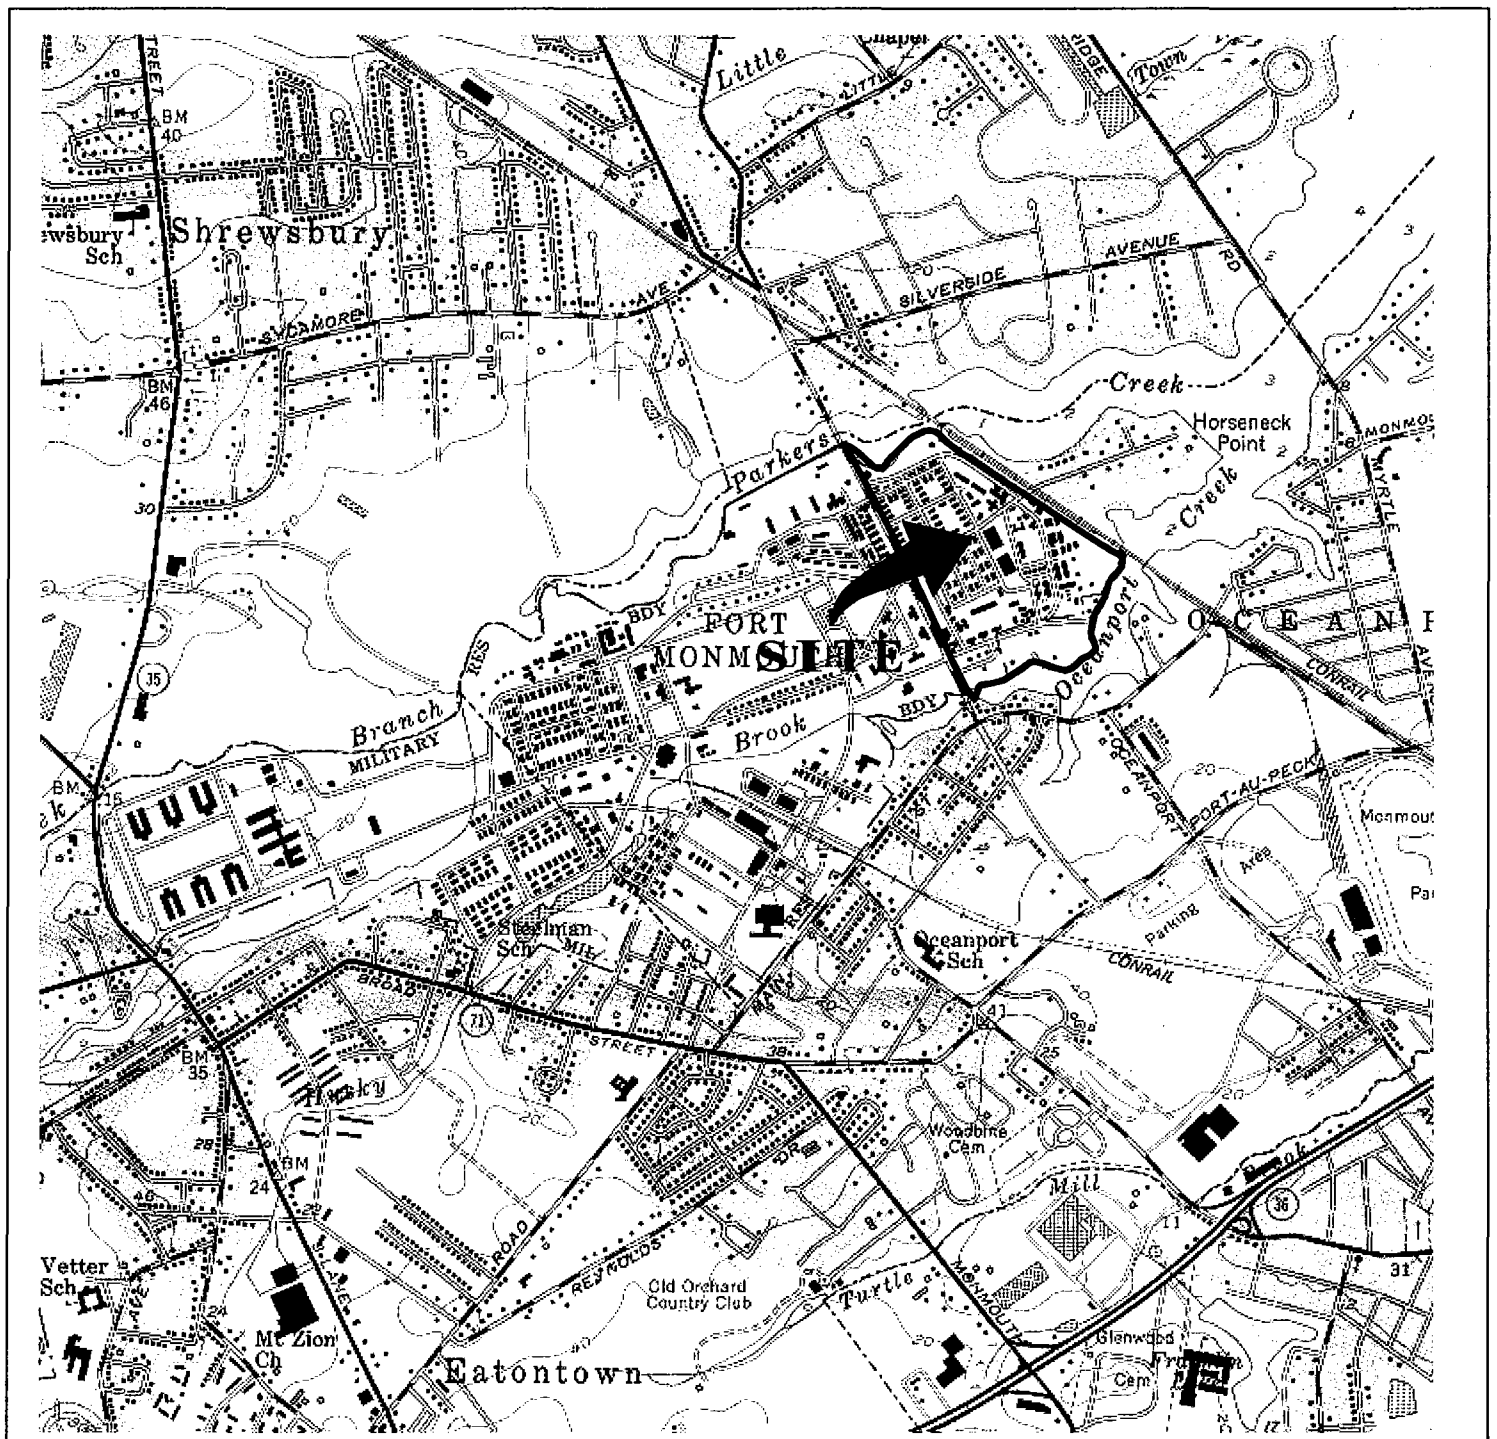


FIGURE 1


LOCATION MAP
Building 475
Main-Post East
Fort Monmouth Army Base
Monmouth County, NJ

VERSAR
 Engineers, Managers, Scientists, & Planners
 Bristol, PA

Scale: 1" = 2000' Date: FEB 1997

LONG BRANCH, N. J.
 40073-C8-TF-024

1954
 PHOTOREVISED 1981
 DMA 6164 I SE-SERIES V822



Geologic Map of New Jersey

SEDIMENTARY ROCKS

CENOZOIC

- Holocene: sand
- Tertiary: sand, silt, clay

MESOZOIC

- Cretaceous: sand, silt, clay
- Jurassic: siltstone, shale, sandstone
- Triassic: siltstone, shale, sandstone

PALEOZOIC

- Devonian: conglomerate, sandstone,
- Silurian: conglomerate, sandstone, shale, limestone
- Ordovician: shale, limestone
- Cambrian: limestone, sandstone

IGNEOUS AND METAMORPHIC ROCKS

MESOZOIC

- Jurassic: basalt
- Jurassic: diabase

PRECAMBRIAN

- marble
- gneiss, granite

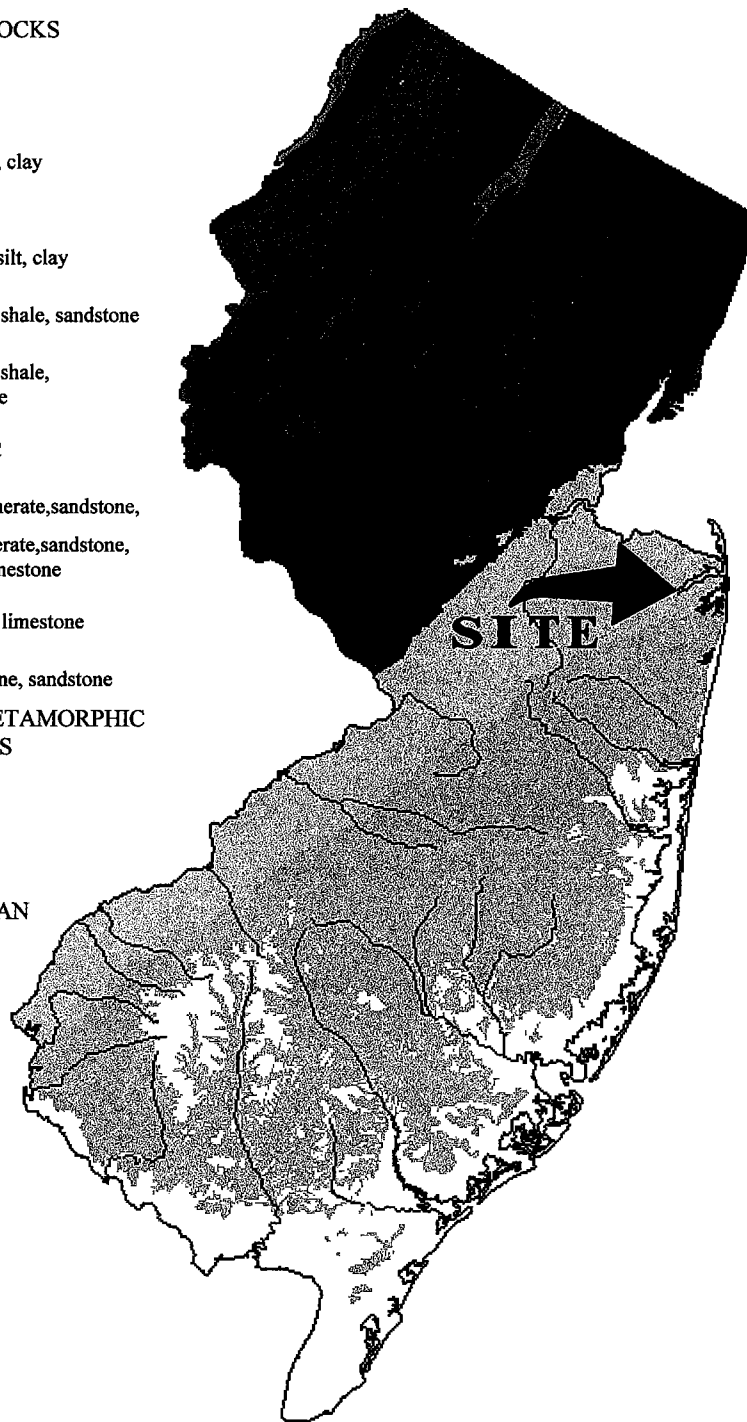


FIGURE 1A
GEOLOGICAL MAP
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
Engineers, Managers, Scientists & Planners
Bristol, Pennsylvania


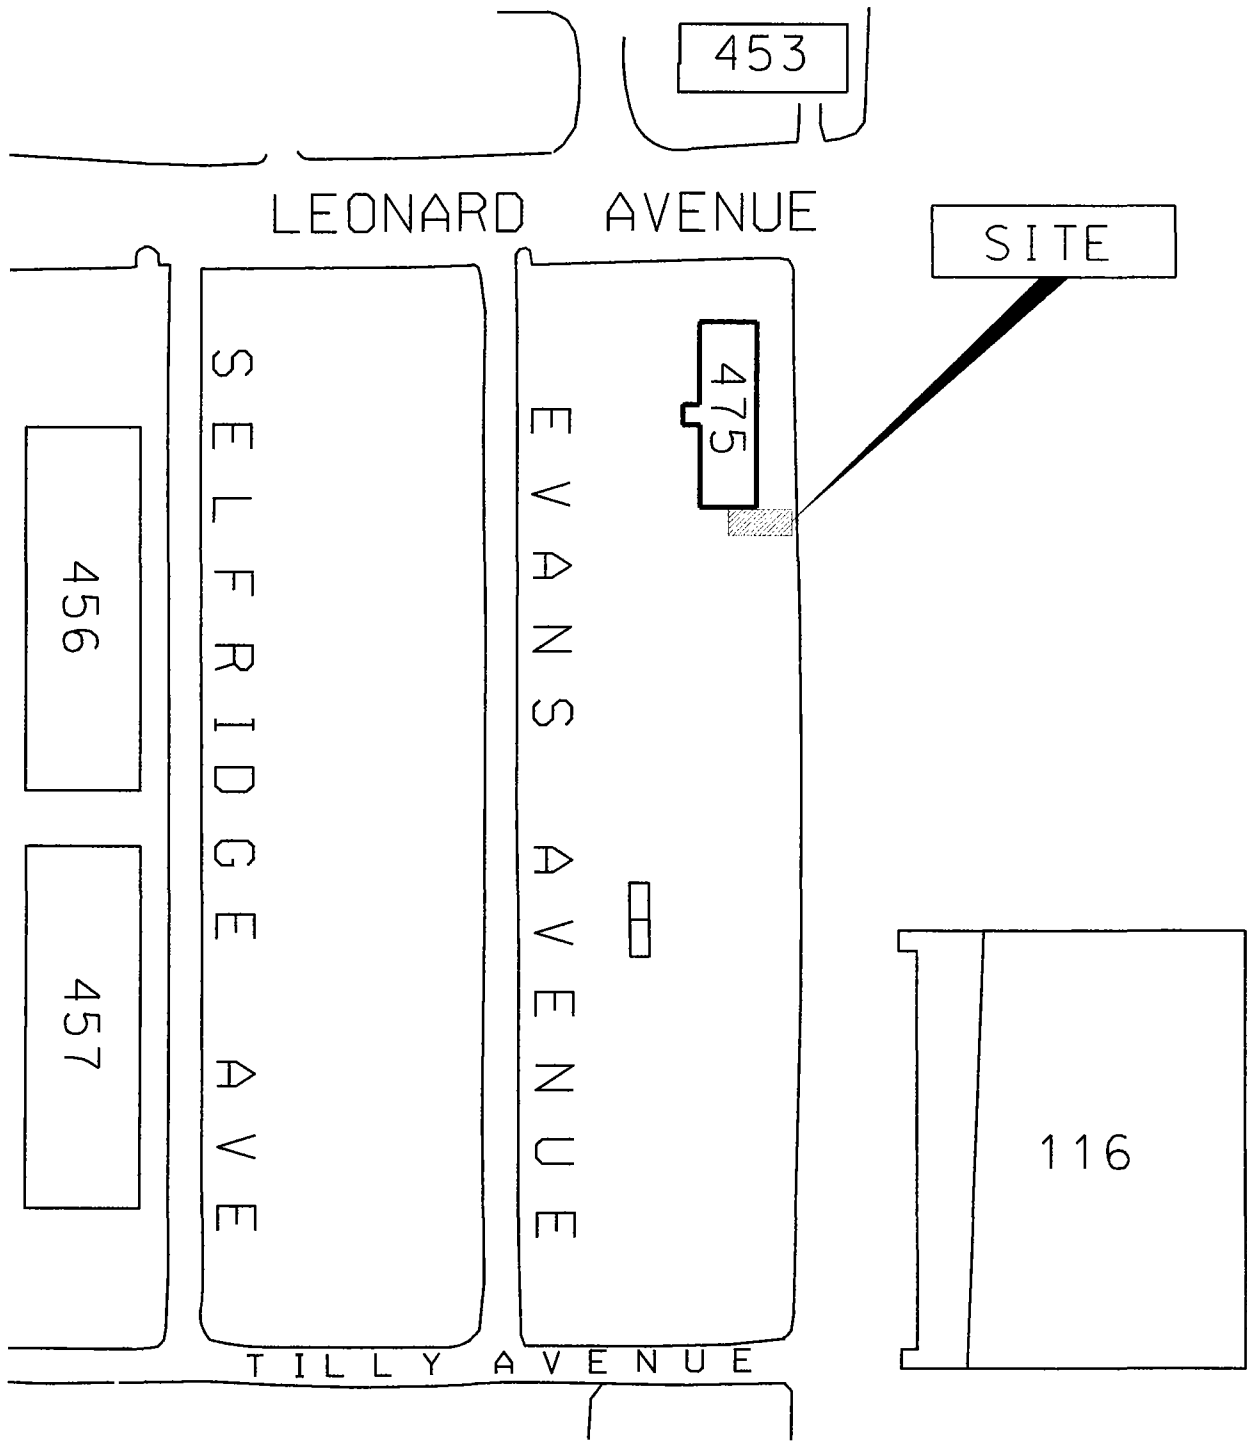


FIGURE 2
 SITE MAP
 BUILDING 475
 FORT MONMOUTH ARMY BASE
 MONMOUTH COUNTY, NJ

VERSAR
 ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
 BRISTOL, PA.

SCALE: 1"=100'	DATE: FEB 1997
----------------	----------------

475 2429 FIG2

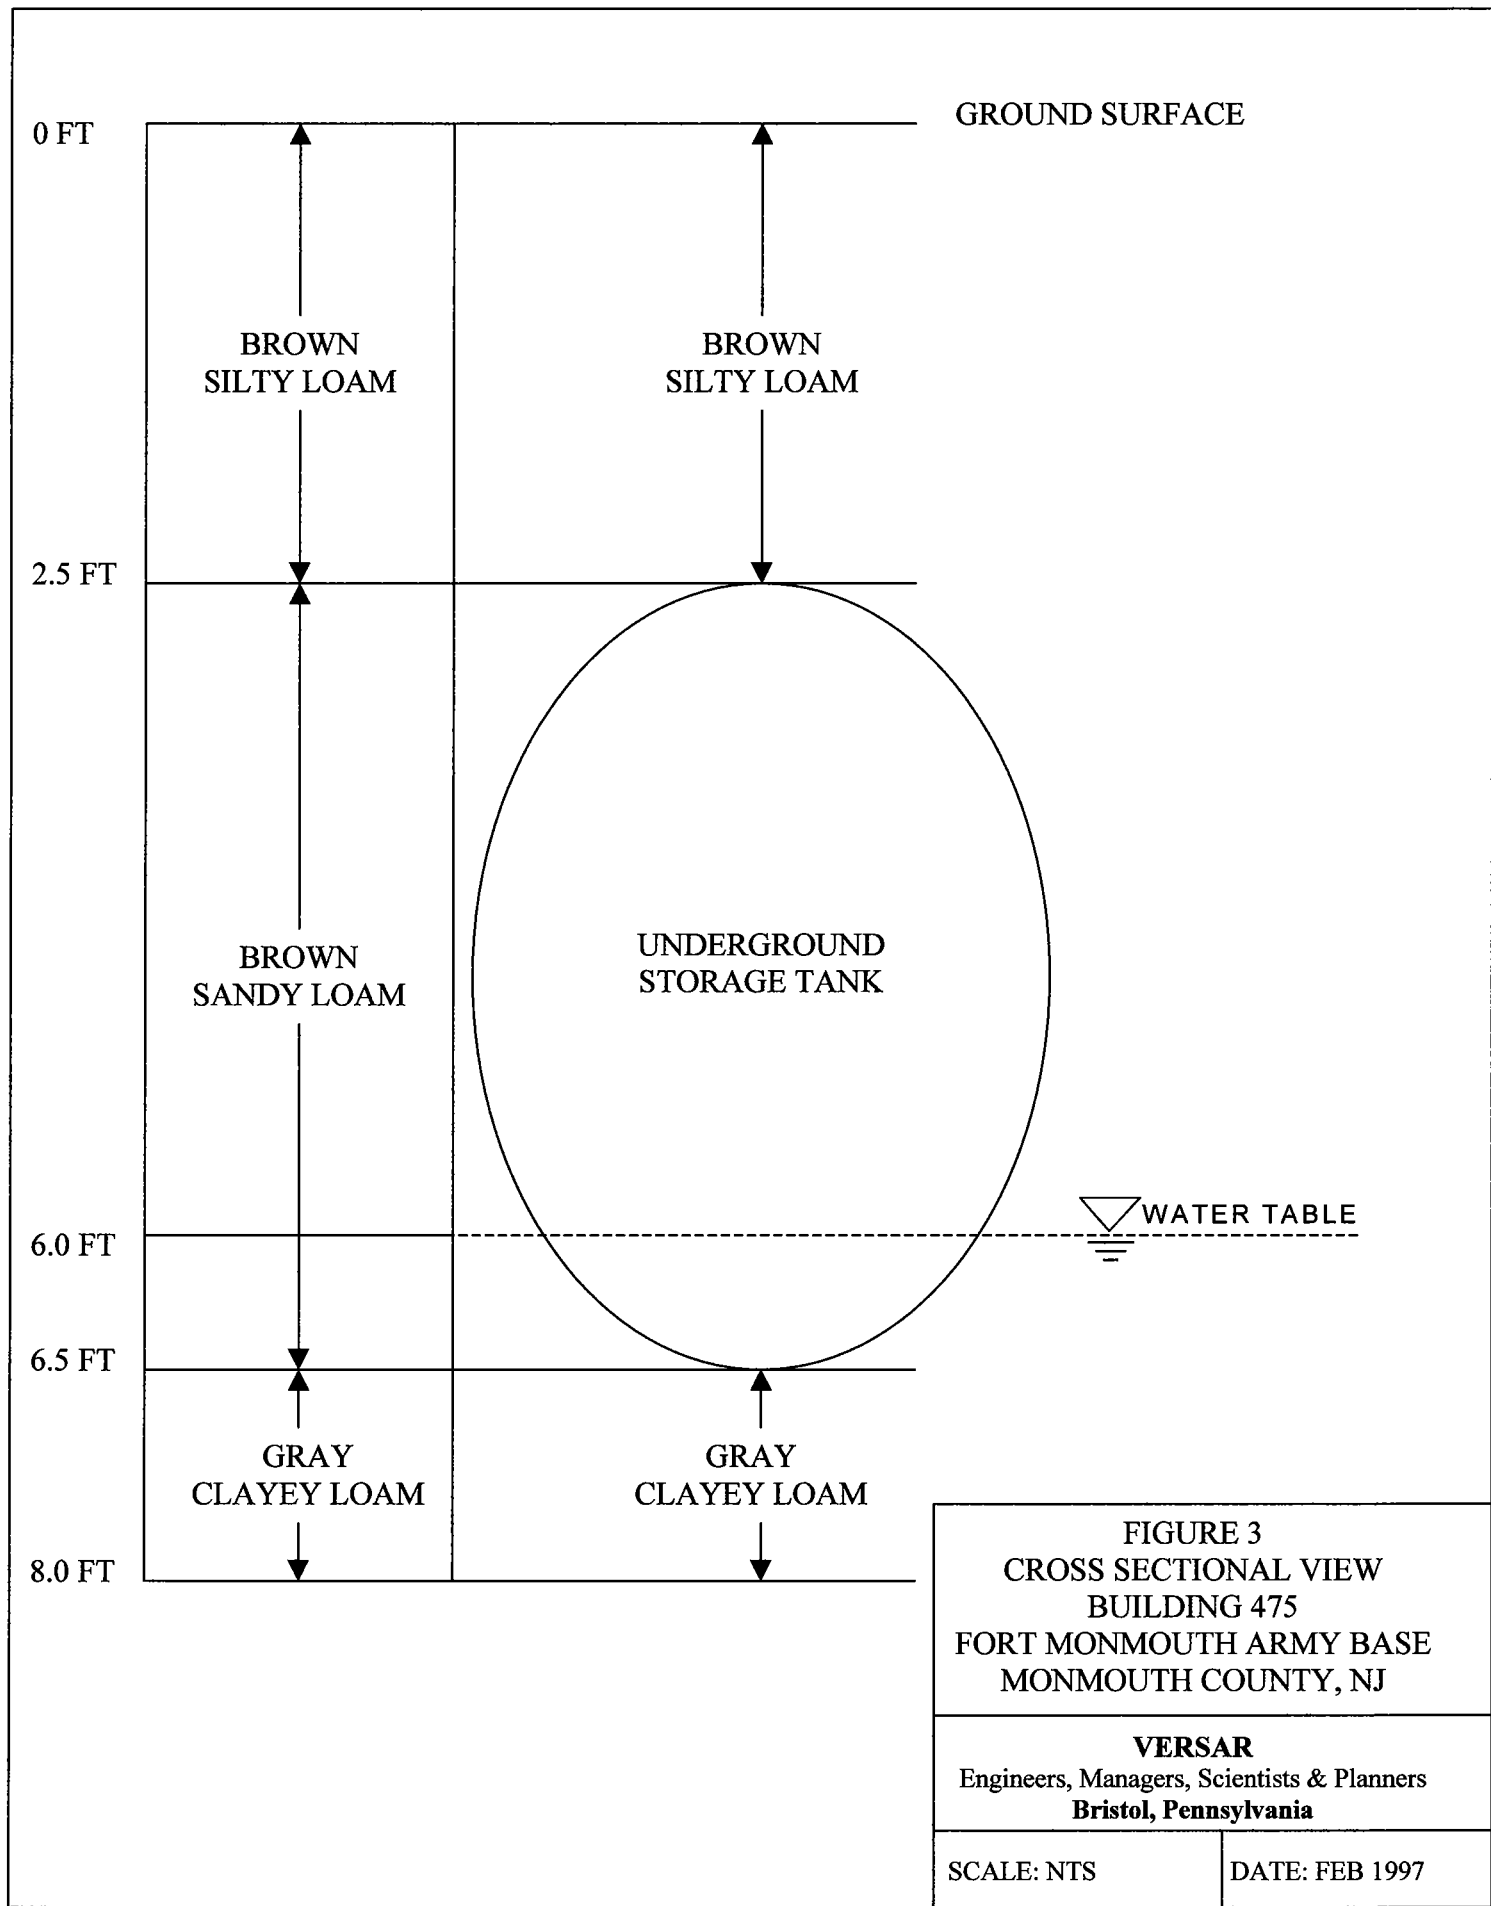

GROUND SURFACE

0 FT

BROWN SILTY LOAM

BROWN SILTY LOAM

2.5 FT

BROWN SANDY LOAM

UNDERGROUND STORAGE TANK

6.0 FT

WATER TABLE

6.5 FT

GRAY CLAYEY LOAM

GRAY CLAYEY LOAM

8.0 FT


FIGURE 3
CROSS SECTIONAL VIEW
BUILDING 475
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
 Engineers, Managers, Scientists & Planners
 Bristol, Pennsylvania

SCALE: NTS

DATE: FEB 1997

BUILDING 475

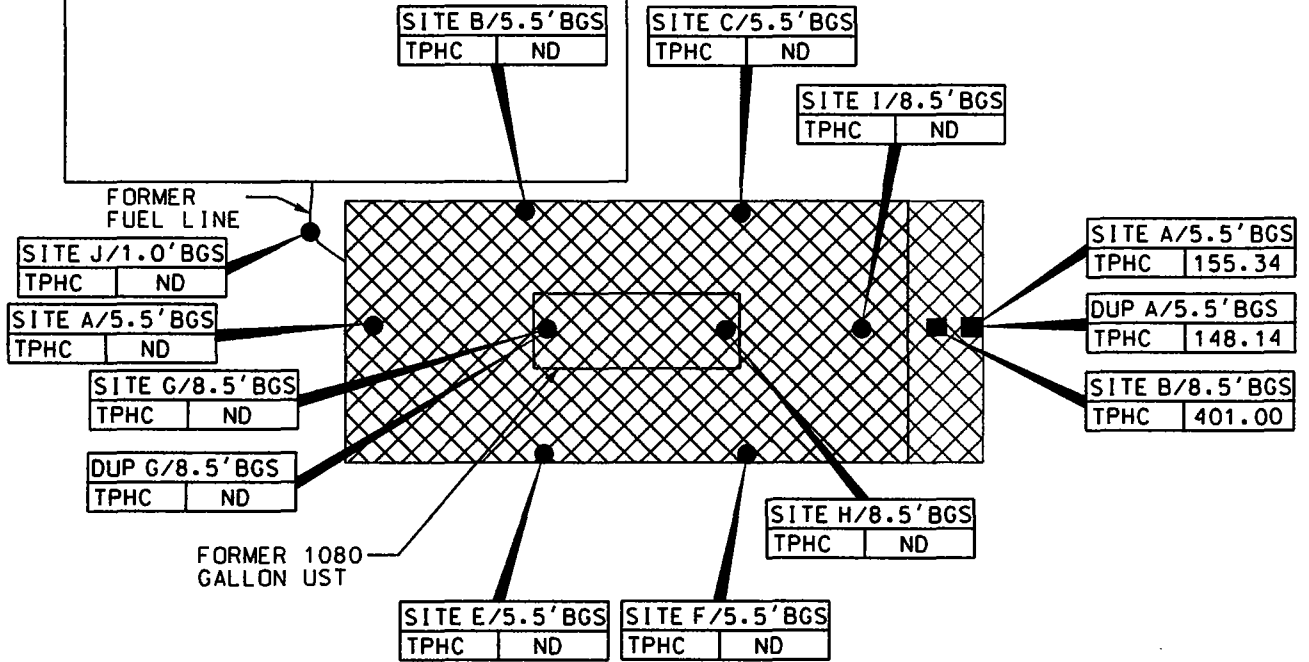

LEGEND

- SOIL SAMPLE LOCATION (FEBRUARY 24, 1997)
- SOIL SAMPLE LOCATION (MARCH 17, 1997)
- ▨ LIMIT OF EXCAVATION (FEBRUARY 24, 1997)
- ▨ LIMIT OF EXCAVATION (MARCH 17, 1997)

NOTES:

1. ALL RESULTS IN MG/KG.
2. SEE TABLE 2 FOR NJDEP SOIL CLEANUP CRITERIA
3. BGS = BELOW GROUND SURFACE



FIGURE 4
SOIL SAMPLING LOCATION MAP
BUILDING 475
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.


SCALE: 1"=10'

DATE: FEB 1997

BUILDING
475

FORMER
FUEL LINE

FORMER 1080
GALLON UST

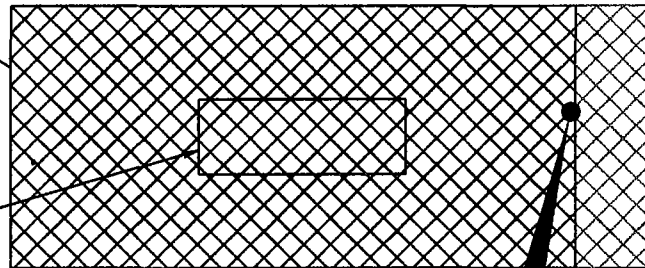

SAMPLING LOCATION:	HIGHER OF	BLDG 475	BLDG 475
SAMPLING DEPTH:	NJDEP GWOS	6-10' BGS	6-10' BGS
SAMPLING DATE:	AND PQL	11/6/99	12/11/99
VOLATILE ORGANIC COMPOUNDS:			
2-BUTANONE:	300 UG/L	ND	5.64 UG/L
SEMIVOLATILE ORGANIC COMPOUNDS:			
		ND	ND

LEGEND

● GROUNDWATER SAMPLE LOCATION
(NOVEMBER 6, 1999 AND DECEMBER 11, 1999)

▣ LIMIT OF EXCAVATION
(FEBRUARY 24, 1997)

▣ LIMIT OF EXCAVATION
(MARCH 17, 1997)

NOTES:

1. ND=INDICATES COMPOUND NOT DETECTED
2. NLE= NO LIMIT ESTABLISHED
3. ALL RESULTS IN UG/L
4. BGS = BELOW GROUND SURFACE

FIGURE 5
GROUNDWATER SAMPLING MAP
BUILDING 475
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=10'

DATE: FEB 1997

APPENDIX A
NJDEP-STANDARD REPORTING FORM



State of New Jersey
Department of Environmental Protection and Energy
Division of Responsible Party Site Remediation
CN 028
Trenton, NJ 08625-0029
ATTN: UST Program
(609) 984-3156

For State Use Only

Date Rec'd.	_____
Auth.	_____
Routing	_____
UST NO.	_____

STANDARD REPORTING FORM
for reporting activities at an UST facility:

<input type="checkbox"/> General Facility Information Changes	<input type="checkbox"/> Sale or Transfer
<input checked="" type="checkbox"/> Closure (Abandonment or Removal)	<input type="checkbox"/> Substantial Modification
<input type="checkbox"/> Temporary Closure	<input type="checkbox"/> Financial Responsibility
<input type="checkbox"/> Change in Service	<input type="checkbox"/> Address Change Only

Check ONLY One Type of Activity - Complete Form For That Activity

(More than one tank can be listed per activity)

*** NOTE *** ALL NEW tank installations at existing registered facilities must submit a Registration Questionnaire for the new tanks.

Answer questions 1 through 5 and others as applicable.

- Company name and address (as it appears on registration questionnaire):
U.S. ARMY - FORT MONMOUTH
DPW - BUILDING 173
FORT MONMOUTH NJ 07703
ATTN: EUGENE W. LESINSKI
- Facility name and location (if different from above):

- Contact person for this activity:
GENE LESINSKI
Telephone Number: (908) 532-0989
- The identification number of the affected tank as it appears in Question Number 12 on the Registration Questionnaire:
BLDG 475
52
- Registration Number (if known):
UST - 0090070
- For GENERAL FACILITY INFORMATION changes (address, telephone, contact person, etc. - supply NEW information only):
 - Facility name: _____
 - Facility location: _____
 - Owner's mailing address: _____

_____ NJ _____
 - Block: _____ Lot: _____
 - Contact person (facility operator): _____
 - Contact telephone number: (_____) _____ - _____
 - Other (Specify): _____

(OVER)

7. For CLOSURE (abandonment or removal - check all that apply):

a. Abandonment Date: / / Case No:

Attach the necessary implementation schedule (3 copies) and all documentation needed for abandonment per N.J.A.C. 7:14B-9.1(d).

b. Removal Date: 2-19-97 Case No. 97-2-19-1352-57

Attach the necessary implementation schedule (3 copies). OPER # 17

8. For CHANGES IN HAZARDOUS SUBSTANCES STORED (check all that apply):

a. Temporary Closure (12 month maximum time - see N.J.A.C. 7:14B-9.1(b)). Remove all hazardous substances; leave tank in place.

b. Change in service from a regulated substance to a non-regulated substance. Tank must be cleaned and site assessment performed per N.J.A.C. 7:14B-9.1(e).

c. Changes in service from one regulated hazardous substance to another regulated hazardous substance.

Tank No. _____	Old _____	New _____
Tank No. _____	Old _____	New _____
Tank No. _____	Old _____	New _____

(Attach additional sheets if more space is needed)

9. For TRANSFER OF OWNERSHIP: Effective Date: / /

a. New Owner (operator) _____

b. New Facility Name _____

_____ NJ _____

_____ County _____

c. Closing Attorney _____ Tele: (____) _____

10. For SUBSTANTIAL MODIFICATIONS (to include any retrofitted activity - e.g. the addition of spill/overflow protection, monitoring systems, cathodic protection, etc.):

a. Type of Modification _____ Date: / /

b. * NOTE * Substantial modifications require a permit under N.J.A.C. 7:14B-10.

11. For changes in FINANCIAL RESPONSIBILITY to (check appropriate changes and attach copies of new information):

- a. Policy Type:
- b. Policy Number:
- c. Other:
- d. Company/Carrier:
- e. Expiration Date:

(Specify)

NOTE: ALL appropriate and applicable permits, licenses and certificates required by the above activity(ies) from any local, state and/or federal agencies must be obtained separately from this notification.

CERTIFICATION

"This registration form shall be signed by the highest ranking individual at the facility with overall responsibility for that facility (N.J.A.C. 7:14B-23 (a) 1)."

"I certify under penalty of law that the information provided in this document is true, accurate and complete. I am aware that there are significant civil and criminal penalties for submitting false, inaccurate or incomplete information, including fines and/or imprisonment."

Signature: James Ott

Name (print or type): JAMES OTT

Title: DIRECTOR - DEPT OF PUBLIC WORKS Date: 2/22/97

APPENDIX B
SITE ASSESSMENT SUMMARY

Site Remediation Program

UST Site/Remedial Investigation Report Certification Form

A. Facility Name : U.S. Army Fort Monmouth New Jersey

Facility Street Address : Directorate of Public Works Building 173

Municipality: Oceanport County : Monmouth

Block: Lot(s): Telephone Number : 732-532-6224

B. Owner (RP)'s Name:

Street Address: City :

State: Zip: Telephone Number :

C. (Check as appropriate)

- Site Investigation Report (SIR) \$500 Fee
Remedial Investigation Report (RIR) \$1000 Fee

X NA - Federal Agreement

D. (Complete all that apply)

- Assigned Case Manager : Ian Curtis, Federal Case Manager
UST Registration Number : 90010-52 (7 digits)
Incident Report Number 97 - 02 - 19 - 1352 - 57 (10 or 12 digits)
Tank Closure Number : Federal Case Manager

E. Certification by the Subsurface Evaluator:

The attached report conforms to the specific reporting requirements of N.J.A.C. 7:26EYes No

Name: Eugene Lesinski Signature: See signed subsurface removal log UST Cert. No.: 14537

Firm: U.S. Army Fort Monmouth Firm's UST Cert. Number: NA-U.S. Army

Firm Address: Directorate of Public Works Building 173 City: Fort Monmouth

State: NJ Zip: 07703 Telephone Number : 732-532-6224

(NOTE: Certification numbers required only if work was conducted on USTs regulated per N.J.S.A. 58:10A-21 et seq.)

F. Certification by the Responsible Party(ies) of the Facility:

The following certification shall be signed [according to the requirements of N.J.A.C. 7:14B-1.7(b)]as follows:

- 1. For a Corporation by a person authorized by a resolution of the board of directors to sign the document.
2. For a partnership or sole proprietorship, by a general partner or the proprietor, respectively; or
3. For a municipality, State, federal or other public agency by either a principal executive officer or ranking elected Official.

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attached documents, and that based on my inquiry of those individuals responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete. I am aware that there are significant civil penalties for knowingly submitting false, inaccurate, or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Name (Print or Type): James Ott Title: Directorate of Public Works

Signature: [Handwritten Signature]

Company Name: U.S. Army Fort Monmouth Date: 9/24/00

DAILY UST SUBSURFACE REMOVAL LOG

BLDG.#: 475 REG.#: 0090010 - 52 CLOSURE#: N/A
 DATE: 2-19-97 TOA: 1300 TOD: 1500
 GOV. SSE: LESINSKI NJDEP CERT.#: 0014537
 REMOVAL CONTRACTOR: SAI Inc.
 CLOSURE SUPERVISOR: D. Martinis NJDEP CERT.#: —
 WEATHER: SUNNY - 60° F

ACTIVITY	YES / NO
THE SUPERVISOR (CLOSURE CERT.) WAS ON-SITE DURING ALL CLOSURE RELATED ACTIVITIES	Y
THE SSE WAS ON-SITE DURING UST REMOVAL AND SITE SCREENING AND SAMPLING ACTIVITIES	Y
ALL ON-SITE PERSONNEL HAD TRAINING IAW ALL SAFETY REQUIREMENTS (E.G. 29CFR)	Y
A CONFINED ENTRY PERMIT WAS COMPLETED AND POSTED ON-SITE BY THE CONTRACTOR	N/A
THE UST WAS PLACED ONTO PLASTIC, SCRAPED OFF, INSPECTED FOR HOLES AND PHOTOGRAPHED	Y
A DISCHARGE WAS REPORTED TO THE NJDEP (609-292-7172), CASE# _____	
PHOTOS HAVE UST#, BLDG. #, DATE, TIME, NAME OF SSE AND DESCR. WRITTEN ON BACK	Y
GROUNDWATER WAS ENCOUNTERED AT <u>6.5</u> FEET BG, A SHEEN (WAS/WAS NOT) OBSERVED ON GW	Y
IF OVA/Hnu WAS USED: WAS IT CAL. AND FOUND TO BE OPERATIONAL (cal. data on COC)	N/A
IF SAMPLES WERE TAKEN: COC, SCALED SITE MAP (VERT. SOIL HORIZONS AND PLOT PLAN)	
ALL SAMPLE COLLECTION ACTIVITIES WERE AS DESCRIBED IN THE NJDEP FSPM, 1992	
ALL SAMPLING WAS BIASED TOWARD HIGHEST OVA/FID RECORDED SITES IAW 7:26E-3.6 <u>et seq.</u>	
ALL PETROL. CONT. SOILS WERE SECURED FROM THE WEATHER BY CLOSE OF BUSINESS TODAY	Y
THE SSE AUTHORIZED BACKFILLING THE EXCAVATION (STONE TO 1" ABOVE GROUNDWATER)	N/A
ADDITIONAL NOTES WERE TAKEN AND ARE RECORDED ON THE BACK OF THIS FORM	
THE FOLLOWING DOCUMENTS WERE ADDED TO THE PROJECT FOLDER TODAY: (CIRCLE EACH) SCRAP TICKET, CSE PERMIT, ACCIDENT REPORT, HAZ. WASTE MANIFEST, DAILY UST CLOSURE LOG, SCALED SITE MAP (SAMPLING), SRF-CLOSURE, CHAIN OF CUSTODY, SOIL ANALYTICAL RESULTS, CLEAN FILL TICKETS (IN YDS ³), PHOTOGRAPHS (UST, EXCAVATION, SAMPLING POINTS)	Y

CHECK ALL BOXES. LEAVE NO BLANKS

I certify under penalty of law that tank decommissioning activities were performed in compliance with N.J.A.C. 7:14B-9.2(b)3 and 7:26 et seq.. I am aware that there are significant penalties for submitting false, inaccurate, or incomplete information, including fines and/or imprisonment.

SIGNATURE: _____ DATE: 2-19-97

ca\ms\ust\removal\sitessls.doc

2-20-97 Remediate Site
 2-21-97 On site 1300-1600 for samples

APPENDIX C
WASTE MANIFEST

LORCO PETROLEUM SERVICES

RD 1 BOX 5A

OLD BRIDGE, NJ 08857

NON-HAZARDOUS WASTE MANIFEST

1. Generator's US EPA ID No. **N.J.3.21.0.02059.702.6.8.7**
 Manifest Document No.

2. Page 1 of 1

NHZ 002607

3. Generator's Name and Mailing Address
U.S. ARMY COMMUNICATIONS ELECTRONICS COMMAND
MAIN POST - C/O JES FALLON - BLDG 173
FORT MONMOUTH, NJ 07703 ATTN: SELFH-PW-EV
 4. Generator's Phone (**908 532-6223**)

5. Transporter 1 Company Name
LIONETTI OIL RECOVERY CO INC

6. US EPA ID Number
N J D 0 8 4 0 4 4 0 6 4

A. Transporter's Phone
908 721-0900

7. Transporter 2 Company Name

8. US EPA ID Number

B. Transporter's Phone

9. Designated Facility Name and Site Address
LIONETTI OIL RECOVERY CO INC DBA LORCO PETROLEUM SVCS
RUNYON&CHEESEQUAKE RDS
OLD BRIDGE, NJ 08857

10. US EPA ID Number
N J D 0 8 4 0 4 4 0 6 4

C. Facility's Phone
908 721-0900

11. Waste Shipping Name and Description

a. **PETROLEUM OIL (PETROLEUM OIL)**
COMBUSTIBLE LIQUID UN1270 PGIII

12. Containers
 No. Type 13. Total Quantity 14. Unit Wt/Vol

0 0 1 T 47.50 G

D. Additional Descriptions for Materials Listed Above
T,L PETROLEUM OIL 1 %
WATER 99 %

E. Handling Codes for Wastes Listed Above
T04 FILTRATION

15. Special Handling Instructions and Additional Information
24 HR EMERGENCY RESPONSE#(908) 721-0900
DECAL #17328 ERG#128 DEXSIL TEST KIT RESULTS 10 PPM
MANIFEST USED FOR TRACKING PURPOSES ONLY

TRACKING PURPOSES ONLY

16. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.

Printed/Typed Name **EUGENE W LESINSKI** Signature *Eugene W Lesinski* Month Day Year **03 03 97**

17. Transporter 1 Acknowledgement of Receipt of Materials
 Printed/Typed Name **Aribal Vazquez** Signature *Aribal Vazquez* Month Day Year **03 03 97**

18. Transporter 2 Acknowledgement of Receipt of Materials
 Printed/Typed Name _____ Signature _____ Month Day Year _____

19. Discrepancy Indication Space

20. Facility Owner or Operator: Certification of receipt of waste materials covered by this manifest except as noted in Item 19.

Printed/Typed Name **TOM WYCKOFF** Signature *Tom Wyckoff* Month Day Year **03 03 97**

ORIGINAL - RETURN TO GENERATOR

GENERATOR

TRANSPORTER

FACILITY

APPENDIX D

UST DISPOSAL CERTIFICATE

Sovereign Bank

TeCom Vinnetl
Three Hundred Eight + 70/100

MAZZA & SONS, INC.
RECYCLING DIVISION
3230 SHAFTO RD.
TINTON FALLS, NJ 07753

DATE 2/28/97

DOLLARS \$ 308.70

1075

	AMOUNT OF CHECK
	TOTAL DEDUCTIONS
	LESS FREIGHT
	LESS % DISCOUNT
	TOTAL OF INVOICES
DATE	AMOUNT

THIS CHECK IS DELIVERED FOR PAYMENT ON THE FOLLOWING ACCOUNTS

MAZZA & SONS, INC.
 Metal Recyclers
 Auto and Truck
 3230 Shafto Rd.
 Tinton Falls, NJ
 (908) 922-9292

NO. _____
 DATE 2/28/97

Customer's Name TeCom Vinnetl
 Address _____

Make of Autos TANK

 Tires _____
 Tank _____
 Price: _____

B. 475
Gross 15,240
12,880

2360

	Weight	Price
Cast Iron		
<u>Steel</u>		<u>82.60</u>
Lt. Iron		
Copper #1		
Copper #2		
Lt. Copper		
Brass		
Alum Clean		
Lead		
Stainless		
Radiators		
Battery		
TOTAL AMOUNT:		<u>82.60</u>

PAID
 FEB 28 1997
 Check 1075

Weigher [Signature] Customer [Signature]

APPENDIX E
SOIL ANALYTICAL DATA PACKAGE

**US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461**

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
96-1262
Bldg. 475

Project # 2360
Date Rec. 02/24/97
Date Comp. 03/14/97
Released by:



Daniel K. Wright
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5-6
Results Summary	7
Initial Calibration Summary	8
Continuing Calibration Summary	9-11
Surrogate Results Summary	12
MS/MSD Results Summary	13
Quality Control Spike Summary	14
Raw Sample Data	15-36
Laboratory Deliverable Checklist	37

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.


The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report

	<u>No</u>	<u>Yes</u>
1. Method Detection Limits provided.	—	✓
2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank. _____ _____	✓	—
3. Matrix Spike Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	—	✓
4. Duplicate Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	—	✓
5. IR Spectra submitted for standards, blanks, & samples	—	NA
6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.	—	✓
7. Analysis holding time met. (If not met, list number of days exceeded for each sample) _____ _____	—	✓
Additional Comments: _____ _____ _____		

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

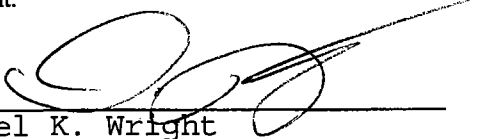

Daniel K. Wright
Laboratory Manager



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (908)532-4359 Fax (908)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Page 1 of 1

Customer: <u>GENE LESINSKI - DPU</u>		Project No:		Location: <u>B. 475</u>		Analysis Parameters				Comments: <u>DEDICATED SAMPLING TOOLS USED. SEE ATTACHED SKETCH FOR SAMPLING LOCATIONS. * = SAMPLES KEPT BELOW 4" REMARKS / PRESERVATION METHOD</u>
() DERA () OMA () Other:						TPHC	% Solids	MUNSEL	QUA	
Sampler's Signature: <u>[Signature]</u>		Sample Type								
Lab Sample I.D.	Sample Location	Date	Time							
2360.1	475-A	2/24/97	0924	SOIL	X	X	X		ND	SIDEWALL @ 5.5' *
2	475-B		0936						ND	
3	475-C		0932						ND	
4	475-D		0941						4	
5	475-E		0917						ND	
6	475-F		0920						ND	
7	475-G		1408						ND	EXC. FLOOR @ 8.5'
8	475-H		1356						1	
9	475-I		1350						2	
10	475-J		1312						ND	Piping Run @ 1.0'
11	475-DUP									FIELD DUPLICATE

NOTE: OMA CALIBRATED W/SPAN CH4 ZERO (0) AIR @ 0900 HRS ON 2/24/97 BY G. DIMARTINIUS (SERIAL # A51903)

Relinquished by (signature): <u>[Signature]</u>	Date/Time: <u>2/24/97 1516</u>	Received by (signature): <u>[Signature]</u>	Relinquished by (signature):	Date/Time:	Received by (signature):
Relinquished by (signature):	Date/Time:	Received by (signature):	Relinquished by (signature):	Date/Time:	Received by (signature):
Relinquished by (signature):	Date/Time:	Received for laboratory by (signature):	Date/Time:	Remarks:	

Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461


Client : U.S. Army Lab. ID #: 2360
 DPW. SELFM-PW-EV Date Rec'd: 24-Feb-97
 Bldg. 173 Analysis Start: 28-Feb-97
 Ft. Monmouth, NJ 07703 Analysis Complete: 14-Mar-97

Analysis: OQA-QAM-025 UST Reg. #:
 Matrix: Soil Closure #:
 Analyst: P. Skelton DICAR #:
 Ext. Meth: Shake Location #: B.475

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
2360.01	475-A	1.00	15.30	89.21	172	ND
2360.02	475-B	1.00	15.15	83.05	187	ND
2360.03	475-C	1.00	15.74	86.92	172	ND
2360.04	475-D	1.00	15.41	88.39	173	1985.93
2360.05	475-E	1.00	15.52	88.42	171	ND
2360.06	475-F	1.00	15.53	86.86	174	ND
2360.07	475-G	1.00	15.19	79.96	193	ND
2360.08	475-H	1.00	15.77	77.33	193	ND
2360.09	475-I	1.00	15.06	79.11	197	ND
2360.10	475-J	1.00	15.37	81.24	188	ND
2360.11	475-DUP	1.00	15.20	81.68	189	ND
METHOD BLANK	28-Feb-97	1.00	15.00	100.00	157	ND

ND = Not Detected

MDL = Method Detection Limit


 Daniel K. Wright
 Laboratory Director

7

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted ✓
- 2. Table of Contents submitted ✓
- 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted ✓
- 4. Document paginated and legible ✓
- 5. Chain of Custody submitted ✓
- 6. Samples submitted to lab within 48 hours of sample collection ✓
- 7. Methodology Summary submitted ✓
- 8. Laboratory Chronicle and Holding Time Check submitted ✓
- 9. Results submitted on a dry weight basis ✓
- 10. Method Detection Limits submitted ✓
- 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP ✓

Laboratory Manager or Environmental Consultant's Signature



Date 12/6/97

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
96-1262
Bldg.475

Project # 2393
Date Rec. 03/17/97
Date Comp. 03/19/97
Released by:



Daniel K. Wright
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5
Results Summary	6
Initial Calibration Summary	7
Continuing Calibration Summary	8
Surrogate Results Summary	9
MS/MSD Results Summary	10
Quality Control Spike Summary	11
Raw Sample Data	12-17
Laboratory Deliverable Checklist	18

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.

The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report

	<u>No</u>	<u>Yes</u>
1. Method Detection Limits provided.	—	— ✓
2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank. _____ _____	— ✓	—
3. Matrix Spike Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	—	— ✓
4. Duplicate Results Summary Meet Criteria. _____ (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	—	— ✓
5. IR Spectra submitted for standards, blanks, & samples	—	NA —
6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.	—	— ✓
7. Analysis holding time met. (If not met, list number of days exceeded for each sample) _____ _____	—	— ✓
Additional Comments: _____ _____ _____		

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



Daniel K. Wright
Laboratory Manager



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (908)532-4359 Fax (908)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Page 1 of 1

Customer: <u>GENE LESINSKI - DPW</u>		Project No:		Location: <u>B. 475</u>		Analysis Parameters				Comments: <u>DEDICATED SAMPLING TOOLS USED. SEE ATTACHED SKETCH FOR SAMPLING LOCATIONS.</u> <u>* = SAMPLES KEPT BELOW 4°C.</u> Remarks / Preservation Method	
() DERA () OMA () Other:		Sampler's Signature: <u>[Signature]</u>		Sample Type		TPHC	% Solids	Munsell			OUA
Lab Sample I.D.	Sample Location	Date	Time								
<u>2393</u>	<u>475-A</u>	<u>3/17/97</u>	<u>1337</u>	<u>SOIL</u>	X	X	X			<u>ND</u>	<u>SIDEWALL @ 5.5'</u> *
↓	<u>475-B</u>	↓	<u>1410</u>	↓	↓	↓	↓			<u>ND</u>	<u>EX. FLOOR @ 8.5'</u> *
↓	<u>475-DUP</u>	↓	<u>—</u>	↓	↓	↓	↓			<u>—</u>	<u>FIELD DUPLICATE</u> *
NOTE: <u>OUA CALIBRATED IN 5 PPM CH4 ZERO (0) AIR @ 1320 HRS ON 3/17/97 BY G. DiMARTINIS. (SERIAL # A52114)</u>											
Relinquished by (signature): <u>[Signature]</u>		Date/Time: <u>3/18/97 1015</u>		Received by (signature): <u>[Signature]</u>		Relinquished by (signature):				Date/Time:	Received by (signature):
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):				Date/Time:	Received by (signature):
Relinquished by (signature):		Date/Time:		Received for laboratory by (signature):		Date/Time:		Remarks:			

print legibly

CUSTODY.ALS11/16/97


Report of Analysis
 U.S. Army, Fort Monmouth Environmental Laboratory
 NJDEP Certification # 13461

Client :	U.S. Army	Lab. ID # :	2393
	DPW. SELFM-PW-EV	Date Rec'd:	17-Mar-97
	Bldg. 173	Analysis Start:	19-Mar-97
	Ft. Monmouth, NJ 07703	Analysis Complete:	19-Mar-97

Analysis:	OQA-QAM-025	UST Reg. #:	
Matrix:	Soil	Closure #:	
Analyst:	P. Skelton	DICAR #:	
Ext. Meth:	Shake	Location #:	B475

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
2393.01	475-A	1.00	14.98	89.32	176	155.34
2393.02	475-B	1.00	15.20	85.69	180	401.00
2393.03	475-DUP	1.00	15.33	89.41	171	148.14
METHOD BLANK	19-Mar-97	1.00	15.00	100.00	157	ND

ND = Not Detected
 MDL = Method Detection Limit


 Daniel K. Wright
 Laboratory Director

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
- 2. Table of Contents submitted
- 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
- 4. Document paginated and legible
- 5. Chain of Custody submitted
- 6. Samples submitted to lab within 48 hours of sample collection
- 7. Methodology Summary submitted
- 8. Laboratory Chronicle and Holding Time Check submitted
- 9. Results submitted on a dry weight basis
- 10. Method Detection Limits submitted
- 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

Laboratory Manager or Environmental Consultant's Signature _____
Date 1/29/95

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance

APPENDIX F

GROUNDWATER ANALYTICAL DATA PACKAGE

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT
Fort Monmouth Environmental Laboratory
ENVIRONMENTAL DIVISION
Fort Monmouth, New Jersey
PROJECT: UST Program

Bldg. 475

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
475-1 6-10'	4927.01	Aqueous	06-Nov-99 10:00	11/08/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS


 4-7-00
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-15
Tune Results Summary	16-17
Method Blank Results Summary	18
Calibration Summary	19
Surrogate Recovery Summary	20
MS/MSD Results Summary	21-22
Internal Standard Area & RT Summary	23
Chromatograms	24-27
Base Neutrals	28
Analytical Results Summary	29-34
Tune Results Summary	35-38
Method Blank Results Summary	39
Calibration Summary	40-43
Surrogate Recovery Summary	44
MS/MSD Results Summary	45-48
Internal Standard Area & RT Summary	49-52
Chromatograms	53-56
Laboratory Deliverables Checklist	57
Laboratory Authentication Statement	58

CHAIN OF CUSTODY

000001



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:appleby@mail1.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: <u>D. DESAI</u>				Project No: <u>FORMER</u>			Analysis Parameters						Comments:	
Phone #: <u>21475</u>				Location: <u>BLOG. 475</u>			VOA + 15	B N + 15	X M E N T Y					
() DERA (<input checked="" type="checkbox"/>) OMA () Other: _____				Samplers Name / Company: <u>MARK LAURA - TVS - PWS 07</u>		Sample #								
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles								Remarks / Preservation Method	
<u>*1927.1</u>	<u>475-1</u>	<u>6-10'</u>	<u>11-6-99</u>	<u>1000</u>	<u>AQ</u>	<u>3</u>	<u>X</u>	<u>X</u>	<u>X</u>				<u>HCL/24cc</u>	
Relinquished by (signature): <u>[Signature]</u>		Date/Time: <u>11-8-99 730</u>		Received by (signature): <u>[Signature]</u>			Relinquished by (signature):		Date/Time:		Received by (signature):			
Relinquished by (signature):		Date/Time:		Received by (signature):			Relinquished by (signature):		Date/Time:		Received by (signature):			
Report Type: <input type="checkbox"/> Full, <input checked="" type="checkbox"/> Reduced, <input type="checkbox"/> Standard, <input type="checkbox"/> Screen / non-certified						Remarks: <u>SHARED T.B.+F.B. w/ BLDG. 277 SAME DAY</u>								
Turnaround time: <input checked="" type="checkbox"/> Standard 3 wks, <input type="checkbox"/> Rush _____ Days, <input type="checkbox"/> ASAP Verbal _____ Hrs.														

000002

METHOD SUMMARY

000003

Method Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

000004

CONFORMANCE/NON- CONFORMANCE SUMMARY

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) Yes
2. Retention times for chromatograms provided Yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria Yes
 - b. DFTPP Meet Criteria Yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series Yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series Yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria Yes
 - b. System Performance Check Compounds Meet Criteria Yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: NO
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____
8. Surrogate Recoveries Meet Criteria Yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____

If not met, were the calculations checked and the results qualified as "estimated"?

9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria
(If not met, list those compounds and their recoveries, which fall outside the acceptable range) Yes
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____

000006

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

Yes

- a. VOA Fraction _____
- b. B/N Fraction _____
- c. Acid Fraction _____

11. Extraction Holding Time Met

Yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

Yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager: _____



Date: 4-7-00

LABORATORY CHRONICLE

000008

Laboratory Chronicle

Lab ID: 4927

Site: Bldg. 475

	Date	Hold Time
Date Sampled	11/06/99	NA
Receipt/Refrigeration	11/06/99	NA
Extractions		
1. Base Neutral	11/12/99	14 days
Analyses		
1. Volatile Organics	11/10,11/99	14 days
2. Base Neutral	11/13/99	40 Day

*Samples collected and refrigerated on 11/06/99, Laboratory received the samples Monday 11/08/99.

000009

VOLATILE ORGANICS

000010

**US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461**

Definition of Qualifiers

- MDL** : Method Detection Limit
- J** : Compound identified below detection limit
- B** : Compound in both sample and blank
- D** : Results from dilution of sample
- U** : Compound searched for but not detected
- E** : Compound exceeds calibration limit

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001257.D**
 Operator **Skelton**
 Date Acquired **10 Nov 1999 2:43 pm**

Sample Name **Vblk37**
 Field ID **Vblk37**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
105-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Vblk37

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 4927 Location: 475 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Vblk37
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001257.D
Level: (low/med) LOW Date Received: 11/8/99
% Moisture: not dec. _____ Date Analyzed: 11/10/99
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001284.D**
 Operator **Skelton**
 Date Acquired **11 Nov 1999 9:03 am**

Sample Name **4927.01**
 Field ID **475-1**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m-p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6.2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

475-1

Lab Name: FMETL NJDEP#: 13461
 Project: 100004 Case No.: 4927 Location: 475 SDG No.: _____
 Matrix: (soil/water) WATER Lab Sample ID: 4927.01
 Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001284.D
 Level: (low/med) LOW Date Received: 11/8/99
 % Moisture: not dec. _____ Date Analyzed: 11/11/99
 GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
 Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 10

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
1. 000488-23-3	Benzene, 1,2,3,4-tetramethyl-	24.08	7	JN
2.	unknown	28.17	4	J
3. 001559-81-5	Naphthalene, 1,2,3,4-tetrahydro-1	28.65	5	JN
4. 003877-19-8	Naphthalene, 1,2,3,4-tetrahydro-2	31.49	10	JN
5.	unknown	32.29	11	J
6.	unknown	32.52	7	J
7.	unknown	33.12	12	J
8.	unknown	34.01	8	J
9.	unknown	34.36	3	J
10.	unknown	34.48	5	J

BASE NEUTRALS

000028

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name BNA03372.D
 Operator Bhaskar
 Date Acquired 13-Nov-99

Sample Name Sblk320
 Misc Info Sblk320 A 991112
 Sample Multiplier 1

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report Page 2

Data File Name **BNA03372.D**
 Operator **Bhaskar**
 Date Acquired **13-Nov-99**

Sample Name **Sblk320**
 Misc Info **Sblk320 A 991112**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Sblk320

Lab Name: FMETL Lab Code 13461
Project UST Case No.: 4927 Location 475 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Sblk320
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03372.D
Level: (low/med) LOW Date Received: 11/8/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 11/12/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/13/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 1 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	7.23	19	J

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BNA03374.D**
 Operator **Bhaskar**
 Date Acquired **13-Nov-99**

Sample Name **4927.01**
 Misc Info **475-1**
 Sample Multiplier. **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report Page 2

Data File Name **BNA03374.D**
 Operator **Bhaskar**
 Date Acquired **13-Nov-99**

Sample Name **4927.01**
 Misc Info **475-1**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

475-1

Lab Name: FMETL Lab Code 13461
 Project UST Case No.: 4927 Location 475 SDG No.: _____
 Matrix: (soil/water) WATER Lab Sample ID: 4927.01
 Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03374.D
 Level: (low/med) LOW Date Received: 11/8/99
 % Moisture: _____ decanted: (Y/N) N Date Extracted: 11/12/99
 Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/13/99
 Injection Volume: 1.0 (uL) Dilution Factor: 1.0
 GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 1 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	7.24	7	J

SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)

Lab Name: FMETL Lab Code 13461
 Project UST Case No.: 4927 Location 475 SDG No.: _____
 Lab File ID: BNA03321.D DFTPP Injection Date: 10/27/99
 Instrument ID: BNA#2 DFTPP Injection Time: 9:32

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	60.0
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	56.4
70	Less than 2.0% of mass 69	0.3 (0.6)1
127	25.0 - 75.0% of mass 198	53.8
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	7.1
275	10.0 - 30.0% of mass 198	19.9
365	Greater than 0.75% of mass 198	2.0
441	Present, but less than mass 443	8.7
442	40.0 - 110.0% of mass 198	59.1
443	15.0 - 24.0% of mass 442	12.0 (20.4)2

1-Value is % mass 69



2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BNA03323.D	10/27/99	10:55
02	SSTD080	80 PPM CAL	BNA03324.D	10/27/99	11:50
03	SSTD050	50 PPM CAL	BNA03325.D	10/27/99	12:40
04	SSTD010	10 PPM CAL	BNA03326.D	10/27/99	13:31
05	SSTD020	20 PPM CAL	BNA03327.D	10/27/99	14:20
06	4871.04DUP	4871.04DUP	BNA03332.D	10/27/99	18:28
07	4871.04MS	4871.04MS	BNA03333.D	10/27/99	19:17

Data File : C:\HPCHEM\1\DATA\991027\BNA03321.D
 Acq On : 27 Oct 1999 9:32 am
 Sample : DFTPP TUNE
 Misc : 50NG/2UL
 MS Integration Params: RTEINT.P
 Method : C:\HPCHEM\1\METHODS\M262534.M (RTE Integrator)
 Title : BNA Calibration

Vial: 99
 Operator: Bhaskar
 Inst : GC BNA 2
 Multiplr: 1.00

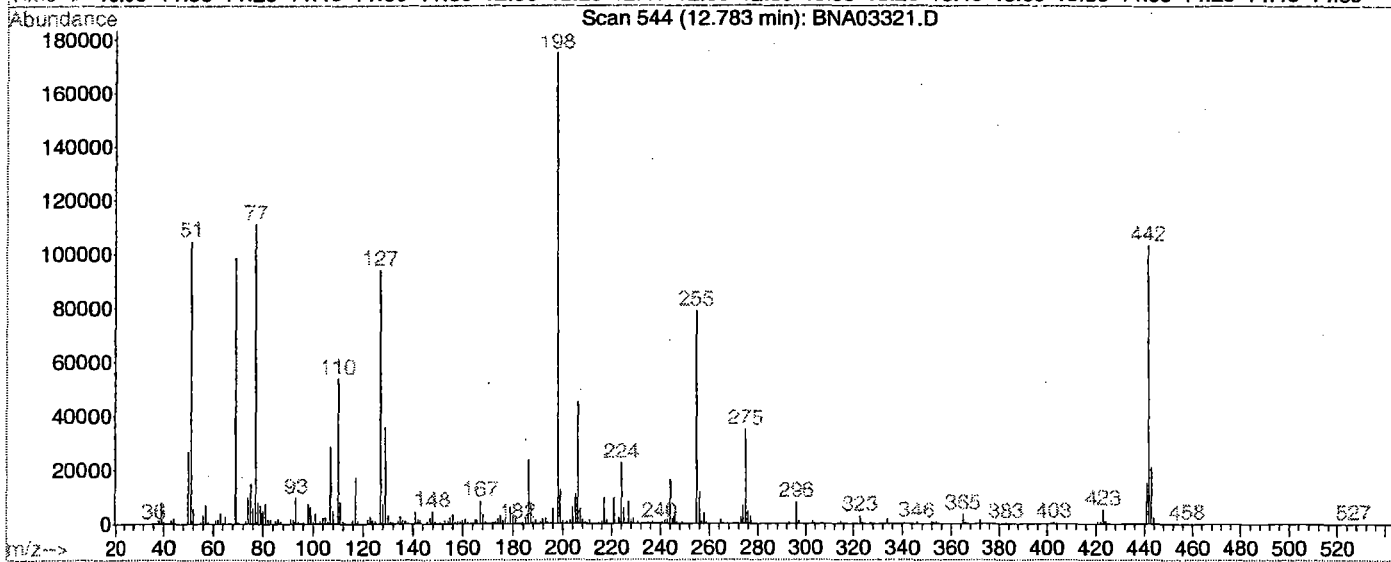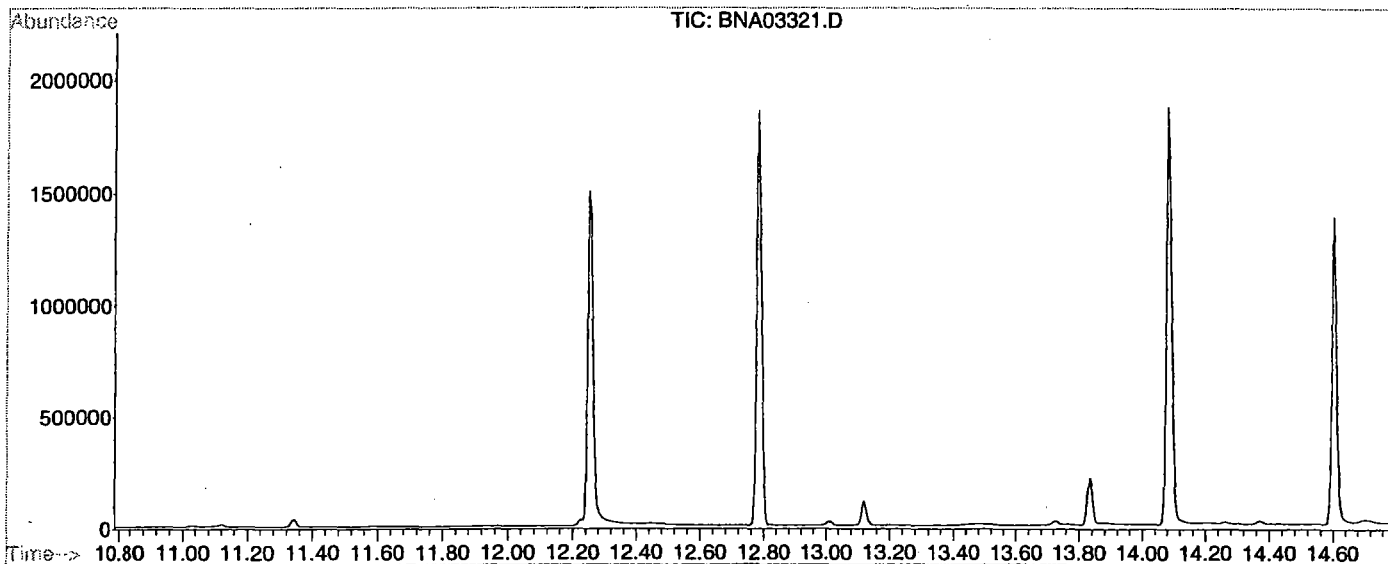

Spectrum Information: Scan 544

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	60.0	104832	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	56.4	98600	PASS
70	69	0.00	2	0.6	593	PASS
127	198	40	60	53.8	94000	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	174720	PASS
199	198	5	9	7.1	12479	PASS
275	198	10	30	19.9	34848	PASS
365	198	1	100	2.0	3527	PASS
441	443	1	99	72.0	15134	PASS
442	198	40	100	59.1	103184	PASS
443	442	17	23	20.4	21008	PASS

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS


The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

Laboratory Manager or Environmental Consultant's Signature

Date 4/7/00

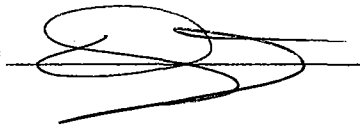

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance.

000057

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



Daniel K. Wright
Laboratory Manager

000058

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT
Fort Monmouth Environmental Laboratory
ENVIRONMENTAL DIVISION
Fort Monmouth, New Jersey
PROJECT: UST Program

Bldg. 475

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
Trip Blank	5010.01	Aqueous	11-Dec-99	12/13/99
Field Blank	5010.02	Aqueous	11-Dec-99 08:30	12/13/99
Bldg. 475	5010.03	Aqueous	11-Dec-99 08:55	12/13/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS

 5-4-00
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-21
Tune Results Summary	22-23
Method Blank Results Summary	24
Calibration Summary	25
Surrogate Recovery Summary	26
MS/MSD Results Summary	27-28
Internal Standard Area & RT Summary	39
Chromatograms	29-38
Base Neutrals	40
Analytical Results Summary	41-52
Tune Results Summary	53-56
Method Blank Results Summary	57
Calibration Summary	58-61
Surrogate Recovery Summary	62
MS/MSD Results Summary	63-66
Internal Standard Area & RT Summary	67-70
Chromatograms	71-78
Laboratory Deliverables Checklist	79
Laboratory Authentication Statement	80

CHAIN OF CUSTODY

000001



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:appleby@mail1.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: D. Deasi		Project No:			Analysis Parameters							Comments: HCL / 4°C	
Phone #: X21477		Location: Bldg 475 VST 2nd Rnd			VOLIS	Xylene	BNHIS						
() DERA () OMA () Other:		Samplers Name / Company: Corey McCormack, TUS				Sample #							
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles								Remarks / Preservation Method
50110 .01	Trip	12/11/99	0715	AQ	2	✓	✓						
.02	Field Blank		0830		3	✓	✓	✓					
.03	Bldg 475		0855		3	✓	✓	✓					
.04	Dupe		—		3	✓	✓	✓					
Relinquished by (signature): Corey McCormack		Date/Time: 12/13/99 730	Received by (signature): J. Appleby		Relinquished by (signature):	Date/Time:	Received by (signature):						
Relinquished by (signature):		Date/Time:	Received by (signature):		Relinquished by (signature):	Date/Time:	Received by (signature):						
Report Type: () Full, (x) Reduced, () Standard, () Screen / non-certified					Remarks:								
Turnaround time: (x) Standard 3 wks, () Rush Days, () ASAP Verbal Hrs.													

00002

METHODOLOGY SUMMARY

000003

Method Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

000004

CONFORMANCE NON-CONFORMANC SUMMARY

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: no
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA _____
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA _____

If not met, were the calculations checked and the results qualified as “estimated”? _____
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA _____

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction _____
- b. B/N Fraction _____
- c. Acid Fraction N/A _____

11. Extraction Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager:  Date: 5-4-00

LABORATORY CHRONICLE

000008

Laboratory Chronicle

Lab ID: 5010

Site: Bldg. 475

	Date	Hold Time
Date Sampled	12/11/99	NA
Receipt/Refrigeration	12/11/99	NA
Extractions		
1. Base Neutral	12/13/99	14 days
Analyses		
1. Volatile Organics	12/10,11/99	14 days
2. Base Neutral	12/14,15/99	40 days

* Samples collected and refrigerated 12/11/99, Laboratory received the samples on Monday 12/13/99.

000009

VOLATILE ORGANICS

000010

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

- MDL : Method Detection Limit
- J : Compound identified below detection limit
- B : Compound in both sample and blank
- D : Results from dilution of sample
- U : Compound searched for but not detected
- E : Compound exceeds calibration limit

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001507.D**
 Operator **Skelton**
 Date Acquired **10 Dec 1999 8:05 pm**

Sample Name **Vblk40**
 Field ID **Vblk40**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,1,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Vblk40

Lab Name: FMETL NJDEP#: 13461

Project: 100004 Case No.: 5010 Location: Bldg47 SDG No.: _____

Matrix: (soil/water) WATER Lab Sample ID: Vblk40

Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001507.D

Level: (low/med) LOW Date Received: 12/13/99

% Moisture: not dec. _____ Date Analyzed: 12/10/99

GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0

Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001529.D**
 Operator **Skelton**
 Date Acquired **11 Dec 1999 10:55 am**

Sample Name **5010.01s**
 Field ID **Trip Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Trip Blank

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 5010 Location: Bldg47 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 5010.01s
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001529.D
Level: (low/med) LOW Date Received: 12/13/99
% Moisture: not dec. _____ Date Analyzed: 12/11/99
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001530.D**
 Operator **Skelton**
 Date Acquired **11 Dec 1999 11:36 am**

Sample Name **5010.02s**
 Field ID **Field Blank**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Field Blank

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 5010 Location: Bldg47 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 5010.02s
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001530.D
Level: (low/med) LOW Date Received: 12/13/99
% Moisture: not dec. _____ Date Analyzed: 12/11/99
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001531.D**
 Operator **Skelton**
 Date Acquired **11 Dec 1999 12:16 pm**

Sample Name **5010.03s**
 Field ID **Bldg 475**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone	15.24	53453	5.64 ug/L	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Bldg475

Lab Name: FMETL NJDEP#: 13461

Project: 100004 Case No.: 5010 Location: Bldg47 SDG No.: _____

Matrix: (soil/water) WATER Lab Sample ID: 5010.03s

Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001531.D

Level: (low/med) LOW Date Received: 12/13/99

% Moisture: not dec. _____ Date Analyzed: 12/11/99

GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0

Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001532.D**
 Operator **Skelton**
 Date Acquired **11 Dec 1999 12:57 pm**

Sample Name **5010.04s**
 Field ID **Dupe**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone	15.24	51437	5.32 ug/L	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-79-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Dupe

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 5010 Location: Bldg47 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 5010.04s
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001532.D
Level: (low/med) LOW Date Received: 12/13/99
% Moisture: not dec. _____ Date Analyzed: 12/11/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

BASE NEUTRAL

000040

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BNA03456.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **Sblk327**
 Misc Info **Sblk327 A 991213**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report Page 2

Data File Name **BNA03456.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **Sblk327**
 Misc Info **Sblk327 A 991213**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000042

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Sblk327

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5010 Location Bld.475 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Sblk327
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03456.D
Level: (low/med) LOW Date Received: 12/13/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 12/13/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/14/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 2 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1.	unknown	7.18	5	J
2.	unknown	10.16	51	J

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BNA03465.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **5010.02**
 Misc Info **Field Blank**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03465.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **5010.02**
 Misc Info **Field Blank**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Field Blank

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5010 Location Bld.475 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 5010.02
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03465.D
Level: (low/med) LOW Date Received: 12/13/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 12/13/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/14/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BNA03466.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **5010.03**
 Misc Info **Bldg.475**
 Sample Multiplier **1.11**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	2.03 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	1.01 ug/L	
62-53-3	Aniline			not detected	NLE	1.81 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.42 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.34 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.32 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.13 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.25 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.54 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.89 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.67 ug/L	
98-95-3	Nitrobenzene			not detected	10	1.08 ug/L	
78-59-1	Isophorone			not detected	100	1.12 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.34 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.35 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.41 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.21 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.79 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.20 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.47 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.12 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.07 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.69 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	1.07 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.90 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.88 ug/L	
83-32-9	Acenaphthene			not detected	400	1.22 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.11 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.97 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.80 ug/L	
86-73-7	Fluorene			not detected	300	1.10 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.22 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.17 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.12 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.74 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.84 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.04 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.37 ug/L	
120-12-7	Anthracene			not detected	2000	1.24 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.89 ug/L	
206-44-0	Fluoranthene			not detected	300	1.82 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03466.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **5010.03**
 Misc Info **Bldg.475**
 Sample Multiplier **1.11**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.64 ug/L	
129-00-0	Pyrene			not detected	200	1.39 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.17 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.32 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.94 ug/L	
218-01-9	Chrysene			not detected	20	1.53 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.93 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.60 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.39 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.43 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.17 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.92 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.71 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.93 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000048

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Bldg.475

Lab Name: FMETL Lab Code 13461
 Project 100004 Case No.: 5010 Location Bld.475 SDG No.: _____
 Matrix: (soil/water) WATER Lab Sample ID: 5010.03
 Sample wt/vol: 900 (g/ml) ML Lab File ID: BNA03466.D
 Level: (low/med) LOW Date Received: 12/13/99
 % Moisture: _____ decanted: (Y/N) N Date Extracted: 12/13/99
 Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/14/99
 Injection Volume: 1.0 (uL) Dilution Factor: 1.0
 GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BNA03467.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **5010.04**
 Misc Info **Dupe**
 Sample Multiplier **1.18**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	2.16 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	1.07 ug/L	
62-53-3	Aniline			not detected	NLE	1.92 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.51 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.43 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.40 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.20 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.33 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.64 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.94 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.77 ug/L	
98-95-3	Nitrobenzene			not detected	10	1.14 ug/L	
78-59-1	Isophorone			not detected	100	1.19 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.43 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.44 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.50 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.29 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.84 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.27 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.56 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.19 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	1.13 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.79 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	1.13 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.96 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.93 ug/L	
83-32-9	Acenaphthene			not detected	400	1.30 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.18 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.03 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.91 ug/L	
86-73-7	Fluorene			not detected	300	1.17 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.30 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.24 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.19 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.79 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.90 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.11 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.45 ug/L	
120-12-7	Anthracene			not detected	2000	1.32 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	2.01 ug/L	
206-44-0	Fluoranthene			not detected	300	1.94 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03467.D**
 Operator **Bhaskar**
 Date Acquired **14-Dec-99**

Sample Name **5010.04**
 Misc Info **Dupe**
 Sample Multiplier **1.18**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.93 ug/L	
129-00-0	Pyrene			not detected	200	1.48 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.24 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.40 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.07 ug/L	
218-01-9	Chrysene			not detected	20	1.63 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	2.05 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.70 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.48 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.52 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.24 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.98 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.76 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.99 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Field Dupe

Lab Name: FMETL Lab Code 13461
 Project 100004 Case No.: 5010 Location Bld.475 SDG No.: _____
 Matrix: (soil/water) WATER Lab Sample ID: 5004.04
 Sample wt/vol: 850 (g/ml) ML Lab File ID: BNA03468.D
 Level: (low/med) LOW Date Received: 12/13/99
 % Moisture: _____ decanted: (Y/N) N Date Extracted: 12/13/99
 Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/15/99
 Injection Volume: 1.0 (uL) Dilution Factor: 1.0
 GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 15 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
1. 017301-23-4	Undecane, 2,6-dimethyl-	13.76	28	JN
2.	unknown	14.23	21	J
3.	unknown	14.62	37	J
4. 074645-98-0	Dodecane, 2,7,10-trimethyl-	16.18	48	JN
5. 000000-00-0	Decahydro-4,4,8,9,10-pentameth	16.39	21	JN
6. 000581-42-0	Naphthalene, 2,6-dimethyl-	16.86	35	JN
7. 000581-40-8	Naphthalene, 2,3-dimethyl-	17.07	41	JN
8. 000575-43-9	Naphthalene, 1,6-dimethyl-	17.13	40	JN
9. 003891-98-3	Dodecane, 2,6,10-trimethyl-	17.31	74	JN
10. 002245-38-7	Naphthalene, 1,6,7-trimethyl-	18.68	22	JN
11.	unknown	19.45	65	J
12. 001921-70-6	Pentadecane, 2,6,10,14-tetramet	20.03	150	JN
13. 001430-97-3	9H-Fluorene, 2-methyl-	20.40	28	JN
14. 031295-56-4	Dodecane, 2,6,11-trimethyl-	21.02	76	JN
15. 000629-97-0	Docosane	21.76	21	JN

SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)

Lab Name: FMETL Lab Code 13461
 Project 100004 Case No.: 5010 Location Bld.475 SDG No.: _____
 Lab File ID: BNA03321.D DFTPP Injection Date: 10/27/99
 Instrument ID: BNA#2 DFTPP Injection Time: 9:32

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	60.0
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	56.4
70	Less than 2.0% of mass 69	0.3 (0.6)1
127	25.0 - 75.0% of mass 198	53.8
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	7.1
275	10.0 - 30.0% of mass 198	19.9
365	Greater than 0.75% of mass 198	2.0
441	Present, but less than mass 443	8.7
442	40.0 - 110.0% of mass 198	59.1
443	15.0 - 24.0% of mass 442	12.0 (20.4)2

1-Value is % mass 69



2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BNA03323.D	10/27/99	10:55
02	SSTD080	80 PPM CAL	BNA03324.D	10/27/99	11:50
03	SSTD050	50 PPM CAL	BNA03325.D	10/27/99	12:40
04	SSTD010	10 PPM CAL	BNA03326.D	10/27/99	13:31
05	SSTD020	20 PPM CAL	BNA03327.D	10/27/99	14:20
06	4871.04DUP	4871.04DUP	BNA03332.D	10/27/99	18:28
07	4871.04MS	4871.04MS	BNA03333.D	10/27/99	19:17

Data File : C:\HPCHEM\1\DATA\991027\BNA03321.D
 Acq On : 27 Oct 1999 9:32 am
 Sample : DFTPP TUNE
 Misc : 50NG/2UL
 MS Integration Params: RTEINT.P
 Method : C:\HPCHEM\1\METHODS\M262534.M (RTE Integrator)
 Title : BNA Calibration

Vial: 99
 Operator: Bhaskar
 Inst : GC BNA 2
 Multiplr: 1.00

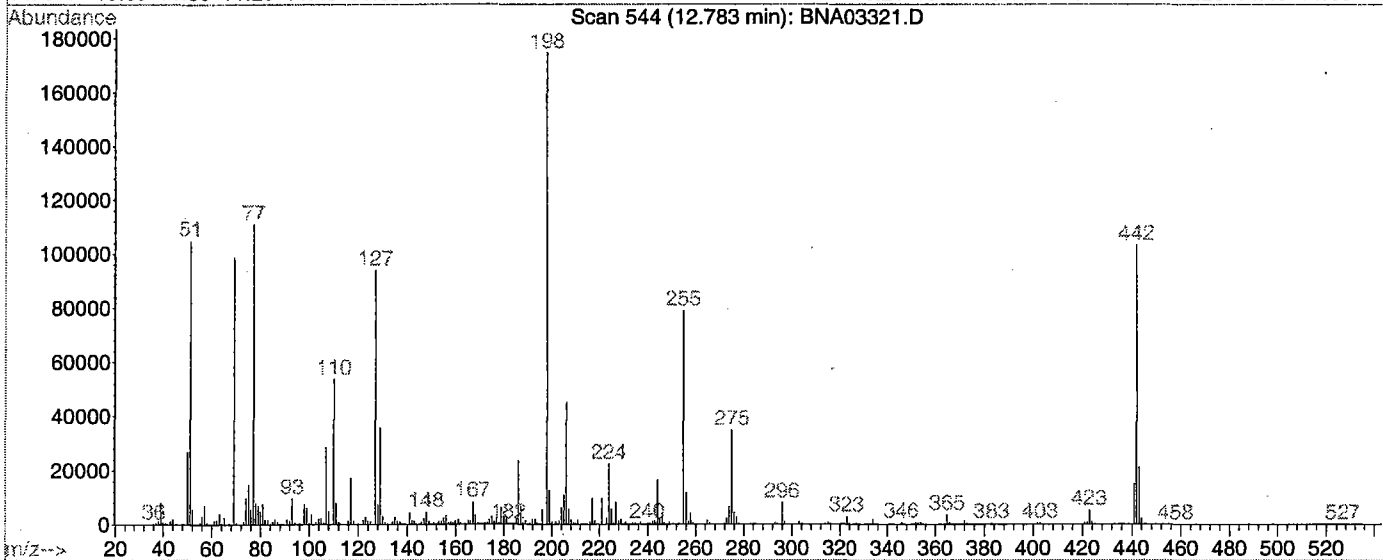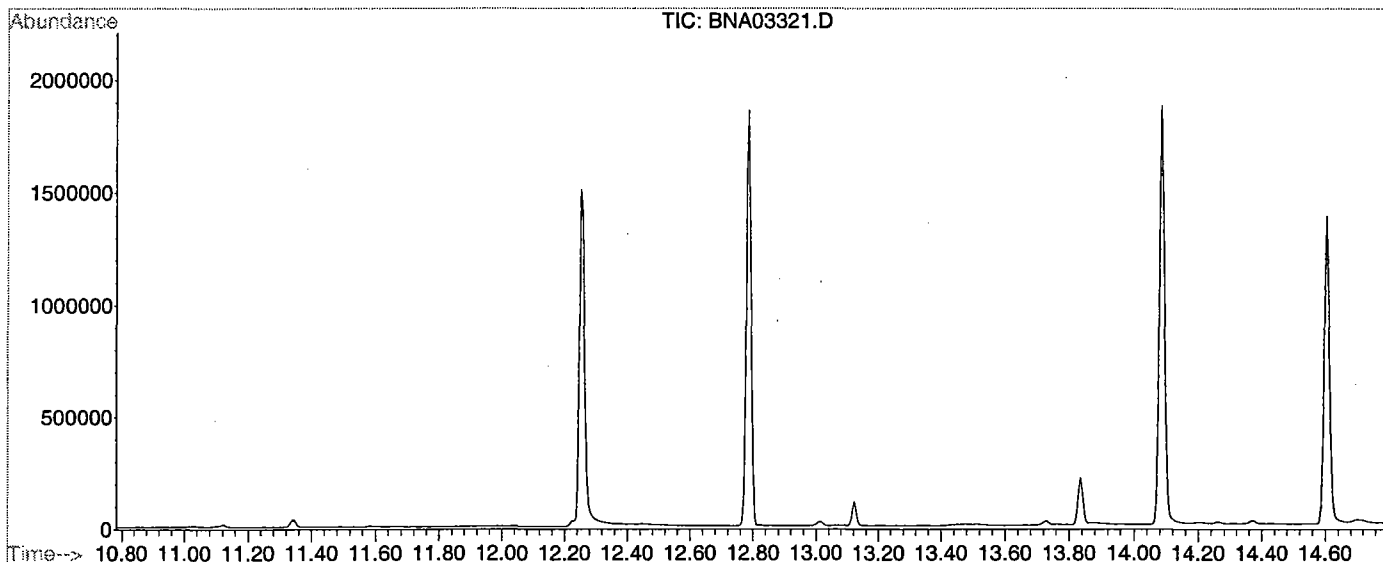

Spectrum Information: Scan 544.

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	60.0	104832	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	56.4	98600	PASS
70	69	0.00	2	0.6	593	PASS
127	198	40	60	53.8	94000	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	174720	PASS
199	198	5	9	7.1	12479	PASS
275	198	10	30	19.9	34848	PASS
365	198	1	100	2.0	3527	PASS
441	443	1	99	72.0	15134	PASS
442	198	40	100	59.1	103184	PASS
443	442	17	23	20.4	21008	PASS


LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
- 2. Table of Contents submitted
- 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
- 4. Document paginated and legible
- 5. Chain of Custody submitted
- 6. Samples submitted to lab within 48 hours of sample collection
- 7. Methodology Summary submitted
- 8. Laboratory Chronicle and Holding Time Check submitted
- 9. Results submitted on a dry weight basis NA
- 10. Method Detection Limits submitted
- 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP


Laboratory Manager or Environmental Consultant's Signature 
Date 5/4/00

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance.

Laboratory Authentication Statement


I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.




Daniel K. Wright
Laboratory Manager

000080

APPENDIX G
PHOTOGRAPHS

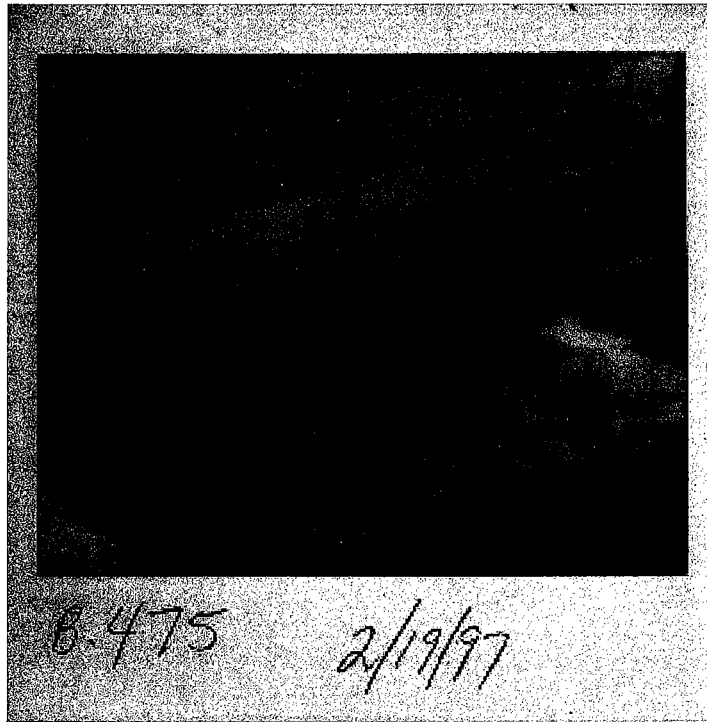

B-475 2/19/97

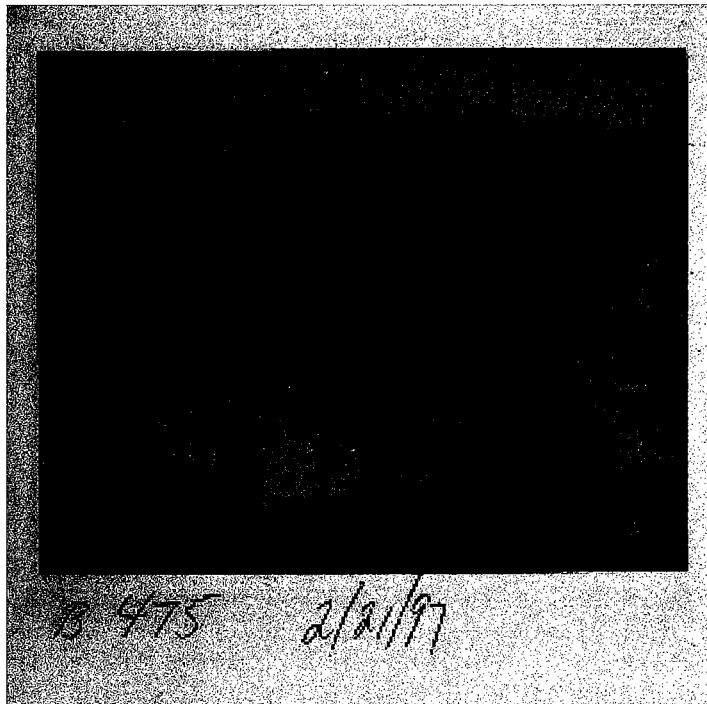

B-475 2/21/97

FEBRUARY 19, 1997


PHOTOGRAPHIC LOG

UST NO. 90010-52

**Building 475
Main Post-East
Fort Monmouth**


VERSAR
Engineers, Managers, Scientists & Planners
Bristol, PA

APPENDIX H
ELECTRONIC DATA DELIVERABLES

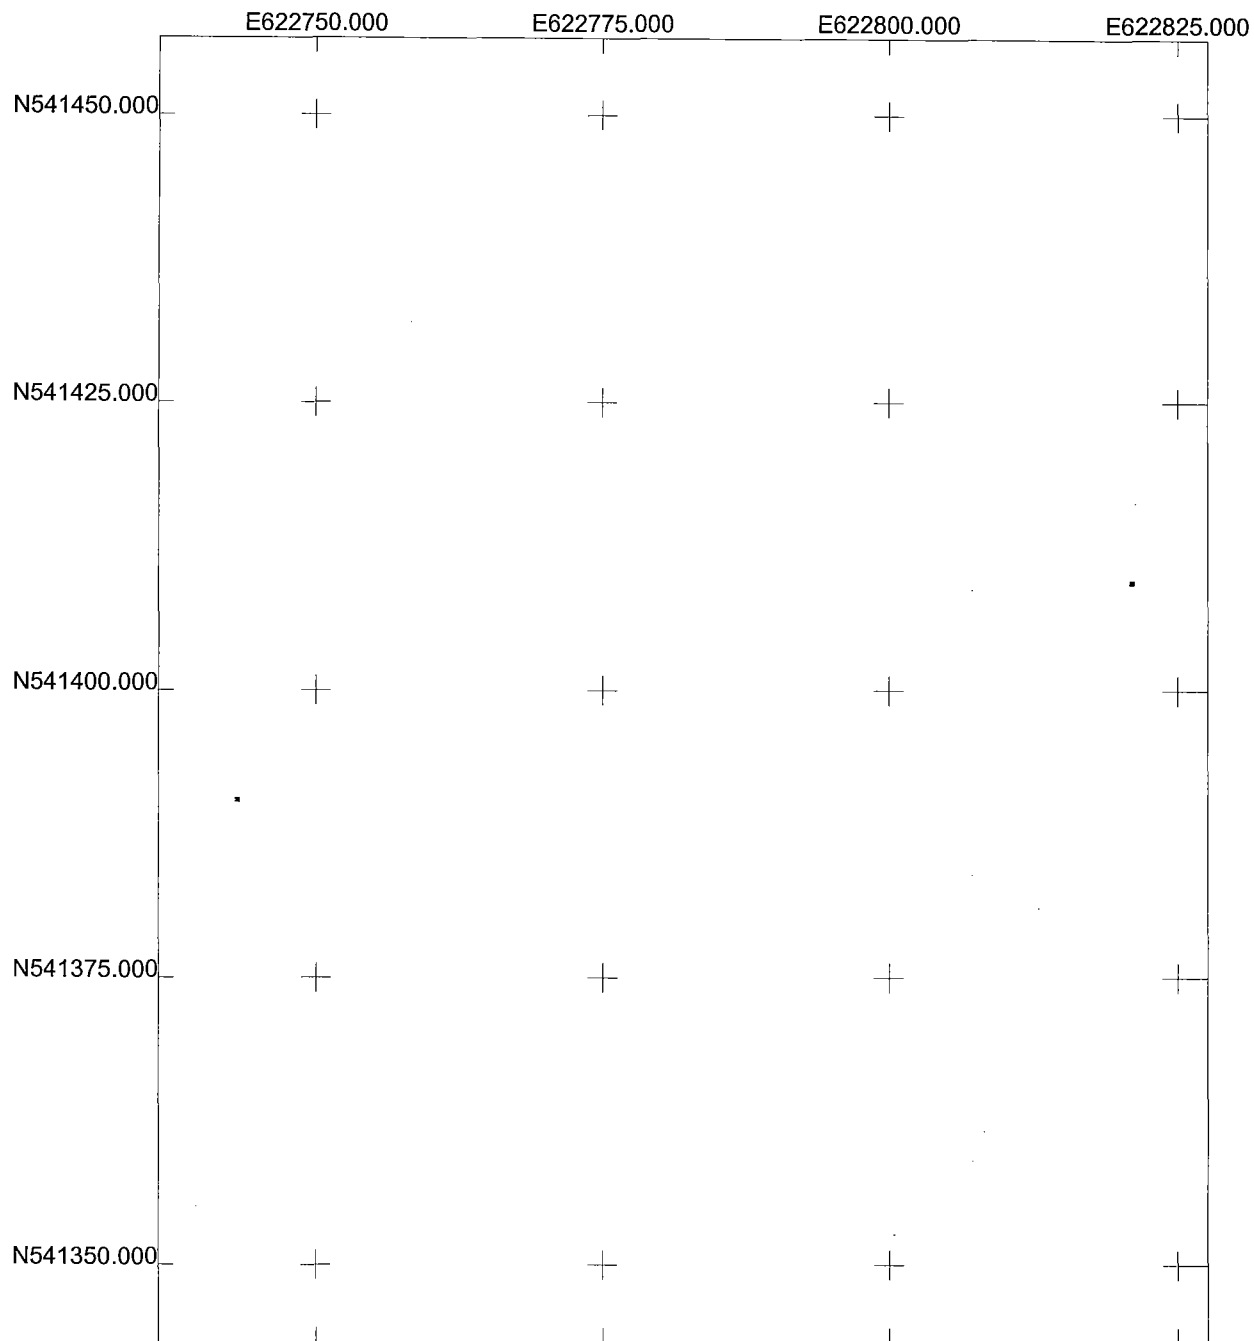

Bldg. 475 UST Ground Water Sample GPS Map

US State Plane 1983
New Jersey (NY East) 2900
NAD 1983 (Conus)

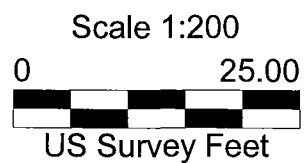

r070714b.cor
7/10/2000
Pathfinder Office
 **Trimble**

BLDG. 475 UST GROUND WATER SAMPLE GPS POSIION & COORDINATES

US STATE PLANE 1983 NJ (NY EAST) 2900 NAD 1983 (CONUS)

(IN US SURVEY FEET)

SAMPLE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
475 GW (GW denotes <u>G</u> round <u>W</u> ater)	541409.509	622820.994

REFERENCE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
HAZ WSTE BLCK MAIL BOX	541390.553	622743.081