

COPY

United States Army
Fort Monmouth, New Jersey

**Underground Storage Tank
Closure and Site Investigation
Report**

***Building 907
Main Post-West Area***

NJDEP UST Registration No. 0081533-231

SEPTEMBER 1998

**UNDERGROUND STORAGE TANK
CLOSURE AND SITE INVESTIGATION REPORT**

BUILDING 907

**MAIN POST-WEST AREA
NJDEP UST REGISTRATION NO. 0081533-231**

SEPTEMBER 1998

PREPARED FOR:

**UNITED STATES ARMY, FORT MONMOUTH, NEW JERSEY
DIRECTORATE OF PUBLIC WORKS
BUILDING 167
FORT MONMOUTH, NJ 07703**

PREPARED BY:

**SMC ENVIRONMENTAL SERVICES GROUP
501 ALLENDALE ROAD
KING OF PRUSSIA, PA 19406**

PROJECT NO. 2491-308

TABLE OF CONTENTS

EXECUTIVE SUMMARY	iv
1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES	1
1.1 OVERVIEW	1
1.2 SITE DESCRIPTION	2
1.2.1 Geological/Hydrogeological Setting	2
1.3 HEALTH AND SAFETY	4
1.4 REMOVAL OF UNDERGROUND STORAGE TANK	4
1.4.1 General Procedures	4
1.4.2 Underground Storage Tank Excavation and Cleaning	4
1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL	5
1.6 MANAGEMENT OF EXCAVATED SOILS	5
2.0 SITE INVESTIGATION ACTIVITIES	6
2.1 OVERVIEW	6
2.2 FIELD SCREENING/MONITORING	6
2.3 SOIL SAMPLING	7
3.0 CONCLUSIONS AND RECOMMENDATIONS	8
3.1 SOIL SAMPLING RESULTS	8
3.2 CONCLUSIONS AND RECOMMENDATIONS	8

TABLE OF CONTENTS (CONTINUED)

TABLES

Table 1	Summary of Post-Excavation Sampling Activities
Table 2	Post-Excavation Soil Sampling Results

FIGURES

Figure 1	Site Location Map
Figure 2	Site Map
Figure 3	Cross Sectional View
Figure 4	Soil Sampling Location Map

APPENDICES

Appendix A	NJDEP Standard Reporting Form
Appendix B	Site Assessment Summary
Appendix C	Waste Manifest
Appendix D	UST Disposal Certificate
Appendix E	Soil Analytical Data Package
Appendix F	Photographs

EXECUTIVE SUMMARY

UST Closure

On March 9, 1998, a steel underground storage tank (UST) was closed by removal in accordance with the New Jersey Department of Environmental Protection (NJDEP) underground storage tank procedures at the Main Post-West area of the U.S. Army Fort Monmouth, Fort Monmouth, New Jersey. The UST, NJDEP Registration No. 0081533-231 (Fort Monmouth ID No. 907), was located northwest of Building 906. UST No. 0081533-231 was a 1,080-gallon No. 2 fuel oil UST.

Site Assessment

The site assessment was performed by U.S. Army personnel in accordance with the NJDEP *Technical Requirements for Site Remediation* (N.J.A.C. 7:26E) and the NJDEP *Field Sampling Procedures Manual*. The sampling and laboratory analysis conducted during the site assessment were performed in accordance with Section 7:26E-2.1 of the *Technical Requirements for Site Remediation*. Soils surrounding the tank were screened visually and with air monitoring equipment for evidence of contamination. Following removal, the UST was inspected for corrosion holes or punctures. No holes or punctures were noted in the UST and no evidence of potentially contaminated soils was observed surrounding the tank. The piping was not found and appears to have been removed when Building 907 was demolished. Groundwater was not encountered. Samples contained TPHC concentrations ranging from non-detect to 337.78 mg/kg.

Site Restoration

Following receipt of all post-excavation soil sampling results, the excavation was backfilled to grade with crushed stone, sand, and native backfill and restored to its original condition.

Conclusions and Recommendations

Based on the post-excavation soil sampling results, soils with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST.

No further action is proposed in regard to the closure and site assessment of UST No. 0081533-231 at Building 907.

1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES

1.1 OVERVIEW

One underground storage tank (UST), New Jersey Department of Environmental Protection (NJDEP) Registration No. 0081533-231, was closed at Building 907 at the Main Post-West area of U.S. Army Fort Monmouth, Fort Monmouth, New Jersey on March 9, 1998. Refer to site location map on Figure 1. This report presents the results of the Department of Public Works (DPW) implementation of the UST Decommissioning/Closure Plan approved by the NJDEP. The UST was a steel 1,080-gallon tank containing No. 2 fuel oil.

Decommissioning activities for UST No. 0081533-231 complied with all applicable Federal, State and Local laws and ordinances in effect at the date of decommissioning. These laws included but were not limited to N.J.A.C. 7:14B-1 et seq., N.J.A.C. 5:23-1 et seq., and Occupational Safety and Health Administration (OSHA) 1910.146 & 1910.120. All permits including but not limited to the NJDEP-approved Decommissioning/Closure Plan were posted onsite for inspection. The decommissioning activities were conducted by DPW personnel who are registered and certified by the NJDEP for performing UST closure activities. Closure of UST No. 0081533-231 proceeded under the approval of the NJDEP Bureau of Underground Storage Tanks (NJDEP-BUST). The Standard Reporting Form and signed Site Assessment Summary form for UST No. 0081533-231 are included in Appendices A and B, respectively.

Based on inspecting the UST, field screening of subsurface soils and groundwater, and reviewing analytical results of collected soil samples, the DPW has concluded that no significant historical discharges are associated with the UST.

This UST Closure and Site Investigation Report has been prepared by SMC Environmental Services Group, to assist the United States Army Directorate of Public Works (DPW) in complying with the NJDEP-BUST regulations. The applicable NJDEP-BUST regulations at the date of closure were the *Interim Closure Requirements for Underground Storage Tank Systems* (N.J.A.C. 7:14B-1 et seq. October 1990 and revisions dated November 1, 1991).

This report was prepared using information collected at the time of closure. Section 1 of this UST Closure and Site Investigation Report provides a summary of the UST decommissioning activities. Section 2 of this report describes the site investigation activities. Conclusions and recommendations, including the results of the soil sampling investigation, are presented in the final section of this report.

1.2 SITE DESCRIPTION

Building 907 is located in the Main Post-West area of the Fort Monmouth Army Base. UST No. 0081533-231 was located northwest of Building 906. The piping, which was not found, appears to have been removed when Building 907 was demolished. A site map is provided on Figure 2.

1.2.1 Geological/Hydrogeological Setting

The following is a description of the geological/hydrogeological setting of the area surrounding Building 907. Included is a description of the regional geology of the area surrounding Fort Monmouth as well as descriptions of the local geology and hydrogeology of the Main Post area.

Regional Geology

Monmouth County lies within the New Jersey Section of the Atlantic Coastal Plain physiographic province. The Main Post, Charles Wood, and the Evans areas are located in what may be referred to as the Outer Coastal Plain subprovince, or the Outer Lowlands.

In general, New Jersey Coastal Plain formations consist of a seaward-dipping wedge of unconsolidated deposits of clay, silt, and gravel. These formations typically strike northeast-southwest with a dip ranging from 10 to 60 feet per mile and were deposited on Precambrian and lower Paleozoic rocks (Zapczka, 1989). These sediments, predominantly derived from deltaic, shallow marine, and continental shelf environments, date from Cretaceous through the Quaternary Periods. The mineralogy ranges from quartz to glauconite.

The formations record several major transgressive/regressive cycles and contain units which are generally thicker to the southeast and reflect a deeper water environment. Over 20 regional geologic units are present within the sediments of the Coastal Plain. Regressive, upward coarsening deposits are usually aquifers (e.g., Englishtown and Kirkwood Formations, and the Cohansey Sand) while the transgressive deposits act as confining units (e.g., the Merchantville, Marshalltown, and Navesink Formations). The individual thicknesses for these units vary greatly (i.e., from several feet to several hundred feet). The Coastal Plain deposits thicken to the southeast from the Fall Line to greater than 6,500 feet in Cape May County (Brown and Zapczka, 1990).

Local Geology

Based on the regional geologic map (Jablonski, 1968), the Cretaceous age Red Bank and Tinton Sands outcrop at the Main Post area. The Red Bank sand conformably overlies the Navesink Formation and dips to the southeast at 35 feet per mile. The upper member (Shrewsbury) of the Red Bank sand is a yellowish-gray to reddish brown clayey, medium-to-coarse-grained sand that contains abundant rock fragments, minor mica and glauconite (Jablonski). The lower member (Sandy Hook) is a dark gray to black, medium-to-fine grained sand with abundant clay, mica, and glauconite.

The Tinton sand conformably overlies the Red Bank Sand and ranges from a clayey medium to very coarse grained feldspathic quartz and glauconite sand to a glauconitic coarse sand. The color varies from dark yellowish orange or light brown to moderate brown and from light olive to grayish olive. Glauconite may constitute 60 to 80 percent of the sand fraction in the upper part of the unit (Minard, 1969). The upper part of the Tinton is often highly oxidized and iron oxide encrusted (Minard).

Hydrogeology

The water table aquifer in the Main Post area is identified as part of the "composite confining units", or minor aquifers. The minor aquifers include the Navesink formation, Red Bank Sand, Tinton Sand, Hornerstown Sand, Vincentown Formation, Manasquan Formation, Shark River Formation, Piney Point Formation, and the basal clay of the Kirkwood Formation.

Based on records of wells drilled in the Main Post area, water is typically encountered at depths of 2 to 9 feet below ground surface (bgs). According to Jablonski, wells drilled in the Red Bank and Tinton Sands may produce 2 to 25 gallons per minute (gpm). Some well owners have reported acidic water that requires treatment to remove iron.

Due to the proximity of the Atlantic Ocean to Fort Monmouth, shallow groundwater may be tidally influenced and may flow toward creeks and brooks as the tide goes out, and away from creeks and brooks as the tide comes in. However, an abundance of clay lenses and sand deposits were noted in borings installed throughout Fort Monmouth. Therefore, the direction of shallow groundwater should be determined on a case-by-case basis.

Shallow groundwater is locally influenced within the Main Post area by the following factors:

- X tidal influence (based on proximity to the Atlantic Ocean, rivers, and tributaries)
- X topography
- X nature of the fill material within the Main Post area
- X presence of clay and silt lenses in the natural overburden deposits
- X local groundwater recharge areas (i.e., streams, lakes)

Due to the fluvial nature of the overburden deposits (i.e., sand and clay lenses), shallow groundwater flow direction is best determined on a case-by-case basis. This is consistent with lithologies observed in borings installed within the Main Post area, which primarily consisted of fine-to-medium grained sands, with occasional lenses or laminations of gravel silt and/or clay.

Building 907 located approximately 200 feet south of Husky Brook, the nearest water body. Based on the Main Post topography, the groundwater flow in the area of Building 907 is anticipated to be to the north.

1.3 HEALTH AND SAFETY

Before, during, and after all decommissioning activities, hazards at the work site which may have posed a threat to the Health and Safety of all personnel who were involved with, or were affected by, the decommissioning of the UST system were minimized. All areas, which posed, or may have been suspected to pose a vapor hazard were monitored by a qualified individual utilizing an organic vapor analyzer (OVA). The individual ascertained if the area was properly vented to render the area safe, as defined by OSHA.

1.4 REMOVAL OF UNDERGROUND STORAGE TANK

1.4.1 General Procedures

- X All underground obstructions (utilities, etc.) were identified by the contractor performing the closure prior to excavation activities.
- X All activities were carried out with the greatest regard to safety and health and the safeguarding of the environment.
- X All excavated soils were visually examined and screened with an OVA for evidence of contamination. Potentially contaminated soils were identified and logged during closure activities.
- X Surface materials (i.e., asphalt, concrete, etc.) were excavated and staged separately from all soil and recycled in accordance with all applicable regulations and laws.
- X A Sub-Surface Evaluator from the DPW was present during all site assessment activities.

1.4.2 Underground Storage Tank Excavation and Cleaning

Prior to UST decommissioning activities, surficial soil was removed to expose the UST. The UST was then purged to remove vapors prior to cutting. After purging the UST, a manway was made to allow for proper cleaning. The UST was completely emptied of all liquids prior to removal from the ground. LORCO and Casie Protank transported approximately 50 gallons of liquid from the UST. Refer to Appendix C for the waste manifest.

The UST was cleaned prior to removal from the excavation in accordance with the NJDEP-BUST regulations. After the UST was removed from the excavation, it was staged on polyethylene sheeting and examined for holes. No holes or punctures were observed during the inspection by the Sub-Surface Evaluator. Soils surrounding the UST were screened visually and with an OVA for evidence of contamination. No evidence of contamination was observed. Groundwater was not encountered. See Figure 3 for a cross-sectional view of the excavated area.

1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL

The tank was transported to Mazza and Sons, Inc., Metal Recyclers. See Appendix D for a copy of the UST disposal certificate and Appendix F for photographs of the UST. The transportation of the UST was in compliance with all applicable regulations and laws.

The UST was labeled prior to transport with the following information:

- X Site of origin
- X Contact person
- X NJDEP UST Facility ID number
- X Former contents

1.6 MANAGEMENT OF EXCAVATED SOILS

Based on OVA air monitoring and TPHC analysis results from the post-excavation soil samples, no soils exhibited signs of contamination. Therefore, the excavated soils were used as backfill following removal of the UST.

2.0 SITE INVESTIGATION ACTIVITIES

2.1 OVERVIEW

The Site Investigation was managed and carried out by U.S. Army DPW personnel. All analyses were performed and reported by U.S. Army Fort Monmouth Environmental Laboratory, a NJDEP-certified testing laboratory. All sampling was performed under the direct supervision of a NJDEP Certified Sub-Surface Evaluator according to the methods described in the NJDEP *Field Sampling Procedures Manual* (1992). Sampling frequency and parameters analyzed complied with the NJDEP-BUST document *Interim Closure Requirements for Underground Storage Tank Systems* (October 1990 and revisions dated November 1, 1991) which was the applicable regulation at the date of the closure. All records of the Site Investigation activities are maintained by the Fort Monmouth DPW Environmental Office.

The following Parties participated in Closure and Site Investigation Activities:

- X Subsurface Evaluator: Charles Appleby
Employer: U.S. Army, Fort Monmouth
Phone Number: (732) 532-6224
NJDEP Certification No.: 2056

- X Analytical Laboratory: U.S. Army Fort Monmouth Environmental Laboratory
Contact Person: Daniel K. Wright
Phone Number: (908) 532-4359
NJDEP Company Certification No.: 13461

- X Hazardous Waste Hauler: Lionetti Oil Recovery Co. Inc
Contact Person: Charles Clayton
Phone Number: (908) 721-0900
NJDEP Hazardous Waste Hauler No.: S6247

- X Hazardous Waste Hauler: Casie Protank Environmental Services
Contact Person: Bob Corsiglia
Phone Number: (609) 696-4401
NJDEP Hazardous Waste Hauler No.: 16931

2.2 FIELD SCREENING/MONITORING

Field screening was performed by a NJDEP Certified Sub-Surface Evaluator using an OVA and visual observations to identify potentially contaminated material. Soil excavated from around the tank and UST excavation sidewalls and bottom, did not exhibit any evidence of potential contamination. Groundwater was not encountered.

2.3 SOIL SAMPLING

On March 9, 1998, following the removal of the UST, post-excavation soil samples A, B, C, D, E, and DUP B were collected from a total of five (5) locations of the UST excavation. . Samples A, B, C and DUP B were collected along the centerline at a depth of 6.0 feet bgs. Sidewall samples D and E were collected at a depth of 5.5 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

U.S. Army personnel in accordance with the NJDEP Technical Requirements and the NJDEP Field Sampling Procedures Manual performed the site assessment. A summary of sampling activities including parameters analyzed is provided in Table 1. The post-excavation soil samples were collected using NJDEP *Field Sampling Procedures Manual* (1992) standard sampling procedures. Following soil sampling activities, the samples were chilled and delivered to U.S. Army Fort Monmouth Environmental Laboratory located in Fort Monmouth, New Jersey, for analysis.

3.0 CONCLUSIONS AND RECOMMENDATIONS

3.1 SOIL SAMPLING RESULTS

To evaluate soil conditions following removal of the UST, post-excavation soil samples were collected on March 9, 1998, from a total of five (5) locations. All samples were analyzed for TPHC and total solids. The post-excavation sampling results were compared to the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 mg/kg (N.J.A.C. 7:26D and revisions dated February 3, 1994). A summary of the analytical results and comparison to the NJDEP soil cleanup criteria is provided in Table 2 and the soil sampling locations are shown on Figure 4. The analytical data package is provided in Appendix E.

All post-excavation soil samples collected on March 9, 1998, from the UST excavation contained concentrations of TPHC below the NJDEP soil cleanup criteria. Samples contained TPHC levels ranging from non-detect to 337.78 mg/kg.

3.2 CONCLUSIONS AND RECOMMENDATIONS

The analytical results for all post-excavation soil samples collected from the UST closure excavation at Building 907 were below the NJDEP soil cleanup criteria for total organic contaminants.

Based on the post-excavation sampling results, soils with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST.

No further action is proposed in regard to the closure and site assessment of UST No. 0081533-231 at Building 907.

TABLES

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
BUILDING 907, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 1 of 1

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	Analysis Method
A	3/9/98	3/10/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
B	3/9/98	3/10/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
C	3/9/98	3/10/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
D	3/9/98	3/10/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
E	3/9/98	3/10/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
DUP B	3/9/98	3/10/98	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 907, MAIN POST-WEST AREA
 FORT MONMOUTH, NEW JERSEY

Page 1 of 1

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Method Used	Method Detection Limit (mg/kg)	Compound of Concern	Result (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
A/6.0=	3395.01	3/9/98	3/10/98	Total Solid	--	--	79.91	--	--
				TPHC	190	Yes	ND	10,000	No
B/6.0=	3395.02	3/9/98	3/10/98	Total Solid	--	--	83.52	--	--
				TPHC	187	Yes	337.78	10,000	No
C/6.0=	3395.03	3/9/98	3/10/98	Total Solid	--	--	81.08	--	--
				TPHC	188	Yes	ND	10,000	No
D/5.5=	3395.04	3/9/98	3/10/98	Total Solid	--	--	81.97	--	--
				TPHC	186	Yes	ND	10,000	No
E/5.5=	3395.05	3/9/98	3/10/98	Total Solid	--	--	85.60	--	--
				TPHC	183	Yes	ND	10,000	No
DUP B/5.5=	3395.06	3/9/98	3/10/98	Total Solid	--	--	83.91	--	--
				TPHC	185	Yes	ND	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
- ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
- Not detected above stated sample quantitation limit
- TPHC Total Petroleum Hydrocarbons

FIGURES

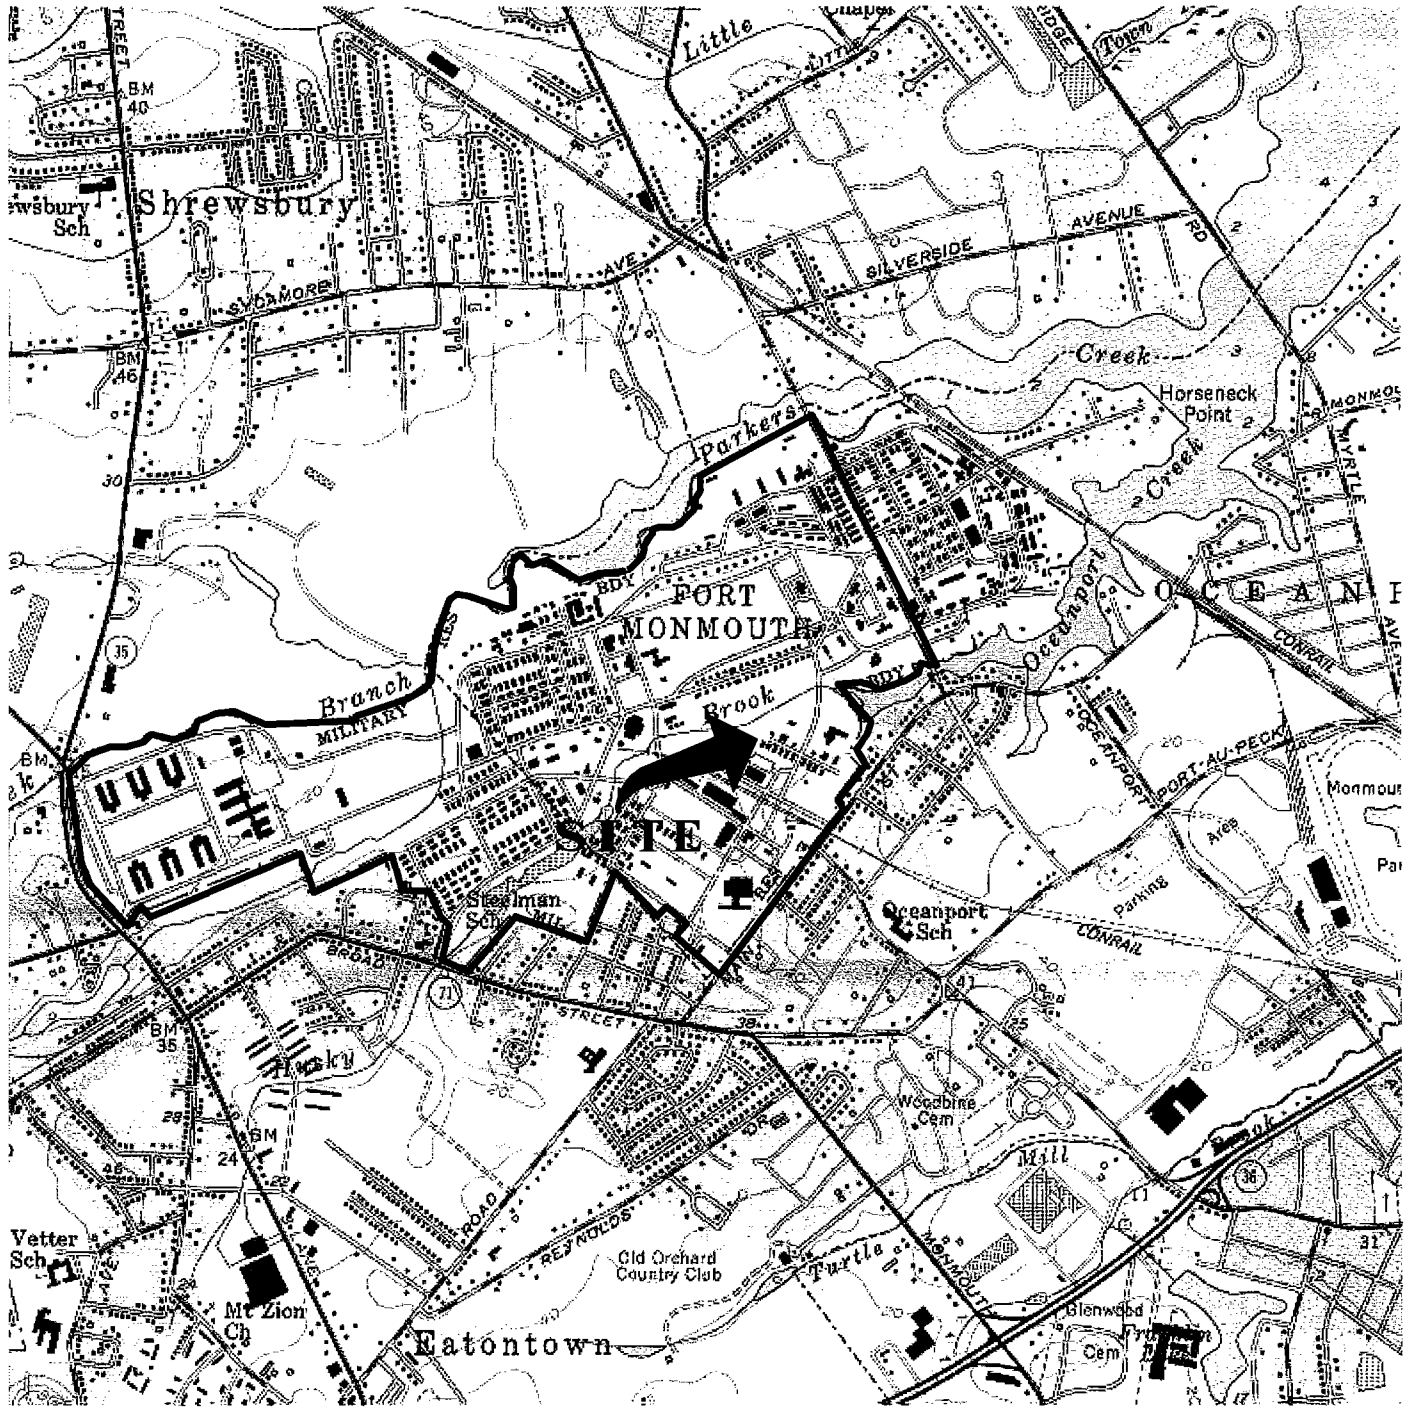


FIGURE 1

SITE LOCATION MAP
 Building 907
 Main Post-West
 Fort Monmouth Army Base
 Monmouth County, NJ



SMC Environmental

Services Group

*Engineers, Managers, Scientists & Planners
 Valley Forge, PA.*


LONG BRANCH, N. J.

40073-C8-TF-024

1954

PHOTOREVISED 1981

DMA 6164 I SE-SERIES V822



NEW
 JERSEY



QUADRANGLE LOCATION

SITE

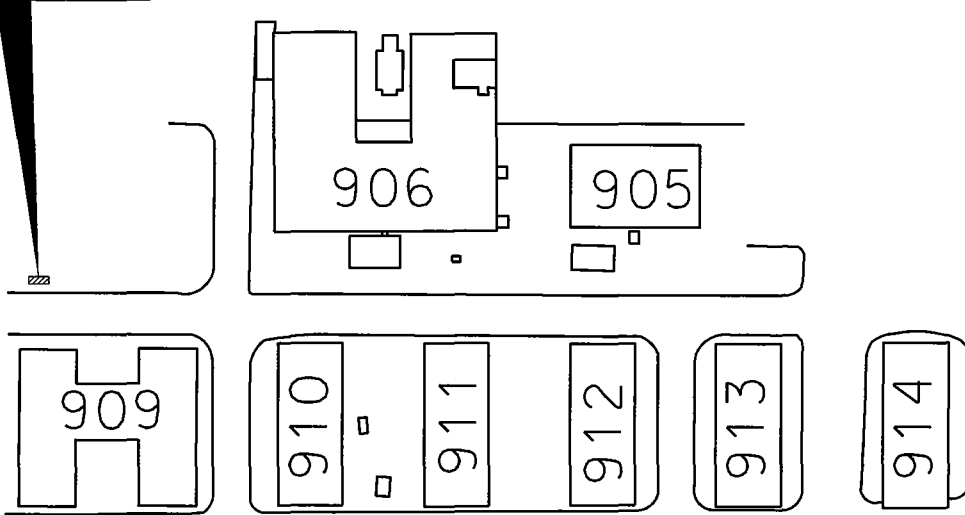


FIGURE 2
SITE MAP
BUILDING 907
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ



SMC ENVIRONMENTAL
SERVICES GROUP
Engineers, Managers, Scientists & Planners
VALLEY FORGE, PA.

SCALE: 1"=100'

DATE: MARCH 1998

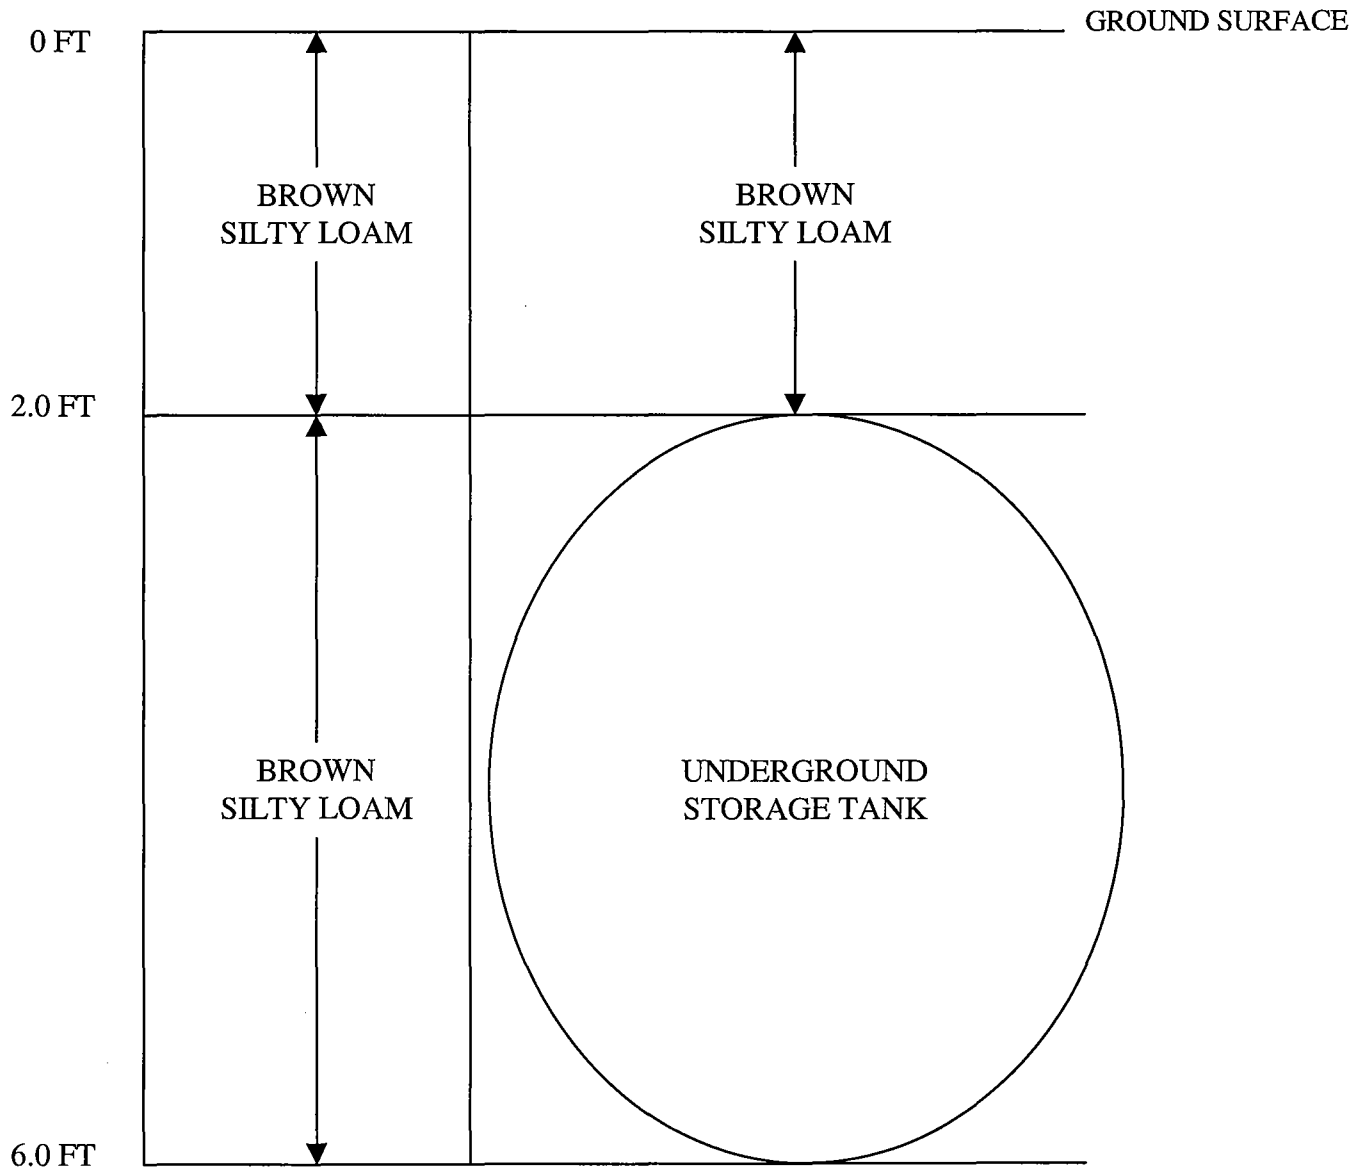



FIGURE 3
 CROSS SECTIONAL VIEW
 BUILDING 907
 FORT MONMOUTH ARMY BASE
 MONMOUTH COUNTY, NJ



**SMC ENVIRONMENTAL
 SERVICES GROUP**
Engineers, Managers, Scientists & Planners
 VALLEY FORGE, PA.

SCALE: NTS

DATE: MARCH 1998

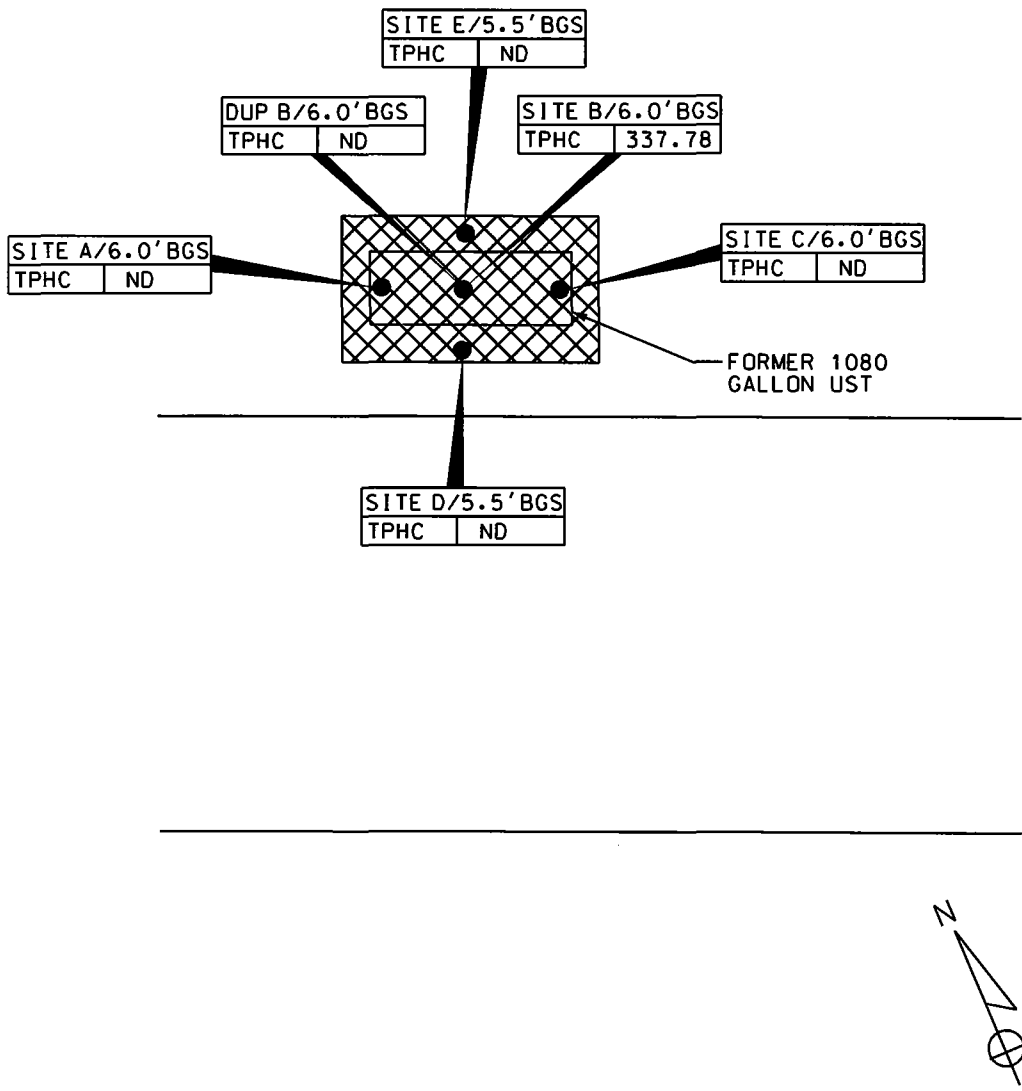

LEGEND


● SOIL SAMPLE LOCATION
(MARCH 9, 1998)

▣ LIMIT OF EXCAVATION
(MARCH 9, 1998)

NOTES:

1. ALL RESULTS IN MG/KG.
2. SEE TABLE 2 FOR NJDEP SOIL CLEANUP CRITERIA
3. BGS = BELOW GROUND SURFACE

FIGURE 4
SOIL SAMPLING LOCATION MAP
BUILDING 907
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

 **SMC ENVIRONMENTAL SERVICES GROUP**
Engineers, Managers, Scientists & Planners
VALLEY FORGE, PA.

SCALE: 1"=10'

DATE: MARCH 1998

907 2429 FIG4


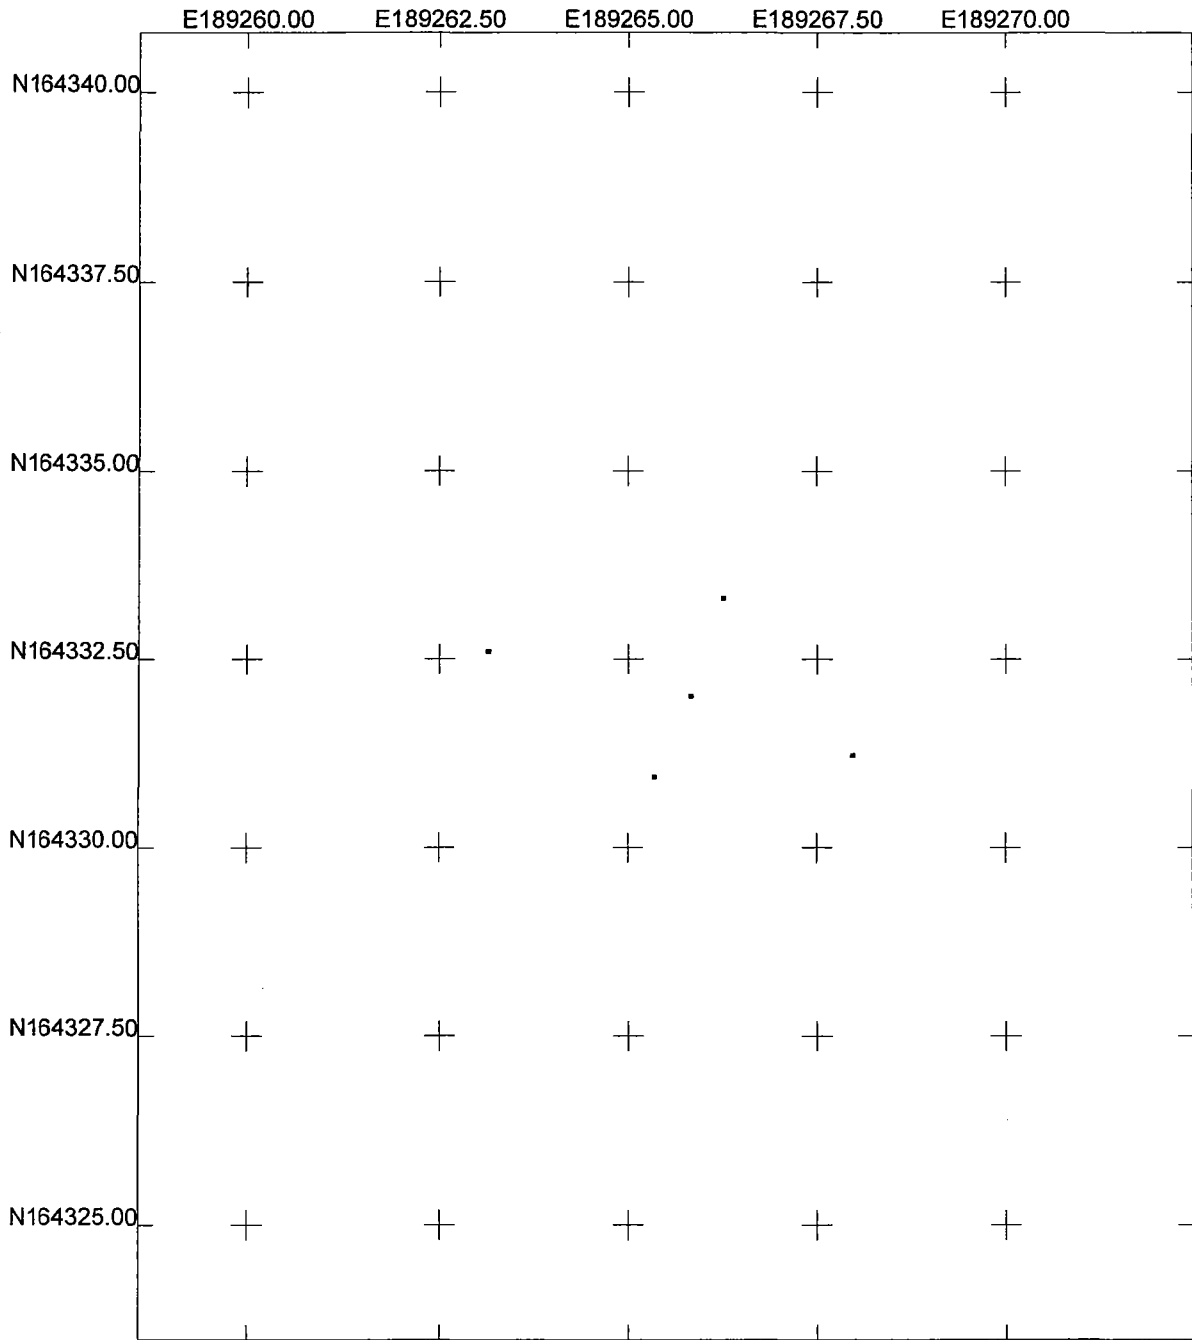


Figure 4 GPS Sampling Locations Map

US State Plane 1983
 New Jersey (NY East) 2900
 NAD 1983 (Conus)



r010715a.cor
 1/19/1999
 Pathfinder Office
Trimble

Figure 4 GPS Sample Location Data

US State Plane 1983 NJ (NY East) 2900 NAD 1983 (Conus)

(in Meters)

Sample Points

<u>Location / Desc.</u>	<u>Y Coord. (Northing)</u>	<u>X Coord. (Easting)</u>
907 A	164332.616	189263.13
907 B	164332.019	189265.817
907 C	164331.233	189267.956
907 D	164330.945	189265.329
907 E	164333.32	189266.242

APPENDIX A
NJDEP-STANDARD REPORTING FORM

NEW JERSEY DEPARTMENT OF ENVIRONMENTAL PROTECTION
 DIVISION OF RESPONSIBLE PARTY SITE REMEDIATION
 BUREAU OF APPLICABILITY AND COMPLIANCE
 Registration and Billing Unit
 CN 028, Trenton, N.J. 08625-0028
 1-609-984-3156

FOR STATE USE ONLY

Check In Yes No

STATUS COMCODE
 Active Inactive

UNDERGROUND STORAGE TANK
 FACILITY QUESTIONNAIRE **COPY**

FACILITY UST # 0081533 Bldg 907

Completion of this Registration Questionnaire will satisfy the registration requirements of the Underground Storage of Hazardous Substances Act, N.J.S.A. 58:10A-21, and the Registration and Billing Regulations N.J.A.C. 7:14B-2.

[Check appropriate box(es)]

- A. Is this a registration of a proposed or newly installed underground storage tank? (This form must be filed at least 30 days prior to operation)
- B. Is this a registration of an existing underground storage tank not presently registered?
- C. Is this a correction or amendment to an existing facility registration? UST # 0081533
- D. There have been no changes to the facility registration since last submittal. UST # _____ (Go to certification page for signatures)

If "C" is checked above, please check the appropriate type of change(s) below

- | | | |
|--|--|--|
| <input type="checkbox"/> Facility Name and/or Address Change | <input type="checkbox"/> Type of Product(s) Stored | <input type="checkbox"/> Financial Responsibility Change |
| <input type="checkbox"/> Owner Name and/or Address Change | <input type="checkbox"/> Spills, Leaks, Releases | <input type="checkbox"/> Substantial Modification(s) |
| <input type="checkbox"/> Facility Operator and/or Address Change | <input type="checkbox"/> Tank(s) and/or Piping Changes | <input type="checkbox"/> Sale or Transfer (Complete Questions 4,5,6 & 13D) |
| <input type="checkbox"/> Owner Contact Person Change | <input type="checkbox"/> Closure (Complete Question #13) | <input type="checkbox"/> Other (please specify) |

SECTION A - GENERAL FACILITY INFORMATION

1. Facility Name _____

2. Facility Location MAIN POST WEST
NUMBER AND STREET

CITY OR MUNICIPALITY

COUNTY STATE ZIP CODE BLOCK LOT

3. Facility Operator _____ PERSON OR TITLE Contact Tele. No. _____
(Area Code) (Extension)

Operator Address (if different than #2) _____
NUMBER AND STREET

CITY OR MUNICIPALITY

STATE ZIP CODE

4. Tank Owner _____

5. Tank Owner Address _____
NUMBER AND STREET

CITY OR MUNICIPALITY

STATE ZIP CODE

Contact Person (Tank Owner) _____ Contact Tele. No. _____
(Area Code) (Extension)

7. EPA ID # _____

8. Total number of regulated underground storage tanks at facility _____

the copy

9. Total regulated underground storage tank capacity at facility (gallons)

10. Facility Type: A State C County/Municipal E Charitable / Public School G Other
 B Commercial/Industrial D Federal F Residence H Farm (as defined in N.J.S.A. 54:4-23.1 et seq.)

11. Is a copy of the facility site plan submitted with this registration pursuant to N.J.A.C. 7:14B-2? YES NO

SECTION B - SPECIFIC TANK INFORMATION

ALL underground tanks, including those taken out of operation (UNLESS THE TANK WAS REMOVED FROM THE GROUND PRIOR TO 9/3/86) must be registered. Report all tank/piping status changes unless previously submitted.

	TANK NO.			TANK NO.			TANK NO.			TANK NO.			TANK NO.		
1. Tank Identification Number <i>Bldg 907</i>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>
2. CAS Number (hazardous substances only) <i>NA</i>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>
3. Date Tank Installed (Month/Day/Year)	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year
	<i>01</i>	<i>10</i>	<i>1987</i>												
4. Tank Size (gallons)	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>
		<i>1000</i>													
5. Tank Contents (Mark one "X" for each tank)															
A. Leaded gasoline	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
B. Unleaded gasoline	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
C. Alcohol enriched gasoline	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
D. Light diesel fuel (No. 1-D)	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
E. Medium diesel fuel (No. 2-D)	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
F. Waste Oil	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
G. Kerosene (No. 1)	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
H. Home heating oil (No. 2)	<input checked="" type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
J. Heating oil (No. 4)	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
K. Heavy heating oil (No. 6)	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
L. Aviation fuel	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
M. Motor oil	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
N. Lubricating oil	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
P. Sewage	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
Q. Sewage sludge	<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>			<input type="checkbox"/>		
R. Other hazardous substances (specify)															
S. Hazardous waste (specify ID number)															
T. Mixtures (please specify)															
U. Emergency spill tank (specify substance)															
V. Other petroleum products (please specify)															
W. Other (please specify)															
6. Tank & Piping Construction (Mark one each for both tank & piping)	Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping	
A. Bare Steel	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
B. Cathodically protected steel	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
C. Fiberglass-coated steel	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
D. Fiberglass-reinforced plastic	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
E. Internally lined	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
F. Other (please specify)	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
7. Tank & Piping Structure (Mark one each for both tank & piping)	Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping	
A. Single wall	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
B. Double wall	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
C. Other (please specify)	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
8. Type of Monitoring/Detection System (Mark all that apply for both tank & piping)	Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping		Tank	Piping	
A. Statistical Inventory Reconciliation	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
B. Manual Tank Gauging	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
C. Inventory Control	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
D. Interstitial	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
E. Precision Test	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
F. Ground water observation wells	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
G. Vapor observation wells	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
H. In-tank (automatic) monitoring gauge	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	
J. Periodic Tank Test	<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>	

Tank Identification Number	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.
	0231				
8. Type of Monitoring/Detection System	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
K. None	<input checked="" type="checkbox"/> <input checked="" type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>
L. Other (please specify)					
9. Overfill Protection (tank only) (Mark one X for each tank)					
A. Yes	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
B. No	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
10. Spill Containment Around Fill Pipe (Mark one X for each tank)					
A. Yes	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
B. No	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
11. Tank Status (Mark one X for each tank)	Tank Piping	Tank Piping	Tank Piping	Tank Piping	Tank Piping
A. In-use	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>
B. Empty less than 12 months	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>
C. Empty 12 months or more	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>
D. Emergency spill tank (sump)	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>
E. Emergency backup generator tank	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>
F. Abandoned in Place	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>
G. Removed	<input checked="" type="checkbox"/> <input checked="" type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>
H. Other (please specify)					
12. If box 11B, C, or D above has been marked, indicate the estimated date last used (month/day/year)	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year
13. Closure Information - Tank ID No.	TANK NO.	TANK NO.	TANK NO.	TANK NO.	TANK NO.
	0231				
	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year
A. Date abandoned in place					
B. Date taken temporarily out of service					
C. Date removed	03 09 1998				
D. Date of Sale or Transfer					
E. TMS # (if applicable)					
F. ISRA # (if applicable)					

SECTION C - FINANCIAL RESPONSIBILITY

Does this facility have a Financial Responsibility Assurance Mechanism as required in 40 CFR 280? YES NO
Please list the appropriate financial information below:

Type	Carrier / Issuing Agency
Effective Date	Expiration Date
Policy Number	\$ Amount

SECTION D - MONITORING SYSTEMS

Does this facility have a release detection monitoring system which is in compliance with N.J.A.C. 7:14B-6? YES NO
If "No", please be aware that the facility must meet the appropriate deadline. (See "Dates to Know" on Page 4)

SECTION E - RECORDKEEPING/COMPLIANCE

- Please answer all the questions in this section on a facility basis. Any one tank not in compliance requires a "NO" answer for the entire facility.
- Does this facility have cathodic protection systems for all steel tanks and piping? YES NO
If "Yes", are the systems properly operated and maintained pursuant to N.J.A.C. 7:14B-5? YES NO
 - Are the performance claims and documentation of monitoring systems maintained by the owner or operator pursuant to N.J.A.C. 7:14B-5? YES NO
 - Are the proper monitoring, testing, sampling, repair and inventory records kept on-site pursuant to N.J.A.C. 7:14B-5 and 6? YES NO
 - Is the proper Release Response Plan kept on-site pursuant to N.J.A.C. 7:14B-5? YES NO
 - Does the facility have spill and over fill protection systems pursuant to N.J.A.C. 7:14B-4? YES NO
 - Have all Fill Ports been permanently marked as per API #1637 pursuant to N.J.A.C. 7:14B-4? YES NO

IMPORTANT INFORMATION

FEE: Please make checks payable to: "Treasurer, State of New Jersey". Use of the enclosed return envelope will expedite processing. Registration and Billing Schedule can be found in N.J.A.C. 7:14B. All Initial Registration fees are \$100 per facility.
PENALTY: Failure by owner or operator of a regulated underground storage tank to comply with any requirement of the State UST Act or regulations may result in the penalties set forth in N.J.S.A. 58:10A-10.
EMERGENCY: If a discharge or spill occurs, the NJDEP Hotline at (609) 292-7172 must be called IMMEDIATELY - 24 hours a day.
UPGRADE EXEMPTION: Residential heating oil underground storage tanks are exempt from all upgrade requirements.

DATES TO KNOW (critical deadlines)

- December 22, 1988 — All new federally regulated tank systems must have cathodic protection and spill/overflow protection.
- September 4, 1990 — All new State-only regulated tank systems must have cathodic protection and spill/overflow protection.
- December 22, 1990 — All federally regulated piping must have begun leak detection.
- February 19, 1993 — All federally regulated tank systems must maintain financial responsibility assurance.
- December 22, 1993 — All federally regulated tank systems must have begun leak detection.
- December 22, 1998 — All regulated tanks shall install cathodic protection and spill/overflow protection.

CERTIFICATIONS

NOTE: IF THE PERSON SIGNING CERTIFICATION NO. 2 IS THE SAME AS THE PERSON SIGNING CERTIFICATION NO. 1, THEN CERTIFICATION NO. 2 NEED NOT BE SIGNED. (If different persons are required to sign No. 1 and No. 2, then they must do so.)

CERTIFICATION NO. 1:

Must be signed by the highest ranking individual at the facility with overall responsibility

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

MR. JAMES OTT
(Typed / Printed Name)

James Ott
(Signature)

Dir DPW
(Title)

4/19/98
(Date)

CERTIFICATION NO. 2:

Must be signed as follows:

- For a corporation, by a principal executive officer of at least the level of vice president
- For a partnership or sole proprietorship, by a general partner or the proprietor, respectively
- For a municipality, State, Federal or other public agency, by either a principal executive officer or ranking elected official
- For persons other than indicated above, by the person with legal responsibility for the site

"I certify under penalty of law that I have personally examined and am familiar with the information submitted herein and all attached documents, and that based on my inquiry of those individuals immediately responsible for obtaining the information. I believe that the submitted information is true, accurate and complete. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

(Typed / Printed Name)

(Signature)

(Title)

(Date)

CERTIFICATION NO. 3:

If applicable, must be signed by the individual who is certified to perform services.

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

CHARLES APPLEBY

ENVIRONMENTAL PROTECTION SPEC.

(Typed / Printed Name)

(Title)

Charles Appleby
(Signature)

4/18/98
(Date)

U.S. Army
(Name of Firm, if applicable)

2056
(NJ. Certification Number)

APPENDIX B
SITE ASSESSMENT SUMMARY

Site Remediation Program

UST Site/Remedial Investigation Report Certification Form

A. Facility Name : U.S. Army Fort Monmouth New Jersey

Facility Street Address : Directorate of Public Works Building 173

Municipality: Oceanport County : Monmouth

Block: Lot(s): Telephone Number : 732-532-6224

B. Owner (RP)'s Name:

Street Address: City :

State: Zip: Telephone Number :

C. (Check as appropriate)

- Site Investigation Report (SIR) \$500 Fee
Remedial Investigation Report (RIR) \$1000 Fee
[X] NA - Federal Agreement

D. (Complete all that apply)

- Assigned Case Manager : Ian Curtis, Federal Case Manager
UST Registration Number : 81533-231 (7 digits)
Incident Report Number (10 or 12 digits)
Tank Closure Number : Federal Case Manager

E. Certification by the Subsurface Evaluator:

The attached report conforms to the specific reporting requirements of N.J.A.C. 7:26E Yes No

Name: Charles Appleby Signature: UST Cert. No.: 2056

Firm: U.S. Army Fort Monmouth Firm's UST Cert. Number: NA - U.S. Army

Firm Address: Directorate of Public Works Building 173 City: Fort Monmouth

State: New Jersey Zip: 07703 Telephone Number : 732-532-6224

(NOTE: Certification numbers required only if work was conducted on USTs regulated per N.J.S.A. 58:10A-21 et seq.)

F. Certification by the Responsible Party(ies) of the Facility:

The following certification shall be signed [according to the requirements of N.J.A.C. 7:14B-1.7(b)] as follows:

- 1. For a Corporation by a person authorized by a resolution of the board of directors to sign the document.
2. For a partnership or sole proprietorship, by a general partner or the proprietor, respectively; or
3. For a municipality, State, federal or other public agency by either a principal executive officer or ranking elected Official.

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attached documents, and that based on my inquiry of those individuals responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete. I am aware that there are significant civil penalties for knowingly submitting false, inaccurate, or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Name (Print or Type): James Ott Title: Directorate of Public Works

Signature: James Ott

Company Name: U.S. Army Fort Monmouth Date: 11/2/99



APPENDIX C
WASTE MANIFEST

CASIE / PROTANK

ENVIRONMENTAL SERVICES

907

Please type or print in block letters. (Form designed for use on elite (12-pitch) typewriter.)

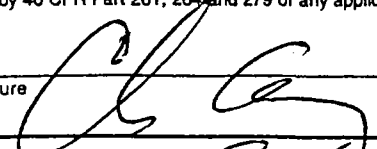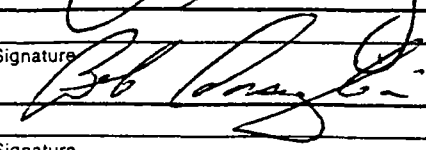NON-HAZARDOUS MANIFEST		1. Generator's US EPA ID No. N J 3 2 1 0 0 2 0 5 9 7 1		2. Page 1 of 1	
3. Generator's Name and Mailing Address U.S. Army Com. Elec. Command Main Post Bldg 173/Attn: Fort Monmouth NJ 07703				A. Non-hazardous Manifest Document Number NHZ020 16448	
4. Generator's Phone (732) 532-6223		6. US EPA ID Number		B. State Generator's ID c/o James Shirghior Joe Fallon	
5. Transporter 1 Company Name Casie Ecology Oil Salvage, Inc. N J D 0 4 5 9 9 5 6 9 3		8. US EPA ID Number		C. State Trans. ID 1 6 9 3 1	
7. Transporter 2 Company Name		10. US EPA ID Number		D. Transporter's Phone (609) 696-4401	
9. Designated Facility Name and Site Address Casie Ecology Oil Salvage, Inc. T/A 3209 N. Mill Rd / Casie Protank Vineland NJ 08360 N J D 0 4 5 9 9 5 6 9 3				E. State Trans. ID	
11. US DOT Description (Including Proper Shipping Name, Hazard Class, and ID Number)				F. Transporter's Phone ()	
a. Combustible liquid, n.o.s. (Fuel Oil) NA1993, PGIII				G. State Facility's ID 0614D1HP05	
12. Containers No. Type				13. Total Quantity	
0 0 1 T T				X3370	
14. Unit Wt/Vol				L Waste No.	
				G I D 7 2	
J. Additional Descriptions for Materials Listed Above L, T %oil/sed. %wtr.				K. Handling Codes for Wastes Listed Above	
a.				a.	
b.				b.	
15. Special Handling Instructions and Additional Information a. 24 Hr. Emergency Response #609 696-4401 K. Ambrosia NAERG# 127					
16. GENERATOR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by proper shipping name and are classified, packed, marked, and labeled, and are in all respects in proper condition for transport by highway according to applicable international and national government regulations. I hereby certify that the above-named material is not hazardous waste as defined by 40 CFR Part 261, 264 and 279 or any applicable state law.					
Printed/Typed Name Charles Appleby SEL FM-RW-EV		Signature 		Month Day Year 07/01/98	
17. Transporter 1 Acknowledgement of Receipt of Materials Printed/Typed Name Bob Corisic		Signature 		Month Day Year 07/01/98	
18. Transporter 2 Acknowledgement of Receipt of Materials Printed/Typed Name		Signature		Month Day Year	
19. Discrepancy Indication Space					
20. Facility Owner or Operator. Certification of receipt of non-hazardous materials covered by this manifest except as noted in Item 19.					
Printed/Typed Name		Signature		Month Day Year	



RD. 1, BOX 5A - OLD BRIDGE, NJ 08857

NON-HAZARDOUS WASTE MANIFEST

1. Generator's US EPA ID No. **NJ321002059709298**

Manifest Document No.

2. Page 1 of 1

NHZ 009298

3. Generator's Name and Mailing Address
**US Army Communications Electronics Command
Main Post, c/o Joe Fallon, Bldg. 173, AHN-SELFM-PW-EV
Fort Monmouth, NJ 07703**

4. Generator's Phone (732) 532-6223

5. Transporter 1 Company Name
LIONETTI OIL RECOVERY CO INC

6. US EPA ID Number
N J D O 8 4 0 4 4 0 6 4

A. Transporter's Phone
908 721-0900

7. Transporter 2 Company Name

8. US EPA ID Number

B. Transporter's Phone

9. Designated Facility Name and Site Address
**LIONETTI OIL RECOVERY CO INC DBA LORCO PETROLEUM SVCS
RUNYON&CHEESEQUAKE RDS
OLD BRIDGE, NJ 08857**

10. US EPA ID Number
N J D O 8 4 0 4 4 0 6 4

C. Facility's Phone
908 721-0900

11. Waste Shipping Name and Description

12. Containers No. Type

13. Total Quantity

14. Unit Wt/Vol

a. **PETROLEUM OIL (PETROLEUM OIL)
COMBUSTIBLE LIQUID UN1270 PGIII**

0 0 1 T X 2.125 G

b.

c.

d.

D. Additional Descriptions for Materials Listed Above
**T, L PETROLEUM OIL 80%
WATER 20%**

E. Handling Codes for Wastes Listed Above
T04 FILTRATION

15. Special Handling Instructions and Additional Information
**24 HR EMERGENCY RESPONSE# (908) 721-0900
DECAL #128 DEXSIL TEST KIT RESULTS PPM
MANIFEST USED FOR TRACKING PURPOSES ONLY**

16. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste

Printed/Typed Name
Joseph M. Fallon

Signature
Joseph M. Fallon Month Day Year
12/10/97

17. Transporter 1 Acknowledgement of Receipt of Materials
Printed/Typed Name
Anibal Vazquez

Signature
Anibal Vazquez Month Day Year
12/10/97

18. Transporter 2 Acknowledgement of Receipt of Materials
Printed/Typed Name

Signature
Month Day Year

19. Discrepancy Indication Space

20. Facility Owner or Operator: Certification of receipt of waste materials covered by this manifest except as noted in Item 19.

Printed/Typed Name
Richard LaBeco

Signature
Richard LaBeco Month Day Year
12/10/97

ORIGINAL - RETURN TO GENERATOR

GENERATOR

TRANSPORTER

FACILITY

APPENDIX D
UST DISPOSAL CERTIFICATE

APPENDIX E
SOIL ANALYTICAL DATA PACKAGE

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
98-0001
Bldg. 907

Project # 3395
Date Rec. 03/09/98
Date Compl. 03/12/98
Released by:



Daniel K. Wright
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5-6
Results Summary	7
Initial Calibration Summary	8
Continuing Calibration Summary	9
Surrogate Results Summary	10
MS/MSD Results Summary	11
Quality Control Spike Summary	12
Raw Sample Data	13-24
Laboratory Deliverable Checklist	25

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.


The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report

	<u>No</u>	<u>Yes</u>
1. Method Detection Limits provided.	—	✓
2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank. _____ _____	✓	—
3. Matrix Spike Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	—	✓
4. Duplicate Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	—	✓
5. IR Spectra submitted for standards, blanks, & samples	—	NA —
6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.	—	✓
7. Analysis holding time met. (If not met, list number of days exceeded for each sample) _____ _____	—	✓
Additional Comments: _____ _____ _____		

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



Daniel K. Wright
Laboratory Manager

Fort Monmouth Environmental Testing Laboratory



Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (908)532-4359 Fax (908)532-3484 EMail:appleby@doim6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: DPW-ENV		Project No: 98-0001		Analysis Parameters					Comments: * = SAMPLES KEPT BELOW 4°C.	
Phone #:		Location: B. 907		TPHC	CASOLIDS	MUNSELL	OHA			
() DERA (X) OMA () Other:										
Samplers Name / Company: GARY DIMARTINO - TVS				Sample #						
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles	TPHC	CASOLIDS	MUNSELL	OHA	Remarks / Preservation Method
3395, 01	907-A	3-9-98	1411	SOIL	1	X	X	X	ND	CENTER LINE @ 6.0'*
02	B	↓	1413	↓	↓	↓	↓	↓	5	↓
03	C	↓	1417	↓	↓	↓	↓	↓	5	↓
04	D	↓	1419	↓	↓	↓	↓	↓	ND	SIDEWALL @ 5.5'
05	E	↓	1421	↓	↓	↓	↓	↓	ND	↓
06	DUP	↓	—	↓	↓	↓	↓	↓	—	FIELD DUPLICATE ↓
NOTE: NO PIPING FOUND EXCEPT FOR DIRECT FALL										
NOTE: OHA (#A52114) CALIBRATED W/ 95 PPM CH4 + ZERO(O) AIR @ 1400 HRS ON 3/9/98 BY G. DIMARTINO.										
Relinquished by (signature): <i>[Signature]</i>		Date/Time: 3-9-98 1530		Received by (signature): <i>[Signature]</i>		Relinquished by (signature):		Date/Time:		Received by (signature):
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):		Date/Time:		Received by (signature):
Report Type: () Full, (X) Reduced, () Standard, () Screen / non-certified						Remarks: DEDICATED SAMPLING TOOLS USED.				
Turnaround time: (X) Standard 4 wks, () Rush Days, () ASAP Verbal Hrs										

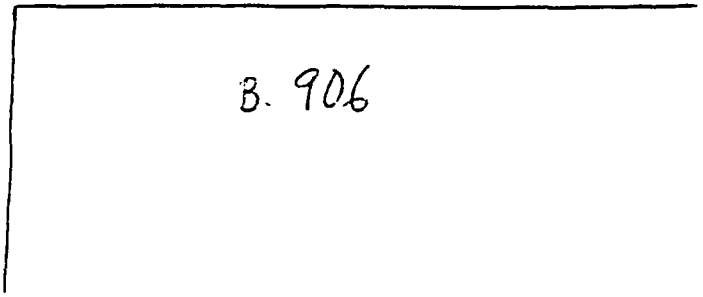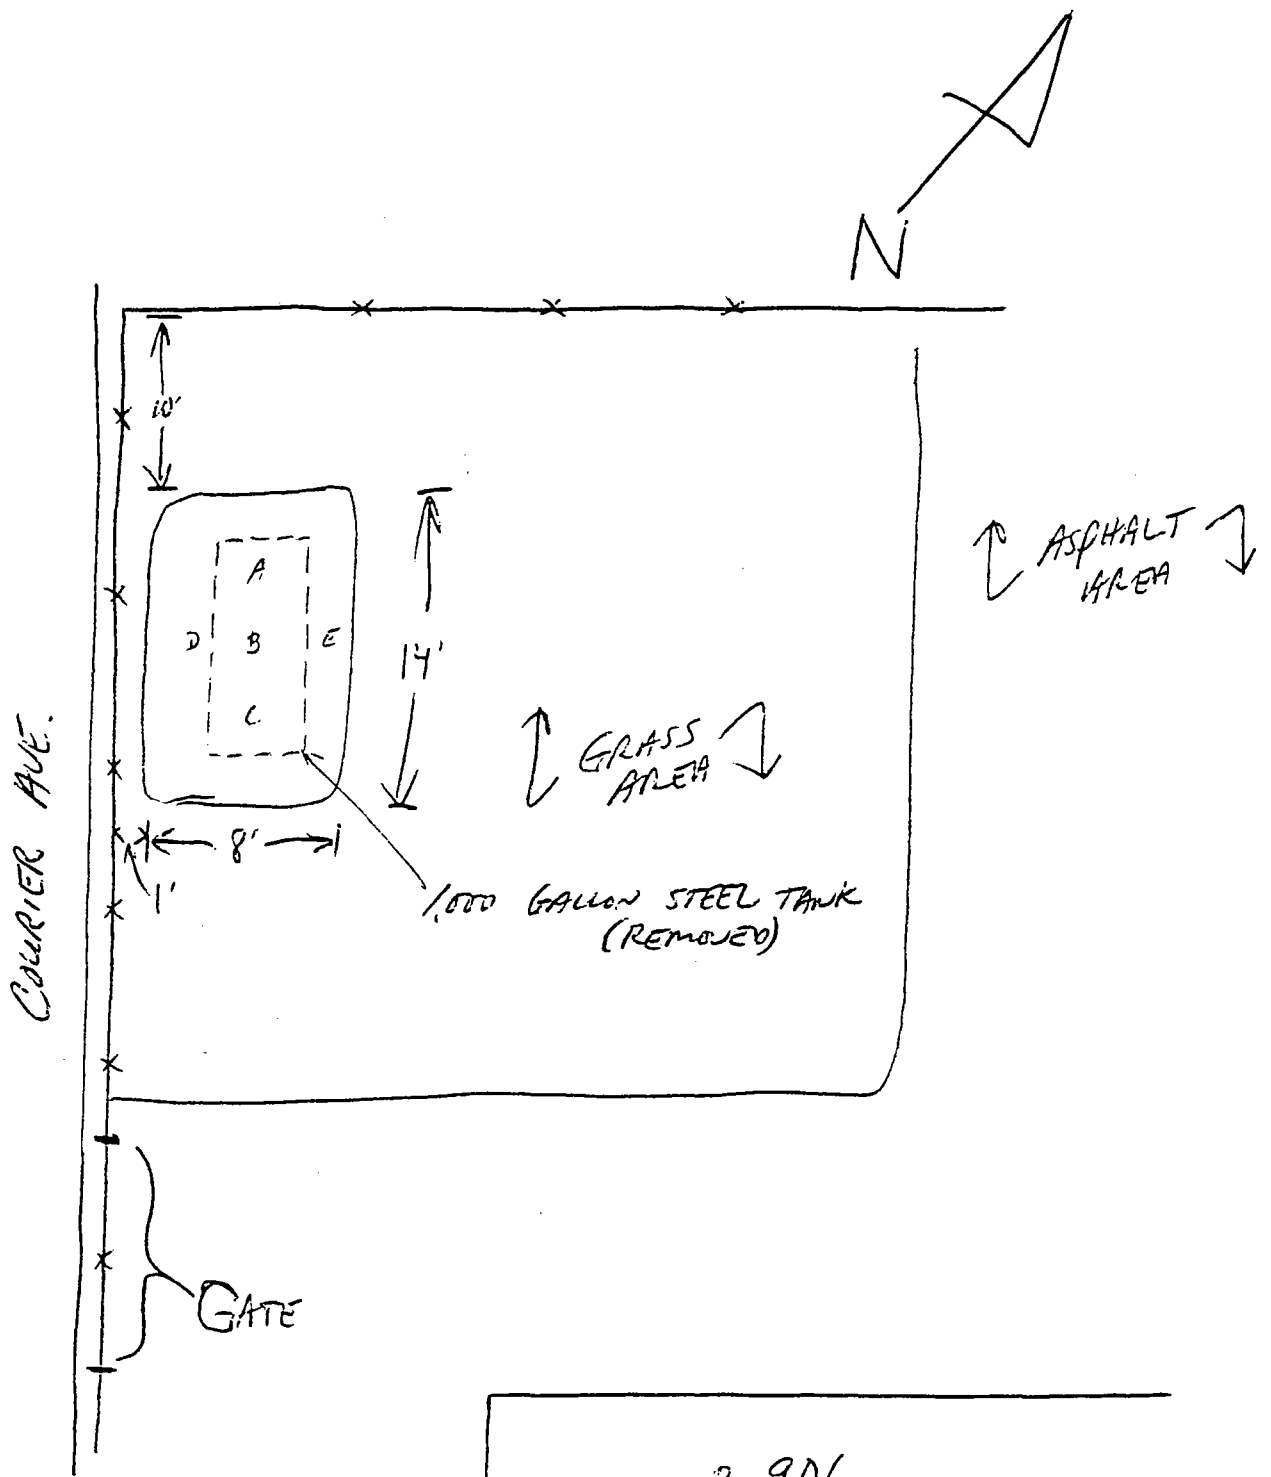

A	1411	ND
B	1413	S
C	1417	S
D	1419	ND
E	1421	NA

BLDG. 907 3/9/98 SAMPLING EVENT
 NOTE: GW NOT ENCOUNTERED


Report of Analysis
 U.S. Army, Fort Monmouth Environmental Laboratory
 NJDEP Certification # 13461

Client :	U.S. Army	Lab. ID # :	3395
	DPW. SELFM-PW-EV	Date Rec'd:	09-Mar-98
	Bldg. 173	Analysis Start:	10-Mar-98
	Ft. Monmouth, NJ 07703	Analysis Complete:	12-Mar-98

Analysis:	OQA-QAM-025	UST Reg. #:	
Matrix:	Soil	Closure #:	
Analyst:	D.DEINHARDT	DICAR #:	
Ext. Meth:	Shake	Location #:	B. 907

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
3395.01	907-A	1.00	15.50	79.91	190	ND
3395.02	907-B	2.00	15.03	83.52	187	337.78
3395.03	907-C	1.00	15.44	81.08	188	ND
3395.04	907-D	1.00	15.38	81.97	186	ND
3395.05	907-E	1.00	15.04	85.60	183	ND
3395.06	907-DUP	1.00	15.14	83.91	185	ND
METHOD BLANK	10-Mar-98	1.00	15.00	100.00	157	ND

ND = Not Detected
 MDL = Method Detection Limit


 Daniel K. Wright
 Laboratory Director

Response Factor Report FID/TCD

Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
 Title : TPHC Calibration 06/05/97 21 peaks
 Last Update : Fri Mar 13 07:39:31 1998

Calibration Files

200 =T04528.D 100 =T04530.D 50 =T04531.D
 10 =T04532.D 5 =T04529.D

Compound	200	100	50	10	5	Avg	%RSD
1) tC C8	2.171	1.843	2.306	2.006	2.110	2.087 E4	8.35
2) tC C10	2.432	1.952	2.451	2.091	2.320	2.249 E4	9.76
3) TC C12	2.685	2.130	2.689	2.267	2.502	2.454 E4	10.20
4) tC C14	2.777	2.203	2.801	2.392	2.690	2.573 E4	10.22
5) tC C16	2.836	2.257	2.873	2.476	2.815	2.651 E4	10.26
6) tC C18	3.200	2.519	3.295	2.841	3.232	3.018 E4	10.94
7) tC C20	3.054	2.463	3.143	2.673	3.017	2.870 E4	10.06
8) tC C22	3.053	2.433	3.094	2.636	2.979	2.839 E4	10.23
9) tC C24	3.055	2.426	3.086	2.619	2.852	2.808 E4	10.10
10) tC C26	2.881	2.277	2.892	2.401	2.706	2.631 E4	10.65
11) tC C28	2.455	1.914	2.435	2.080	2.351	2.247 E4	10.62
12) tC C30	2.155	1.653	2.082	1.797	2.069	1.951 E4	11.02
13) tC C32	2.019	1.517	1.906	1.542	1.745	1.746 E4	12.61
14) tC C34	1.857	1.349	1.695	1.519	1.755	1.635 E4	12.35
15) tC C36	1.636	1.167	1.494	1.455	1.778	1.506 E4	15.15
16) tC C38	1.435	1.026	1.308	1.499	1.675	1.389 E4	17.42
17) tC C40	1.198	0.899	1.177	1.287	1.576	1.227 E4	19.81
18) tC c42	1.071	0.808	1.071	1.243	1.505	1.140 E4	22.52
19) TC Pristane	3.248	2.354	3.046	2.662	3.138	2.890 E4	12.87
20) TC Phytane	3.170	2.514	3.164	2.863	2.987	2.940 E4	9.20
21) sC o-terphenyl	3.313	2.636	3.363	2.907	3.316	3.107 E4	10.35
22) tC TPHC - total	2.915	2.351	3.061	3.193	4.019	3.108 E4	19.37

Evaluate Continuing Calibration Report

Data File : C:\HPCHEM\1\DATA\980312\T04545.D
 Acq On : 12 Mar 98 10:09 am
 Sample : 50 PPM STD
 Misc :
 IntFile : TPHCINT.E

Vial: 100
 Operator: DEINHARDT
 Inst : FID/TCD
 Multiplr: 1.00

Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
 Title : TPHC Calibration 06/05/97 21 peaks
 Last Update : Fri Mar 13 07:39:31 1998
 Response via : Multiple Level Calibration

Min. RRF : 0.000 Min. Rel. Area : 50% Max. R.T. Dev 0.50min
 Max. RRF Dev : 25% Max. Rel. Area : 200%

Compound	AvgRF	CCRF	%Dev	Area%	Dev(min)
1 tC C8	20.874	19.823 E3	5.0	0#	0.00
2 tC C10	22.494	20.824 E3	7.4	0#	0.00
3 TC C12	24.545	23.495 E3	4.3	0#	0.00
4 tC C14	25.725	24.609 E3	4.3	0#	0.00
5 tC C16	26.514	25.326 E3	4.5	0#	0.00
6 tC C18	30.176	28.265 E3	6.3	0#	0.00
7 tC C20	28.701	26.186 E3	8.8	0#	0.00
8 tC C22	28.391	27.369 E3	3.6	0#	0.00
9 tC C24	28.075	26.675 E3	5.0	0#	0.00
10 tC C26	26.315	26.018 E3	1.1	0#	0.00
11 tC C28	22.469	22.578 E3	-0.5	0#	0.00
12 tC C30	19.513	19.739 E3	-1.2	0#	0.00
13 tC C32	17.457	17.685 E3	-1.3	0#	0.00
14 tC C34	16.348	15.779 E3	3.5	0#	0.00
15 tC C36	15.062	13.611 E3	9.6	0#	0.00
16 tC C38	13.887	11.357 E3	18.2	0#	0.00
17 tC C40	12.275	10.066 E3	18.0	0#	0.00
18 tC c42	11.395	9.605 E3	15.7	0#	-0.02
19 TC Pristane	28.898	26.879 E3	7.0	0#	0.00
20 TC Phytane	29.395	27.942 E3	4.9	0#	0.00
21 sC o-terphenyl	31.073	29.847 E3	3.9	0#	0.00
22 tC TPHC - total	31.079	25.862 E3	16.8	0#	2.66#

Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461

Matrix Spike Recovery Report

Lab. ID #: 3395

Location #: B. 907

Sample	Spike Amount Added (ppm)	Sample Amount (ppm)	Matrix Spike Amount (ppm)	Percent Recovery	QC Limits %
3395.06MS	1000	0.00	951.64	95.16	75-125
3395.06MSD	1000	0.00	919.47	91.95	75-125

RPD	3.44	20.00
-----	------	-------

Report of Analysis
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification # 13461

Blank Spike Recovery Report

Lab. ID #: 3395

Location #: B. 907

Sample	Date Extracted	Spike Amount Added (ppm)	Matrix Spike Amount (ppm)	Percent Recovery	QC Limits %
Blank Spike	10-Mar-98	1000	942.64	94.26	75-125

Quantitation Report (QT Reviewed)

Data File : C:\HPCHEM\1\DATA\980312\T04550.D
 Acq On : 12 Mar 98 2:22 pm
 Sample : 3395.01
 Misc :
 IntFile : TPHCINT.E
 Quant Time: Mar 16 16:37 1998

Vial: 17
 Operator: DEINHARDT
 Inst : FID/TCD
 Multiplr: 1.00

Quant Results File: TPH25.RES

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
 Title : TPHC Calibration 06/05/97 21 peaks
 Last Update : Wed Mar 11 14:49:32 1998
 Response via : Initial Calibration
 DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
 Signal Phase : HP-5
 Signal Info : 30m x 0.32mm

Compound	R.T.	Response	Conc Units
System Monitoring Compounds			
21) sC o-terphenyl	13.95	281134	9.048 mg/L
Spiked Amount 10.000	Range 8 - 13	Recovery =	90.48%#

Target Compounds			
1) tC C8	0.00	0	N.D. mg/L
2) tC C10	0.00	0	N.D. mg/L
3) TC C12	0.00	0	N.D. mg/L
4) tC C14	0.00	0	N.D. mg/L
5) tC C16	0.00	0	N.D. mg/L
6) tC C18	0.00	0	N.D. mg/L
7) tC C20	0.00	0	N.D. mg/L
8) tC C22	0.00	0	N.D. mg/L
9) tC C24	0.00	0	N.D. mg/L
10) tC C26	0.00	0	N.D. mg/L
11) tC C28	0.00	0	N.D. mg/L
12) tC C30	0.00	0	N.D. mg/L
13) tC C32	0.00	0	N.D. mg/L
14) tC C34	0.00	0	N.D. mg/L
15) tC C36	0.00	0	N.D. mg/L
16) tC C38	0.00	0	N.D. mg/L
17) tC C40	0.00	0	N.D. mg/L
18) tC c42	0.00	0	N.D. mg/L
19) TC Pristane	0.00	0	N.D. mg/L
20) TC Phytane	0.00	0	N.D. mg/L
22) tC TPHC - total	0.00	0	N.D. mg/L d

Quantitation Report


Data File : C:\HPCHEM\1\DATA\980312\T04550.D
Acq On : 12 Mar 98 2:22 pm
Sample : 3395.01
Misc :
IntFile : TPHCINT.E
Quant Time: Mar 16 16:37 1998

Vial: 17
Operator: DEINHARDT
Inst : FID/TCD
Multiplr: 1.00

Quant Results File: TPH25.RES

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
Title : TPHC Calibration 06/05/97 21 peaks
Last Update : Wed Mar 11 14:49:32 1998
Response via : Multiple Level Calibration
DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
Signal Phase : HP-5
Signal Info : 30m x 0.32mm

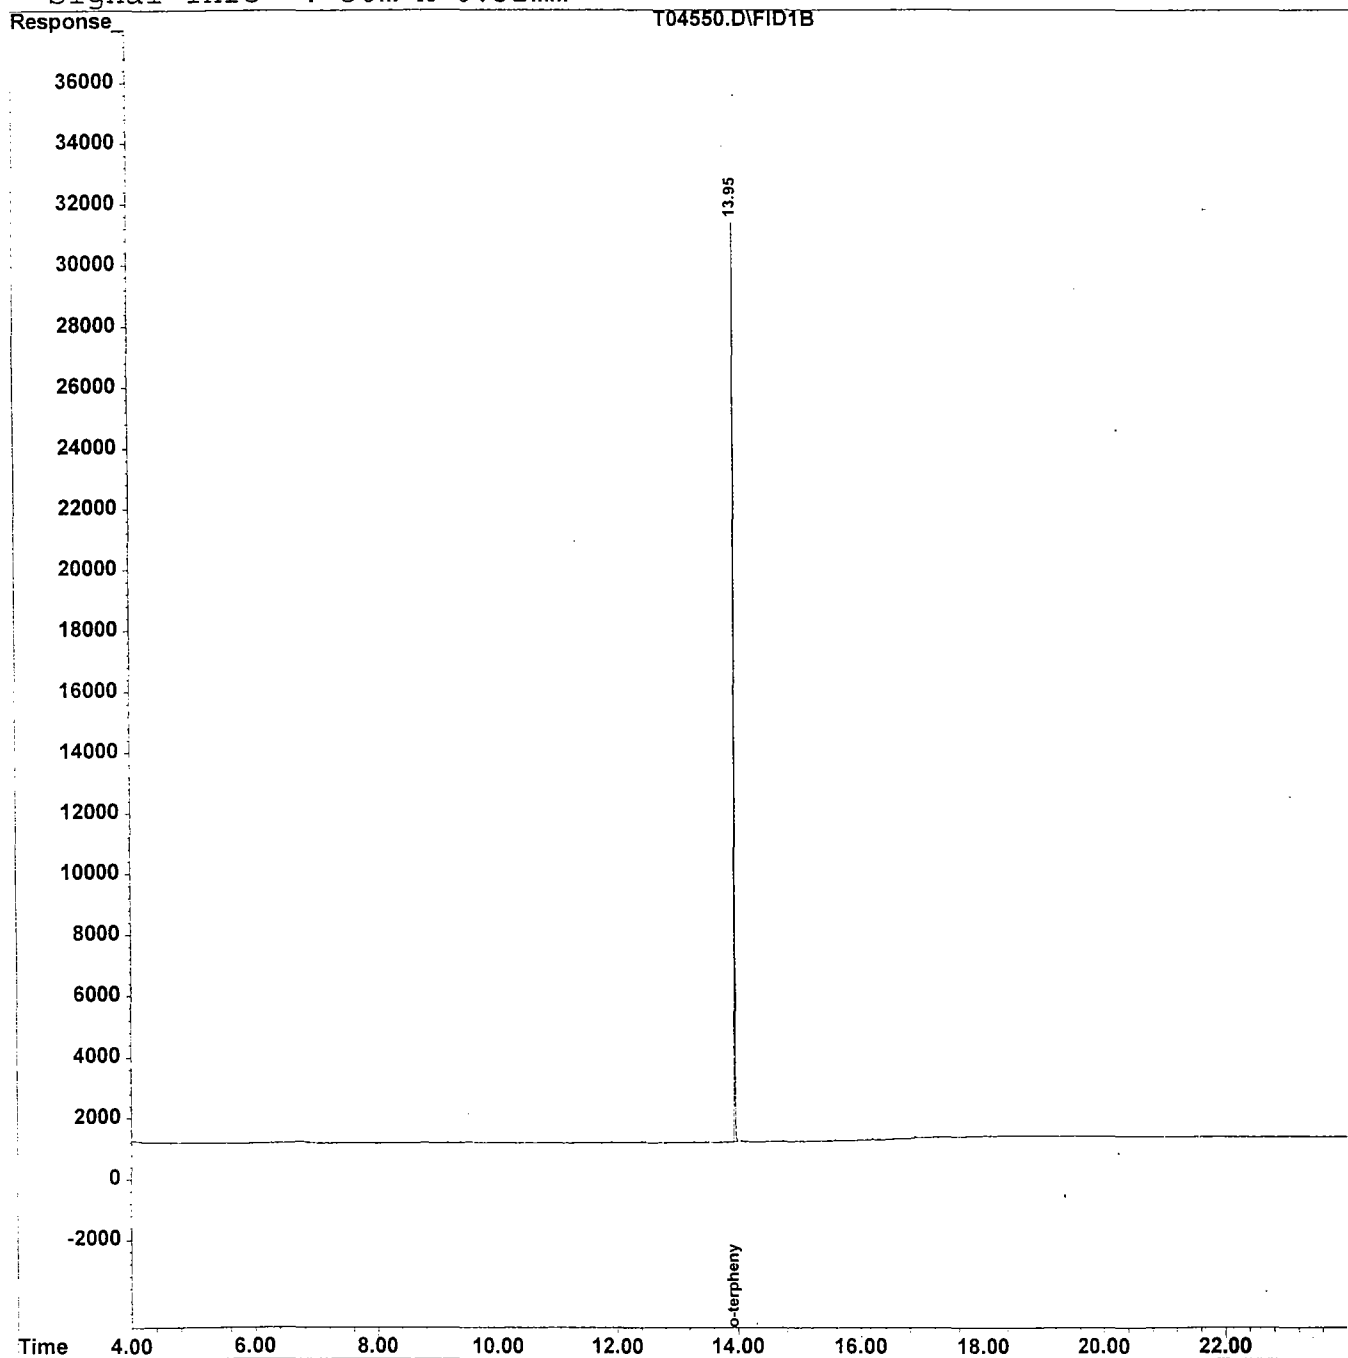

Quantitation Report (QT Reviewed)

Data File : C:\HPCHEM\1\DATA\980312\T04551.D
 Acq On : 12 Mar 98 3:00 pm
 Sample : 3395.02
 Misc :
 IntFile : TPHCINT.E
 Quant Time: Mar 16 16:38 1998

Vial: 18
 Operator: DEINHARDT
 Inst : FID/TCD
 Multiplr: 1.00

Quant Results File: TPH25.RES

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
 Title : TPHC Calibration 06/05/97 21 peaks
 Last Update : Wed Mar 11 14:49:32 1998
 Response via : Initial Calibration
 DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
 Signal Phase : HP-5
 Signal Info : 30m x 0.32mm

Compound	R.T.	Response	Conc Units
System Monitoring Compounds			
21) sC o-terphenyl	13.95	301919	9.717 mg/L
Spiked Amount 10.000	Range 8 - 13	Recovery =	97.17%#
Target Compounds			
1) tC C8	0.00	0	N.D. mg/L
2) tC C10	0.00	0	N.D. mg/L
3) TC C12	0.00	0	N.D. mg/L
4) tC C14	0.00	0	N.D. mg/L
5) tC C16	12.62	1520	0.057 mg/L
6) tC C18	0.00	0	N.D. mg/L
7) tC C20	13.43	1268	0.044 mg/L
8) tC C22	14.15	2664	0.094 mg/L
9) tC C24	14.95	3163	0.113 mg/L
10) tC C26	0.00	0	N.D. mg/L
11) tC C28	0.00	0	N.D. mg/L
12) tC C30	0.00	0	N.D. mg/L
13) tC C32	0.00	0	N.D. mg/L
14) tC C34	0.00	0	N.D. mg/L
15) tC C36	0.00	0	N.D. mg/L
16) tC C38	0.00	0	N.D. mg/L
17) tC C40	0.00	0	N.D. mg/L
18) tC c42	0.00	0	N.D. mg/L
19) TC Pristane	0.00	0	N.D. mg/L
20) TC Phytane	13.43	1268	0.043 mg/L
22) tC TPHC - total	13.95	1317809	42.402 mg/L m

Quantitation Report


Data File : C:\HPCHEM\1\DATA\980312\T04551.D
Acq On : 12 Mar 98 3:00 pm
Sample : 3395.02
Misc :
IntFile : TPHCINT.E
Quant Time: Mar 16 16:38 1998

Vial: 18
Operator: DEINHARDT
Inst : FID/TCD
Multiplr: 1.00

Quant Results File: TPH25.RES

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
Title : TPHC Calibration 06/05/97 21 peaks
Last Update : Wed Mar 11 14:49:32 1998
Response via : Multiple Level Calibration
DataAcq Meth : TPH25.M

Volume Inj: : 1 ul
Signal Phase : HP-5
Signal Info : 30m x 0.32mm

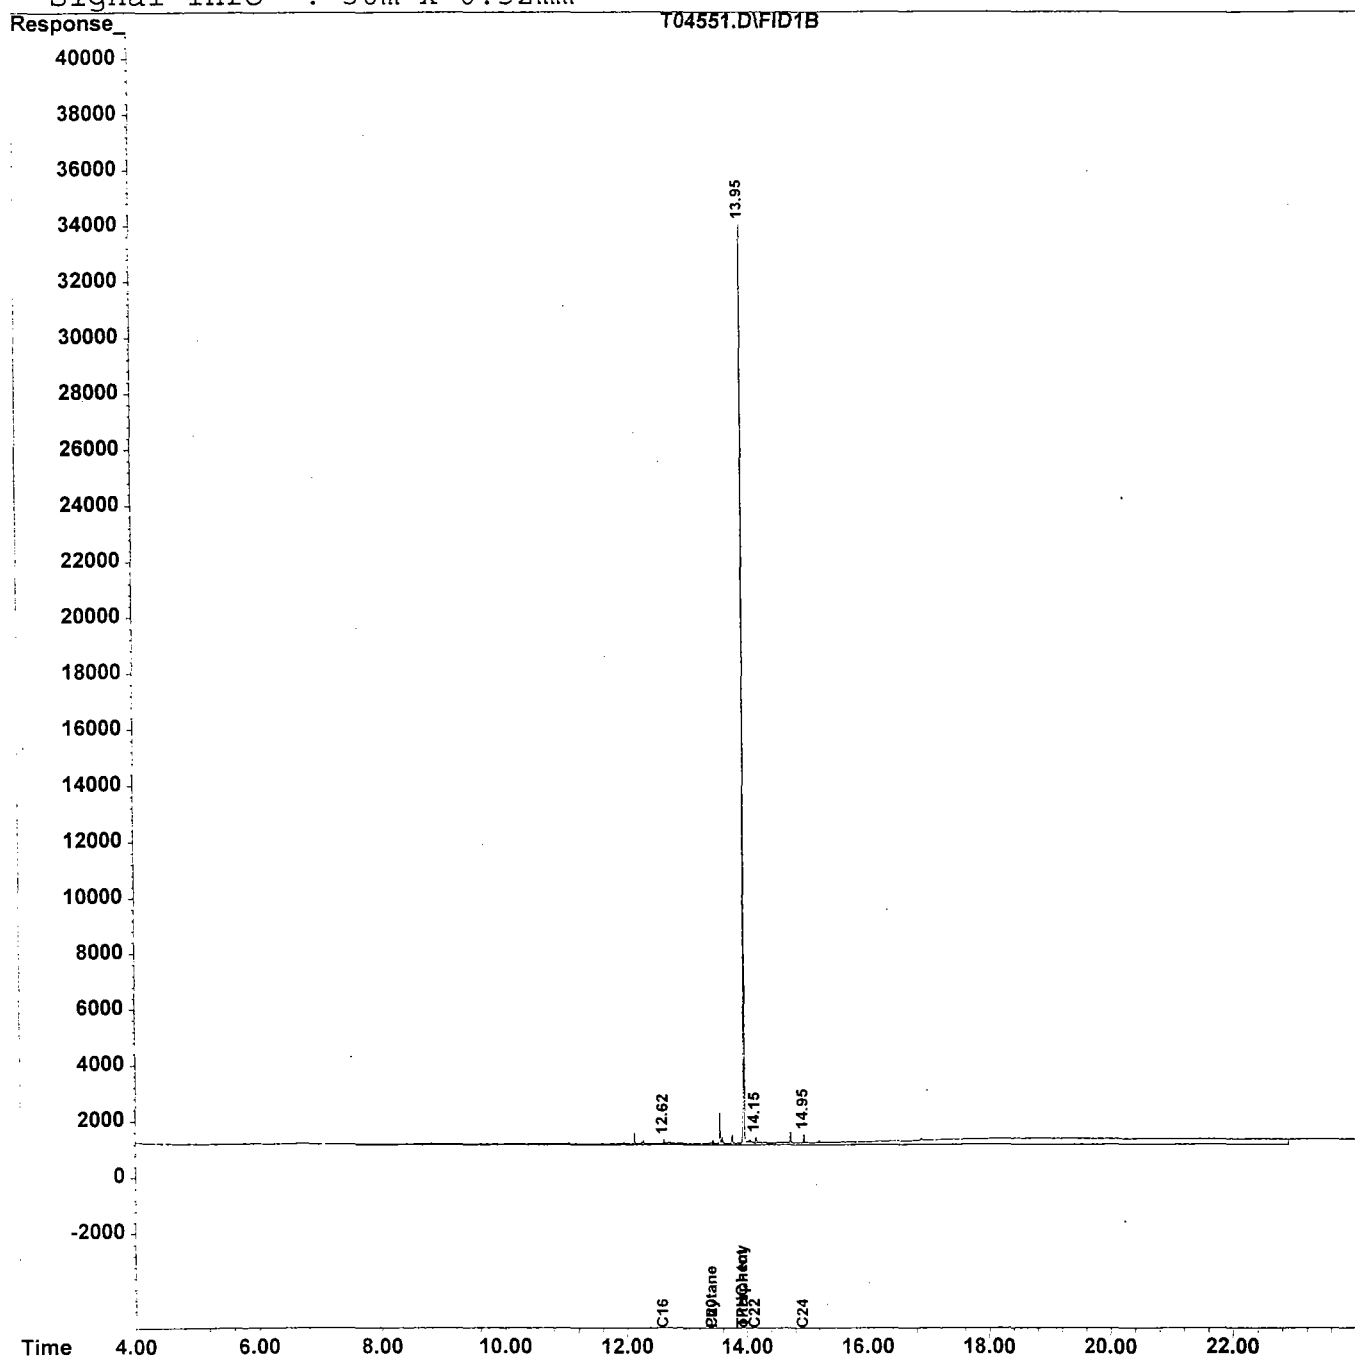

Quantitation Report (QT Reviewed)

Data File : C:\HPCHEM\1\DATA\980312\T04552.D
 Acq On : 12 Mar 98 3:39 pm
 Sample : 3395.03
 Misc :
 IntFile : TPHCINT.E
 Quant Time: Mar 16 16:38 1998

Vial: 19
 Operator: DEINHARDT
 Inst : FID/TCD
 Multiplr: 1.00

Quant Results File: TPH25.RES

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
 Title : TPHC Calibration 06/05/97 21 peaks
 Last Update : Fri Mar 13 07:39:31 1998
 Response via : Initial Calibration
 DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
 Signal Phase : HP-5
 Signal Info : 30m x 0.32mm

Compound	R.T.	Response	Conc Units
System Monitoring Compounds			
21) sC o-terphenyl	13.95	303685	9.773 mg/L
Spiked Amount 10.000	Range 8 - 13	Recovery =	97.73%#
Target Compounds			
1) tC C8	0.00	0	N.D. mg/L
2) tC C10	8.81	1000	0.044 mg/L
3) TC C12	10.36	2625	0.107 mg/L
4) tC C14	0.00	0	N.D. mg/L
5) tC C16	12.62	3477	0.131 mg/L
6) tC C18	0.00	0	N.D. mg/L
7) tC C20	13.43	1692	0.059 mg/L
8) tC C22	14.15	3578	0.126 mg/L
9) tC C24	14.95	7274	0.259 mg/L
10) tC C26	0.00	0	N.D. mg/L
11) tC C28	16.13	1120	0.050 mg/L
12) tC C30	0.00	0	N.D. mg/L
13) tC C32	0.00	0	N.D. mg/L
14) tC C34	0.00	0	N.D. mg/L
15) tC C36	0.00	0	N.D. mg/L
16) tC C38	0.00	0	N.D. mg/L
17) tC C40	0.00	0	N.D. mg/L
18) tC c42	0.00	0	N.D. mg/L
19) TC Pristane	0.00	0	N.D. mg/L
20) TC Phytane	13.43	1692	0.058 mg/L
22) tC TPHC - total	13.95	1373113	44.181 mg/L m


Quantitation Report

Data File : C:\HPCHEM\1\DATA\980312\T04552.D
Acq On : 12 Mar 98 3:39 pm
Sample : 3395.03
Misc :
IntFile : TPHCINT.E
Quant Time: Mar 16 16:38 1998

Vial: 19
Operator: DEINHARDT
Inst : FID/TCD
Multiplr: 1.00

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
Title : TPHC Calibration 06/05/97 21 peaks
Last Update : Fri Mar 13 07:39:31 1998
Response via : Multiple Level Calibration
DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
Signal Phase : HP-5
Signal Info : 30m x 0.32mm

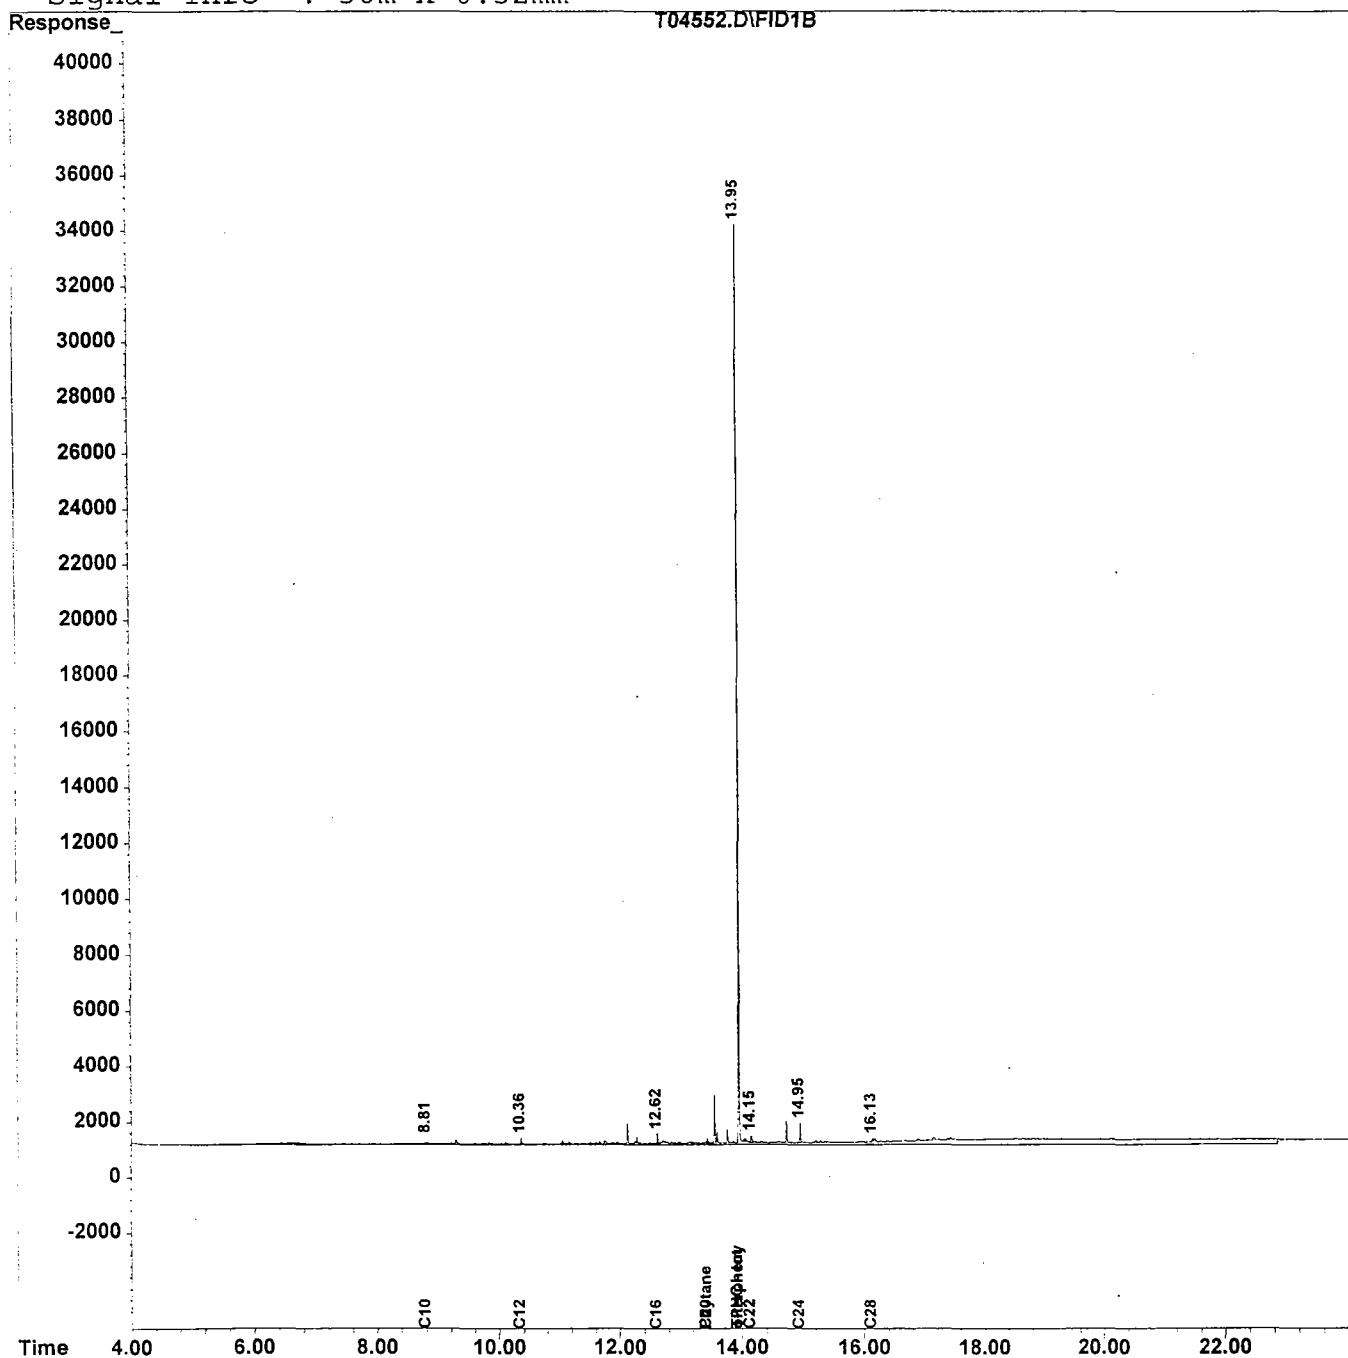

Quantitation Report (QT Reviewed)

Data File : C:\HPCHEM\1\DATA\980312\T04553.D
 Acq On : 12 Mar 98 4:17 pm
 Sample : 3395.04
 Misc :
 IntFile : TPHCINT.E
 Quant Time: Mar 16 16:38 1998

Vial: 20
 Operator: DEINHARDT
 Inst : FID/TCD
 Multiplr: 1.00

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
 Title : TPHC Calibration 06/05/97 21 peaks
 Last Update : Fri Mar 13 07:39:31 1998
 Response via : Initial Calibration
 DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
 Signal Phase : HP-5
 Signal Info : 30m x 0.32mm

Compound	R.T.	Response	Conc	Units
System Monitoring Compounds				
21) sC o-terphenyl	13.95	287790	9.262	mg/L
Spiked Amount 10.000	Range 8 - 13	Recovery =	92.62%	#
Target Compounds				
1) tC C8	0.00	0	N.D.	mg/L
2) tC C10	0.00	0	N.D.	mg/L
3) TC C12	0.00	0	N.D.	mg/L
4) tC C14	0.00	0	N.D.	mg/L
5) tC C16	0.00	0	N.D.	mg/L
6) tC C18	0.00	0	N.D.	mg/L
7) tC C20	0.00	0	N.D.	mg/L
8) tC C22	0.00	0	N.D.	mg/L
9) tC C24	0.00	0	N.D.	mg/L
10) tC C26	0.00	0	N.D.	mg/L
11) tC C28	0.00	0	N.D.	mg/L
12) tC C30	0.00	0	N.D.	mg/L
13) tC C32	0.00	0	N.D.	mg/L
14) tC C34	0.00	0	N.D.	mg/L
15) tC C36	0.00	0	N.D.	mg/L
16) tC C38	0.00	0	N.D.	mg/L
17) tC C40	0.00	0	N.D.	mg/L
18) tC c42	0.00	0	N.D.	mg/L
19) TC Pristane	0.00	0	N.D.	mg/L
20) TC Phytane	0.00	0	N.D.	mg/L
22) tC TPHC - total	0.00	0	N.D.	mg/L d


Quantitation Report

Data File : C:\HPCHEM\1\DATA\980312\T04553.D
Acq On : 12 Mar 98 4:17 pm
Sample : 3395.04
Misc :
IntFile : TPHCINT.E
Quant Time: Mar 16 16:38 1998 Quant Results File: TPH25.RES

Vial: 20
Operator: DEINHARDT
Inst : FID/TCD
Multiplr: 1.00

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
Title : TPHC Calibration 06/05/97 21 peaks
Last Update : Fri Mar 13 07:39:31 1998
Response via : Multiple Level Calibration
DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
Signal Phase : HP-5
Signal Info : 30m x 0.32mm

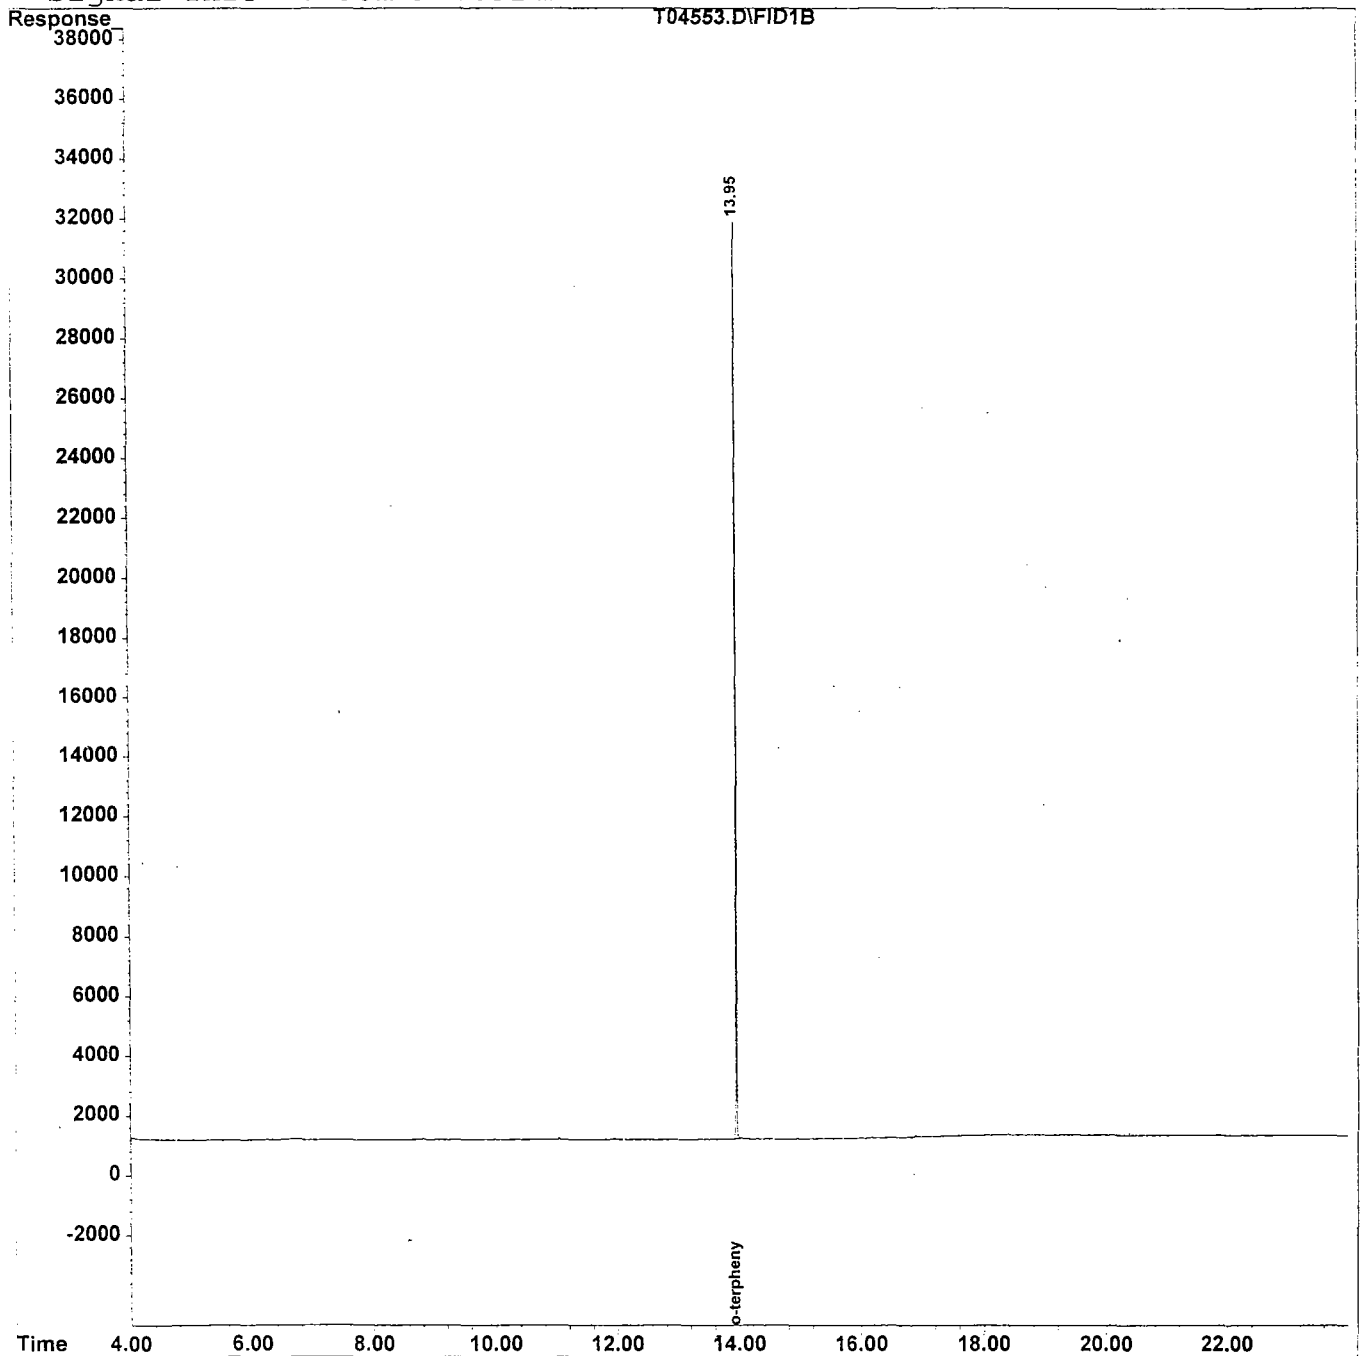

Quantitation Report (QT Reviewed)

Data File : C:\HPCHEM\1\DATA\980312\T04554.D
 Acq On : 12 Mar 98 4:55 pm
 Sample : 3395.05
 Misc :
 IntFile : TPHCINT.E
 Quant Time: Mar 16 16:39 1998

Vial: 21
 Operator: DEINHARDT
 Inst : FID/TCD
 Multiplr: 1.00

Quant Results File: TPH25.RES

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
 Title : TPHC Calibration 06/05/97 21 peaks
 Last Update : Fri Mar 13 07:39:31 1998
 Response via : Initial Calibration
 DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
 Signal Phase : HP-5
 Signal Info : 30m x 0.32mm

Compound	R.T.	Response	Conc	Units
----------	------	----------	------	-------

System Monitoring Compounds

21) sC o-terphenyl	13.95	297686	9.580	mg/L
Spiked Amount 10.000	Range 8 - 13	Recovery =	95.80%#	

Target Compounds

1) tC C8	0.00	0	N.D.	mg/L
2) tC C10	0.00	0	N.D.	mg/L
3) TC C12	0.00	0	N.D.	mg/L
4) tC C14	0.00	0	N.D.	mg/L
5) tC C16	0.00	0	N.D.	mg/L
6) tC C18	0.00	0	N.D.	mg/L
7) tC C20	0.00	0	N.D.	mg/L
8) tC C22	0.00	0	N.D.	mg/L
9) tC C24	0.00	0	N.D.	mg/L
10) tC C26	0.00	0	N.D.	mg/L
11) tC C28	0.00	0	N.D.	mg/L
12) tC C30	0.00	0	N.D.	mg/L
13) tC C32	0.00	0	N.D.	mg/L
14) tC C34	0.00	0	N.D.	mg/L
15) tC C36	0.00	0	N.D.	mg/L
16) tC C38	0.00	0	N.D.	mg/L
17) tC C40	0.00	0	N.D.	mg/L
18) tC c42	0.00	0	N.D.	mg/L
19) TC Pristane	0.00	0	N.D.	mg/L
20) TC Phytane	0.00	0	N.D.	mg/L
22) tC TPHC - total	0.00	0	N.D.	mg/L d

Quantitation Report


Data File : C:\HPCHEM\1\DATA\980312\T04554.D
Acq On : 12 Mar 98 4:55 pm
Sample : 3395.05
Misc :
IntFile : TPHCINT.E
Quant Time: Mar 16 16:39 1998

Vial: 21
Operator: DEINHARDT
Inst : FID/TCD
Multiplr: 1.00

Quant Results File: TPH25.RES

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
Title : TPHC Calibration 06/05/97 21 peaks
Last Update : Fri Mar 13 07:39:31 1998
Response via : Multiple Level Calibration
DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
Signal Phase : HP-5
Signal Info : 30m x 0.32mm

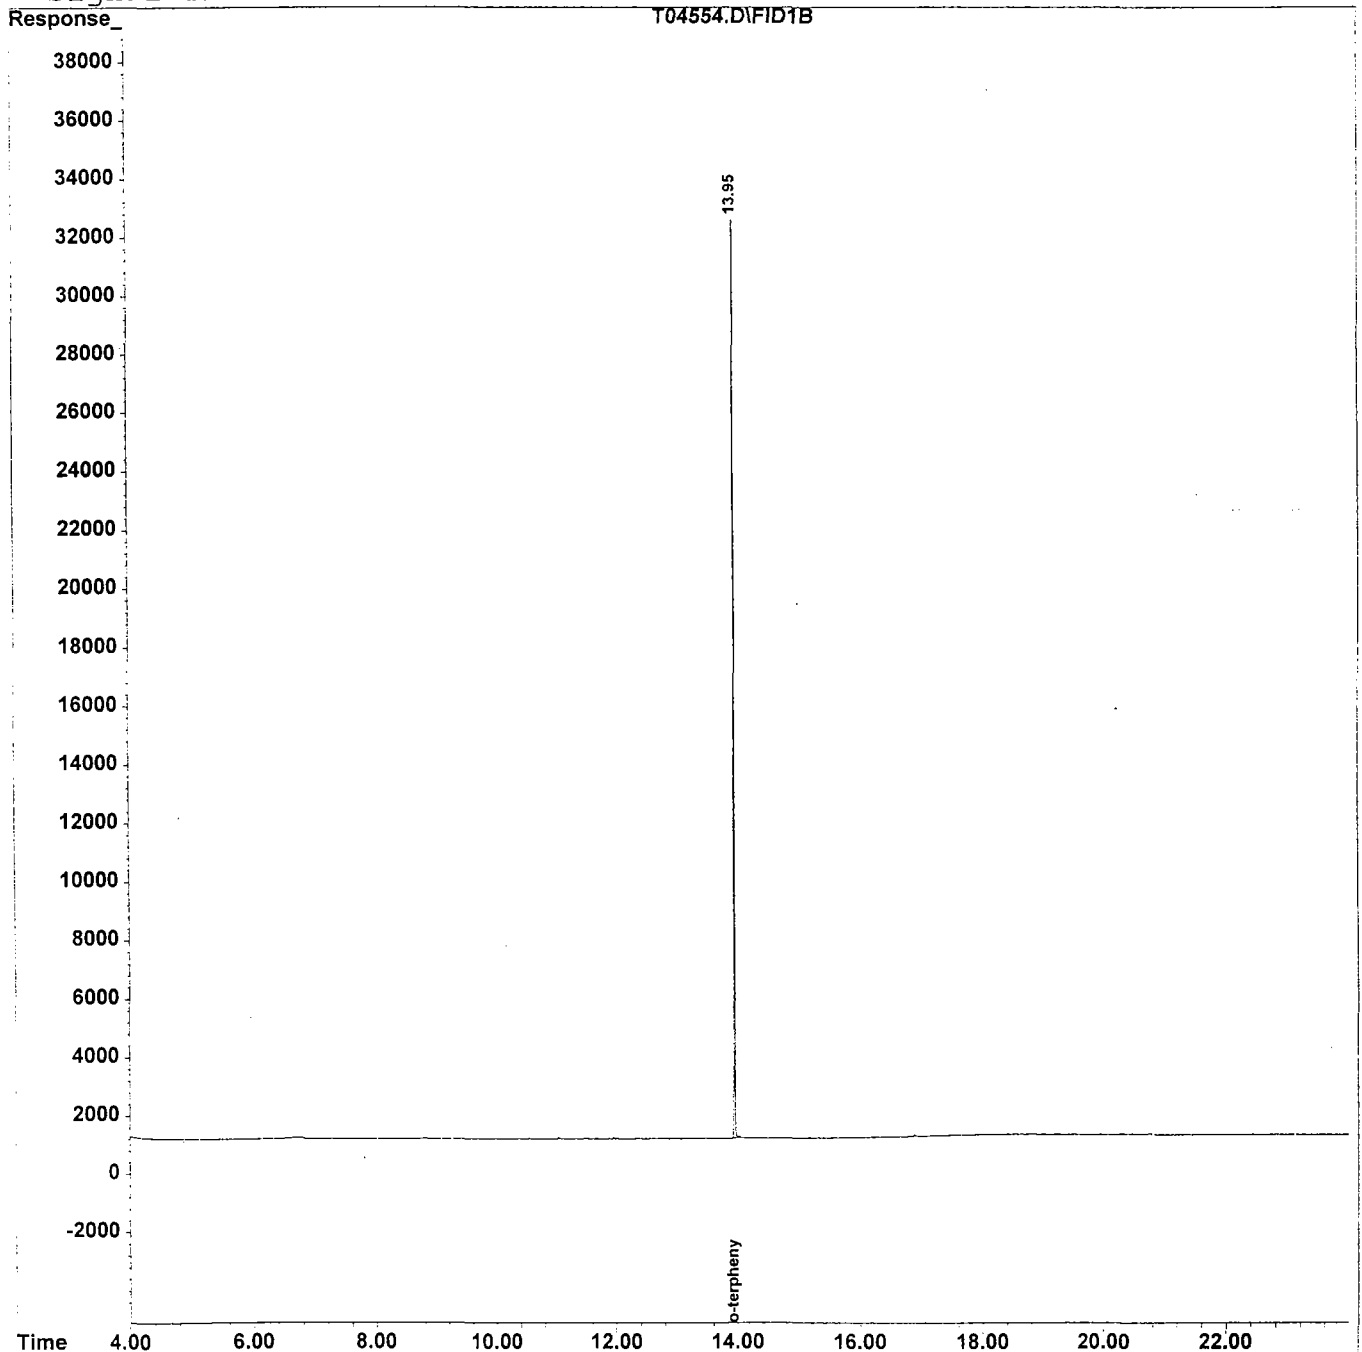

Data File : C:\HPCHEM\1\DATA\980312\T04555.D
 Acq On : 12 Mar 98 5:33 pm
 Sample : 3395.06
 Misc :
 IntFile : TPHCINT.E
 Quant Time: Mar 16 16:39 1998

Vial: 22
 Operator: DEINHARDT
 Inst : FID/TCD
 Multiplr: 1.00

Quant Results File: TPH25.RES

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
 Title : TPHC Calibration 06/05/97 21 peaks
 Last Update : Fri Mar 13 07:39:31 1998
 Response via : Initial Calibration
 DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
 Signal Phase : HP-5
 Signal Info : 30m x 0.32mm

Compound	R.T.	Response	Conc Units
System Monitoring Compounds			
21) sC o-terphenyl	13.95	290186	9.339 mg/L
Spiked Amount 10.000	Range 8 - 13	Recovery =	93.39%#

Target Compounds			
1) tC C8	0.00	0	N.D. mg/L
2) tC C10	0.00	0	N.D. mg/L
3) TC C12	0.00	0	N.D. mg/L
4) tC C14	0.00	0	N.D. mg/L
5) tC C16	0.00	0	N.D. mg/L
6) tC C18	0.00	0	N.D. mg/L
7) tC C20	0.00	0	N.D. mg/L d
8) tC C22	0.00	0	N.D. mg/L
9) tC C24	0.00	0	N.D. mg/L
10) tC C26	0.00	0	N.D. mg/L
11) tC C28	0.00	0	N.D. mg/L
12) tC C30	0.00	0	N.D. mg/L
13) tC C32	0.00	0	N.D. mg/L
14) tC C34	0.00	0	N.D. mg/L
15) tC C36	0.00	0	N.D. mg/L
16) tC C38	0.00	0	N.D. mg/L
17) tC C40	0.00	0	N.D. mg/L
18) tC c42	0.00	0	N.D. mg/L
19) TC Pristane	0.00	0	N.D. mg/L
20) TC Phytane	0.00	0	N.D. mg/L d
22) tC TPHC - total	0.00	0	N.D. mg/L

Quantitation Report


Data File : C:\HPCHEM\1\DATA\980312\T04555.D
Acq On : 12 Mar 98 5:33 pm
Sample : 3395.06
Misc :
IntFile : TPHCINT.E
Quant Time: Mar 16 16:39 1998

Vial: 22
Operator: DEINHARDT
Inst : FID/TCD
Multiplr: 1.00

Quant Results File: TPH25.RES

Quant Method : C:\HPCHEM\1\METHODS\TPH25.M (Chemstation Integrator)
Title : TPHC Calibration 06/05/97 21 peaks
Last Update : Fri Mar 13 07:39:31 1998
Response via : Multiple Level Calibration
DataAcq Meth : TPH25.M

Volume Inj. : 1 ul
Signal Phase : HP-5
Signal Info : 30m x 0.32mm

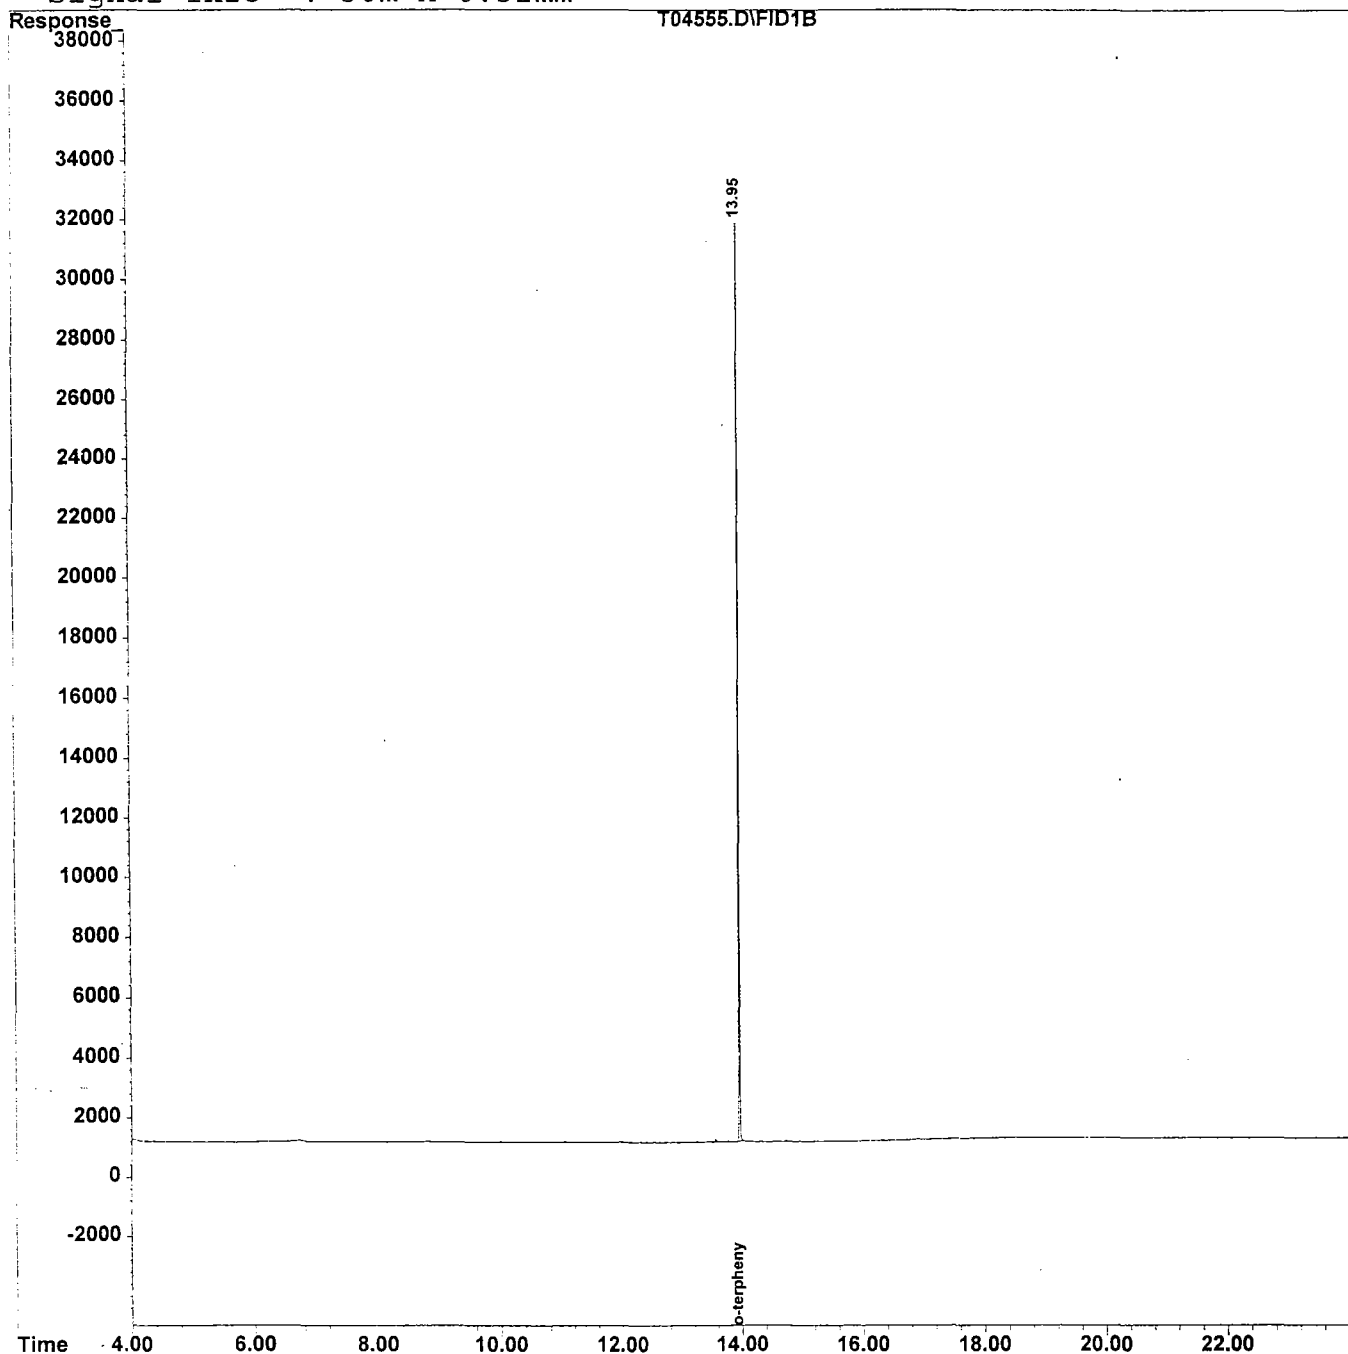

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
- 2. Table of Contents submitted
- 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
- 4. Document paginated and legible
- 5. Chain of Custody submitted
- 6. Samples submitted to lab within 48 hours of sample collection
- 7. Methodology Summary submitted
- 8. Laboratory Chronicle and Holding Time Check submitted
- 9. Results submitted on a dry weight basis
- 10. Method Detection Limits submitted
- 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

Laboratory Manager or Environmental Consultant's Signature


Date 3/27/94



Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance

APPENDIX F
PHOTOGRAPHS

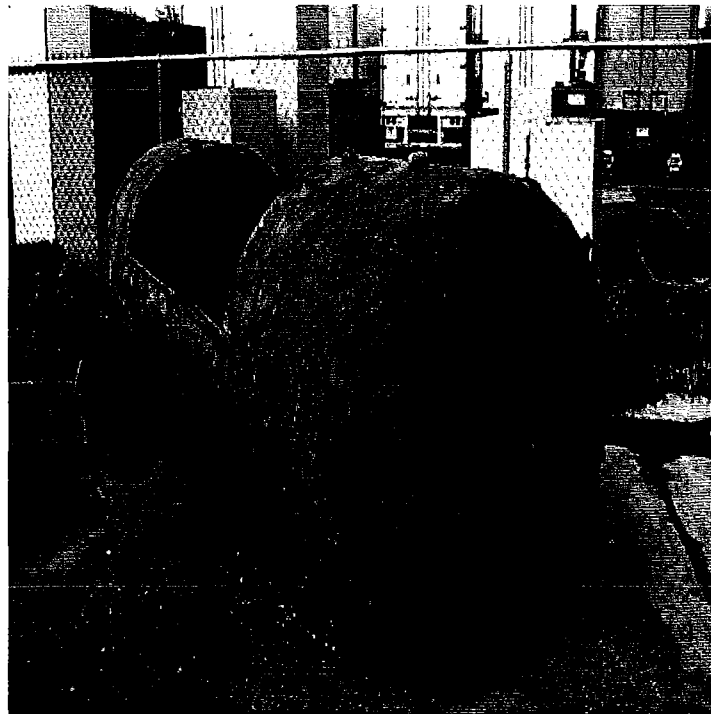

March 9, 1998

PHOTOGRAPHIC LOG

UST NO. 81533-231

**Building 907
Main Post-West
Fort Monmouth**



**SMC ENVIRONMENTAL
SERVICES GROUP**
Engineers, Managers, Scientists & Planners
VALLEY FORGE, PA.