

United States Army
Fort Monmouth, New Jersey

**Underground Storage Tank
Closure and Site Investigation
Report**

***Building 915
Main Post-West Area***

NJDEP UST Registration No. 81533-153

February 2000

**UNDERGROUND STORAGE TANK
CLOSURE AND SITE INVESTIGATION REPORT**

BUILDING 915

**MAIN POST-WEST AREA
NJDEP UST REGISTRATION NO. 81533-153**

FEBRUARY 2000

PREPARED FOR:

**UNITED STATES ARMY, FORT MONMOUTH, NEW JERSEY
DIRECTORATE OF PUBLIC WORKS
BUILDING 167
FORT MONMOUTH, NJ 07703**

PREPARED BY:

**VERSAR
1900 FROST ROAD
SUITE 110
BRISTOL, PA 19007**

PROJECT NO. 4435-018

915.DOC

TABLE OF CONTENTS

EXECUTIVE SUMMARY	iv
1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES	1
1.1 OVERVIEW	1
1.2 SITE DESCRIPTION	2
1.2.1 Geological/Hydrogeological Setting	2
1.3 HEALTH AND SAFETY	4
1.4 REMOVAL OF UNDERGROUND STORAGE TANK	4
1.4.1 General Procedures	4
1.4.2 Underground Storage Tank Excavation and Cleaning	4
1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL	5
1.6 MANAGEMENT OF EXCAVATED SOILS	5
2.0 SITE INVESTIGATION ACTIVITIES	6
2.1 OVERVIEW	6
2.2 FIELD SCREENING/MONITORING	6
2.3 SOIL SAMPLING	7
2.4 GROUNDWATER SAMPLING	7
3.0 CONCLUSIONS AND RECOMMENDATIONS	8
3.1 SOIL SAMPLING RESULTS	8
3.2 GROUNDWATER SAMPLING RESULTS	8
3.3 CONCLUSIONS AND RECOMMENDATIONS	9

TABLE OF CONTENTS (CONTINUED)

TABLES

Table 1	Summary of Post-Excavation Sampling Activities
Table 2	Post-Excavation Soil Sampling Results
Table 3	Groundwater Sampling Results

FIGURES

Figure 1	Site Location Map
Figure 1A	Geological Map
Figure 2	Site Map
Figure 3	Cross Sectional View
Figure 4	Soil Sampling Location Map
Figure 5	Groundwater Sampling Location Map

APPENDICES

Appendix A	NJDEP Standard Reporting Form
Appendix B	Site Assessment Summary
Appendix C	Waste Manifest
Appendix D	UST Disposal Certificate
Appendix E	Soil Analytical Data Package
Appendix F	Groundwater Analytical Data Package
Appendix G	Photographs
Appendix H	Electronic Data Deliverables

EXECUTIVE SUMMARY

UST Closure

On March 23, 1998, a steel underground storage tank (UST) was closed by removal in accordance with New Jersey Department of Environmental Protection (NJDEP) closure procedures at the Main Post-West area of the U.S. Army Fort Monmouth, Fort Monmouth, New Jersey. The UST, NJDEP Registration No. 0081533-153 (Fort Monmouth ID No. 915), was located southeast of Building 915. UST No. 0081533-153 was a 1,080-gallon #2 fuel oil UST.

Site Assessment

The site assessment was performed by U.S. Army personnel in accordance with the NJDEP *Technical Requirements for Site Remediation* (N.J.A.C. 7:26E) and the NJDEP *Field Sampling Procedures Manual*. The sampling and laboratory analysis conducted during the site assessment were performed in accordance with Section 7:26E-2.1 of the *Technical Requirements for Site Remediation*. Soils surrounding the tank were screened visually and with air monitoring equipment for evidence of contamination. Following removal, the UST was inspected for corrosion holes. No holes or punctures were noted in the UST. On May 17, 1999, potentially contaminated soil was removed from the excavation area. In total, approximately 3 cubic yards of potentially contaminated soil were removed from the excavated area and stored at the Fort Monmouth petroleum contaminated soil staging area. Soil samples that were collected after the removal of the potentially contaminated soil contained non-detectable levels of TPHC. Groundwater was encountered at 4.5 feet below ground surface and no sheen was observed on groundwater.

All post excavation soil samples collected from the UST excavation at Building 915 contained TPHC concentrations below the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 milligrams per kilogram (mg/kg) (N.J.A.C. 7:26D and revisions dated February 3, 1994). Following receipt of all post-excavation soil sampling results, the excavation was backfilled to grade with a combination of uncontaminated excavated soil and certified clean fill. The excavation site was then restored to its original condition.

In response to the observation of potentially contaminated soil near the water table, two (2) groundwater samples were collected at Building 915. On December 3, 1999, and January 8, 2000, Building 915 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). All groundwater analytical results were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 81533-153 at Building 915.

1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES

1.1 OVERVIEW

One underground storage tank (UST), New Jersey Department of Environmental Protection (NJDEP) Registration No. 81533-153, was closed at Building 915 at the Main Post-West area of U.S. Army Fort Monmouth, Fort Monmouth, New Jersey on March 23, 1998. Refer to the site location map on Figure 1. This report presents the results of the Department of Public Works' (DPW) implementation of the UST Decommissioning/Closure Plan approved by the NJDEP. The UST was a steel 1,080-gallon tank containing No. 2 fuel oil.

Decommissioning activities for UST No. 81533-153 complied with all applicable Federal, State, and Local laws and ordinances in effect at the date of decommissioning. These laws included but were not limited to N.J.A.C. 7:14B-1 et seq., N.J.A.C. 5:23-1 et seq., and Occupational Safety and Health Administration (OSHA) 1910.146 & 1910.120. All permits including but not limited to the NJDEP approved Decommissioning/Closure Plan were posted onsite for inspection. The decommissioning activities were conducted by DPW personnel who are registered and certified by the NJDEP for performing UST closure activities. Closure of UST No. 81533-153 proceeded under the approval of the NJDEP Bureau of Federal Case Management (NJDEP-BFCM). The Standard Reporting Form and signed Site Assessment Summary form for UST No. 81533-153 are included in Appendices A and B, respectively.

After removal of the potentially contaminated soil, the site was assessed. Based on inspecting the UST, field screening of remaining subsurface soils, and reviewing analytical results of soil samples and groundwater samples, the DPW has concluded that no significant historical discharges are associated with the UST or associated piping.

This UST Closure and Site Investigation Report has been prepared by Versar, to assist the U.S. Army DPW in complying with the NJDEP regulations. The applicable NJDEP regulations at the date of closure were the *Interim Closure Requirements for Underground Storage Tank Systems* (N.J.A.C. 7:14B-1 et seq. October 1990 and revisions dated November 1, 1991).

This report was prepared using information collected at the time of closure. Section 1 of this UST Closure and Site Investigation Report provides a summary of the UST decommissioning activities. Section 2 of this report describes the site investigation activities. Conclusions and recommendations, including the results of the soil sampling and groundwater investigation, are presented in the final section of this report.

1.2 SITE DESCRIPTION

Building 915 is located in the Main Post-West area of the Fort Monmouth Army Base. UST No. 0081533-153 was located southeast of Building 915 and appurtenant copper piping ran approximately seven (7) feet northeast from the excavation to Building 915. A site map is provided on Figure 2.

1.2.1 Geological/Hydrogeological Setting

The following is a description of the geological/hydrogeological setting of the area surrounding Building 915. Included is a description of the regional geology of the area surrounding Fort Monmouth as well as descriptions of the local geology and hydrogeology of the Main Post area. A geological map is provided on Figure 1A.

Regional Geology

Monmouth County lies within the New Jersey Section of the Atlantic Coastal Plain physiographic province. The Main Post, Charles Wood, and the Evans areas are located in what may be referred to as the Outer Coastal Plain subprovince, or the Outer Lowlands.

In general, New Jersey Coastal Plain formations consist of a seaward-dipping wedge of unconsolidated deposits of clay, silt, and gravel. These formations typically strike northeast-southwest with a dip ranging from 10 to 60 feet per mile and were deposited on Precambrian and lower Paleozoic rocks (Zapeczka, 1989). These sediments, predominantly derived from deltaic, shallow marine, and continental shelf environments, date from Cretaceous through the Quaternary Periods. The mineralogy ranges from quartz to glauconite.

The formations record several major transgressive/regressive cycles and contain units which are generally thicker to the southeast and reflect a deeper water environment. More than 20 regional geologic units are present within the sediments of the Coastal Plain. Regressive, upward coarsening deposits are usually aquifers (e.g., Englishtown and Kirkwood Formations, and the Cohansey Sand) while the transgressive deposits act as confining units (e.g., the Merchantville, Marshalltown, and Navesink Formations). The individual thicknesses for these units vary greatly (i.e., from several feet to several hundred feet). The Coastal Plain deposits thicken to the southeast from the Fall Line to greater than 6,500 feet in Cape May County (Brown and Zapeczka, 1990).

Local Geology

Based on the regional geologic map (Jablonski, 1968), the Cretaceous age Red Bank and Tinton Sands outcrop at the Main Post area. The Red Bank sand conformably overlies the Navesink Formation and dips to the southeast at 35 feet per mile. The upper member (Shrewsbury) of the Red Bank sand is a yellowish-gray to reddish brown clayey, medium-to-coarse-grained sand that contains abundant rock fragments, minor mica and glauconite (Jablonski). The lower member (Sandy Hook) is a dark gray to black, medium-to-fine grained sand with abundant clay, mica, and glauconite.

The Tinton sand conformably overlies the Red Bank Sand and ranges from a clayey medium to very coarse grained feldspathic quartz and glauconite sand to a glauconitic coarse sand. The color varies from dark yellowish orange or light brown to moderate brown and from light olive to grayish olive. Glauconite may constitute 60 to 80 percent of the sand fraction in the upper part of the unit (Minard, 1969). The upper part of the Tinton is often highly oxidized and iron oxide encrusted (Minard).

Hydrogeology

The water table aquifer in the Main Post area is identified as part of the "composite confining units," or minor aquifers. The minor aquifers include the Navesink formation, Red Bank Sand, Tinton Sand, Hornerstown Sand, Vincentown Formation, Manasquan Formation, Shark River Formation, Piney Point Formation, and the basal clay of the Kirkwood Formation.

Based on records of wells drilled in the Main Post area, water is typically encountered at depths of 2 to 9 feet below ground surface (bgs). According to Jablonski, wells drilled in the Red Bank and Tinton Sands may produce 2 to 25 gallons per minute (gpm). Some well owners have reported acidic water that requires treatment to remove iron.

Due to the proximity of the Atlantic Ocean to Fort Monmouth, shallow groundwater may be tidally influenced and may flow toward creeks and brooks as the tide goes out, and away from creeks and brooks as the tide comes in. However, an abundance of clay lenses and sand deposits were noted in borings installed throughout Fort Monmouth. Therefore, the direction of shallow groundwater should be determined on a case-by-case basis.

Shallow groundwater is locally influenced within the Main Post area by the following factors:

- tidal influence (based on proximity to the Atlantic Ocean, rivers, and tributaries)
- topography
- nature of the fill material within the Main Post area
- presence of clay and silt lenses in the natural overburden deposits
- local groundwater recharge areas (i.e., streams, lakes)

Due to the fluvial nature of the overburden deposits (i.e., sand and clay lenses), shallow groundwater flow direction is best determined on a case-by-case basis. This is consistent with lithologies observed in borings installed within the Main Post area, which primarily consisted of fine-to-medium grained sands, with occasional lenses or laminations of gravel silt and/or clay.

Building 915 is located approximately 600 feet south of Husky Brook, the nearest water body. Based on the Main Post topography, the groundwater flow in the area of Building 915 is anticipated to be to the north.

1.3 HEALTH AND SAFETY

Before, during, and after all decommissioning activities, hazards at the work site which may have posed a threat to the Health and Safety of all personnel who were involved with, or were affected by, the decommissioning of the UST system were minimized. All areas, which posed, or may have been suspected to pose a vapor hazard were monitored by a qualified individual utilizing an organic vapor analyzer (OVA). The individual ascertained if the area was properly vented to render the area safe, as defined by OSHA.

1.4 REMOVAL OF UNDERGROUND STORAGE TANK

1.4.1 General Procedures

- The contractor performing the closure prior to excavation activities identified all underground obstructions (utilities, etc.).
- All activities were carried out with the greatest regard to safety and health and the safeguarding of the environment.
- All excavated soils were visually examined and screened with an OVA for evidence of contamination. Potentially contaminated soils were identified and logged during closure activities.
- Surface materials (i.e., asphalt, concrete, etc.) were excavated and staged separately from all soil and recycled in accordance with all applicable regulations and laws.
- A Sub-Surface Evaluator from the DPW was present during all site assessment activities.

1.4.2 Underground Storage Tank Excavation and Cleaning

Prior to UST decommissioning activities, surficial soil was removed to expose the UST and associated piping. All free product present in the piping was drained into the UST, and the UST was purged to remove vapors prior to cutting and removal of the piping. After removal of the associated piping, a manway was made in the UST to allow for proper cleaning. The UST was completely emptied of all liquids prior to removal from the ground. Approximately 35 gallons of liquid from the UST and its associated piping were pumped directly into a Lionetti Oil Recovery truck where it was then transported to Lionetti Oil Recovery Co., Inc. facility, a NJDEP-approved petroleum recycling and disposal company located in Old Bridge, NJ. Refer to Appendix C for a copy of the waste manifest.

The UST was cleaned prior to removal from the excavation in accordance with the NJDEP regulations. After the UST was removed from the excavation, it was staged on polyethylene sheeting and examined for holes. No holes or punctures were noted in the UST during the inspection by the Sub-Surface Evaluator. On May 17, 1999, potentially contaminated soil was removed from the excavation area. In total, approximately 3 cubic yards of potentially contaminated soil were removed from the excavated area and stored at the Fort Monmouth petroleum contaminated soil staging area. Soil samples that were collected after the removal of the potentially contaminated soil contained non-detectable levels of TPHC. Groundwater was encountered at 4.5 feet below ground surface and no sheen was observed on groundwater. See Figure 3 for a cross-sectional view of the excavated area.

1.5 UNDERGROUND STORAGE TANK TRANSPORTATION AND DISPOSAL

The tank was transported in compliance with all applicable regulations and laws to Mazza and Sons, Inc. Please refer to Appendix D for the UST Disposal Certificate and Appendix G for photographs of the tank.

The UST was labeled prior to transport with the following information:

- Site of origin
- Contact person
- NJDEP UST Facility ID number
- Former contents
- Destination site
- Date

1.6 MANAGEMENT OF EXCAVATED SOILS

Based on OVA air monitoring and TPHC analysis results from the post-excavation soil samples, approximately 3 cubic yards of potentially contaminated soil were removed from the UST excavation. All potentially contaminated soils were stockpiled separately from other excavated material and were placed on and covered with polyethylene sheets. Potentially contaminated soils were transported to the soil staging area. Soils that did not exhibit signs of contamination were used as backfill following the removal of the UST. Groundwater was encountered at 4.5 feet below ground surface and no sheen was observed on groundwater.

2.0 SITE INVESTIGATION ACTIVITIES

2.1 OVERVIEW

The Site Investigation was managed and carried out by U.S. Army DPW personnel. All analyses were performed and reported by U.S. Army Fort Monmouth Environmental Laboratory, a NJDEP-certified testing laboratory. All sampling was performed under the direct supervision of a NJDEP Certified Sub-Surface Evaluator according to the methods described in the NJDEP *Field Sampling Procedures Manual* (1992). Sampling frequency and parameters analyzed complied with the NJDEP document *Interim Closure Requirements for Underground Storage Tank Systems* (October 1990 and revisions dated November 1, 1991) which was the applicable regulation at the date of the closure. The Fort Monmouth DPW Environmental Office maintains all records of the Site Investigation activities.

The following Parties participated in Closure and Site Investigation Activities:

- Project Manager: Charles Appleby
Employer: U.S. Army, Fort Monmouth
Phone Number: (730) 532-6224
NJDEP Certification No.: 2056
- Analytical Laboratory: U.S. Army Fort Monmouth Environmental laboratory
Contact Person: Daniel K. Wright
Phone Number: (908) 532-4359
NJDEP Company Certification No.: 13461
- Hazardous Waste Hauler: L & L Oil Service
Contact Person: Anibal Vazquez
Phone Number: (732) 721-0900
NJDEP Company Certification No.: P56601

2.2 FIELD SCREENING/MONITORING

Field screening was performed by a NJDEP Certified Sub-Surface Evaluator using an OVA and visual observations to identify potentially contaminated material. Approximately 3 cubic yards of potentially petroleum contaminated soil were removed from the excavated area and transported to the Fort Monmouth petroleum contaminated soil holding area. Soils were removed from the excavation until no evidence of contamination remained. Groundwater was encountered at 4.5 feet below ground surface and no sheen was observed on groundwater.

2.3 SOIL SAMPLING

On March 24, 1998, following the removal of the UST and associated piping, post-excavation soil samples A, B, C, D, E, F, and DUP A were collected from a total of six (6) locations of the UST excavation. Excavation floor samples A and DUP A were collected at a depth of 5.5 feet bgs. Sidewall samples B, C, D, and E were collected at a depth of 3.5 feet bgs. Piping sample F was collected at a depth of 1.0 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

On May 17, 1999, following the removal of potentially contaminated soil from the piping area, post-excavation soil sample P and DUP P were collected at a depth of 2.0 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

U.S. Army personnel in accordance with the NJDEP Technical Requirements and the NJDEP Field Sampling Procedures Manual performed the site assessment. A summary of sampling activities including parameters analyzed is provided in Table 1. The post-excavation soil samples were collected using NJDEP *Field Sampling Procedures Manual* (1992) standard sampling procedures. Following soil sampling activities, the samples were chilled and delivered to U.S. Army Fort Monmouth Environmental Laboratory located in Fort Monmouth, New Jersey, for analysis.

2.4 GROUNDWATER SAMPLING

On December 3, 1999, and January 8, 2000, Building 915 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). Sampling and analysis were performed in accordance with the NJDEP *Field Sampling Procedures Manual* and the *Technical Requirements For Site Remediation*. Refer to Appendix F for the field sampling documentation.

3.0 CONCLUSIONS AND RECOMMENDATIONS

3.1 SOIL SAMPLING RESULTS

To evaluate soil conditions following removal of the UST and associated piping, post-excavation soil samples were collected on March 24, 1998, and May 17, 1999 from a total of seven (7) locations. All samples were analyzed for TPHC and total solids. The post-excavation sampling results were compared to the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 mg/kg (N.J.A.C. 7:26D and revisions dated February 3, 1994). A summary of the analytical results and comparison to the NJDEP soil cleanup criteria is provided in Table 2 and the soil sampling locations are shown on Figure 4. The analytical data package is provided in Appendix E.

All post-excavation soil samples collected on March 24, 1998, and May 17, 1999, from the UST excavation and from below piping associated with the UST contained concentrations of TPHC below the NJDEP soil cleanup criteria. Soil samples, which were collected after the removal of the potentially contaminated soil, contained non-detectable levels of TPHC

3.2 GROUNDWATER SAMPLING RESULTS

The sample collected from Building 915 on December 3, 1999, contained acetone at 13.52 ug/l and 2-butanone at 5.74 ug/l. No other compounds were detected.

No compounds were detected in the sample collected from Building 915 on January 8, 2000.

A summary of the analytical results and comparison to the NJDEP groundwater cleanup criteria is provided in Table 3 and the groundwater sampling locations are shown on Figure 5. The analytical data package is provided in Appendix F. The full data package, including quality control, is on file at U.S. Army Fort Monmouth, Fort Monmouth, New Jersey.

Groundwater samples collected on December 3, 1999, and January 8, 2000, were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

3.3 CONCLUSIONS AND RECOMMENDATIONS

The analytical results for all post-excavation soil samples collected from the UST closure excavation at Building 915 were below the NJDEP soil cleanup criteria for total organic contaminants.

Based on the post-excavation sampling results, soil with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST or associated piping.

Based on the analytical results of the groundwater samples collected at Building 915 on December 3, 1999, and January 8, 2000, groundwater quality at Building 915 was either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 81533-153 at Building 915.

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
 BUILDING 915, MAIN POST-WEST AREA
 FORT MONMOUTH, NEW JERSEY

Page 1 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
A	3/24/98	3/25/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
B	3/24/98	3/25/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
C	3/24/98	3/25/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
D	3/24/98	3/25/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
E	3/24/98	3/25/98	Soil	Post-Excavation	TPHC	OQA-QAM-025
**F	3/24/98	3/25/98	Soil	Post-excavation	TPHC	OQA-QAM-025
DUP A	3/24/98	3/25/98	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

** Sample further remediated and resampled

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES
 BUILDING 915, MAIN POST-WEST AREA
 FORT MONMOUTH, NEW JERSEY

Page 2 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
P	5/17/99	5/19/99	Soil	Post-Excavation	TPHC	OQA-QAM-025
DUP P	5/17/99	5/19/99	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

* TPHC Total Petroleum Hydrocarbons

TABLE 1

SUMMARY OF SAMPLING ACTIVITIES
BUILDING 915, MAIN POST-WEST AREA
FORT MONMOUTH, NEW JERSEY

Page 3 of 3

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	Sampling Method**
4976.01	12/3/99	12/6/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
5082.01	1/8/00	1/10/00	Aqueous	Groundwater	VOCs, SVOCs	PPNDP

Note:

- *VOCs: Volatile Organic Compounds plus 15 tentatively identified compounds
*SVOCs: Semivolatile organic compounds plus 15 tentatively identified compounds
**PPNDP: Passively Placed Narrow Diameter Point

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 915, MAIN POST-WEST AREA
 FORT MONMOUTH, NEW JERSEY

Page 1 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
A/5.5'	3427.01	3/24/98	3/25/98	Total Solid	--	--	83.42 %	--	--
				TPHC	184	yes	ND	10,000	No
B/3.5'	3427.02	3/24/98	3/25/98	Total Solid	--	--	85.83 %	--	--
				TPHC	181	Yes	ND	10,000	No
C/3.5'	3427.03	3/24/98	3/25/98	Total Solid	--	--	89.08 %	--	--
				TPHC	174	Yes	ND	10,000	No
D/3.5'	3427.04	3/24/98	3/25/98	Total Solid	--	--	83.36 %	--	--
				TPHC	182	yes	ND	10,000	No
E/3.5'	3427.05	3/24/98	3/25/98	Total Solid	--	--	81.53 %	--	--
				TPHC	185	yes	ND	10,000	No
***F/1.0	3427.06	3/24/98	3/25/98	Total Solid	--	--	88.96 %	--	--
				TPHC	173	yes	2601.77	10,000	No
DUPA/5.5'	3427.07	3/24/98	3/25/98	Total Solid	--	--	87.85 %	--	--
				TPHC	172	yes	ND	10,000	No

Note:

- * Total Solid results are expressed as a percentage.
- ** NJDEP Residential Direct Contact soil cleanup criteria for total organics
- *** Sample further remediated and resampled
- ND Not detected above stated method detection limit
- TPHC Total Petroleum Hydrocarbons

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS
 BUILDING 915, MAIN POST-WEST AREA
 FORT MONMOUTH, NEW JERSEY

Page 2 of 2

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
P/2.0'	4489.01	5/17/99	5/19/99	Total Solid	--	--	90.51 %	--	--
				TPHC	171	yes	ND	10,000	No
DUP P/2.0'	4489.01	5/17/99	5/19/99	Total Solid	--	--	90.76 %	--	--
				TPHC	171	yes	ND	10,000	No

Note:

* Total Solid results are expressed as a percentage.

** NJDEP Residential Direct Contact soil cleanup criteria for total organics

ND Not detected above stated method detection limit

TPHC Total Petroleum Hydrocarbons

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/3/99 Location: 915 Lab Sample ID: 4976.01(Bldg 915)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	13.52 ug/L	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	5.74 ug/L	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/3/99 Location: 915 Lab Sample ID: 4976.01(Bldg 915)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 12/3/99Location: 915Lab Sample ID: 4976.01(Bldg 915)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	2.29	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	1.14	Not Detected	--	20	no
62-53-3	Aniline	2.04	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.60	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.49	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.28	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.41	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.74	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	1.88	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.21	Not Detected	--	10	no
78-59-1	Isophorone	1.26	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.51	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.53	Not Detected	--	9	no
91-20-3	Naphthalene	1.59	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.36	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.89	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.35	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.65	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.26	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.99	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.90	Not Detected	--	7000	no
208-96-8	Acenaphthylene	1.20	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 12/3/99 Location: 915 Lab Sample ID: 4976.01(Bldg 915)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	1.01	Not Detected	--	Nle	No
99-09-2	3-Nitroaniline	0.99	Not Detected	--	Nle	No
83-32-9	Acenaphthene	1.38	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.25	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	1.09	Not Detected	--	10	no
84-66-2	Diethylphthalate	2.03	Not Detected	--	5000	no
86-73-7	Fluorene	1.24	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.38	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.31	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.26	Not Detected	--	20	no
103-33-3	Azobenzene	0.84	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.95	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	1.18	Not Detected	--	10	no
85-01-8	Phenanthrene	1.54	Not Detected	--	nle	no
120-12-7	Anthracene	1.40	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	2.13	Not Detected	--	900	no
206-44-0	Fluoranthene	2.05	Not Detected	--	300	no
92-87-5	Benzidine	5.23	Not Detected	--	50	no
129-00-0	Pyrene	1.56	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.31	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.49	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	2.19	Not Detected	--	60	no
218-01-9	Chrysene	1.73	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	2.18	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.80	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.56	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.61	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.31	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	1.04	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.80	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	1.05	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 1/8/00 Location: 915 Lab Sample ID: 5082.01(Bldg 915)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER
 Date Sampled: 1/8/00 Location: 915 Lab Sample ID: 5082.01(Bldg 915)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,1,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 1/8/00Location: 915Lab Sample ID: 5082.01(Bldg 915)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 1/8/00Location: 915Lab Sample ID: 5082.01(Bldg 915)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

F 1
L 1
F 2
L 2
F 3
L 3
F 4
L 4
F 5
L 5
F 6
L 6
F 7
L 7
F 8
L 8
F 9
L 9
F 10
L 10
F 11
L 11
F 12
L 12
F 13
L 13
F 14
L 14
F 15
L 15
F 16
L 16
F 17
L 17
F 18
L 18
F 19
L 19
F 20
L 20
F 21
L 21
F 22
L 22
F 23
L 23
F 24
L 24
F 25
L 25
F 26
L 26
F 27
L 27
F 28
L 28
F 29
L 29
F 30
L 30
F 31
L 31
F 32
L 32
F 33
L 33
F 34
L 34
F 35
L 35
F 36
L 36
F 37
L 37
F 38
L 38
F 39
L 39
F 40
L 40
F 41
L 41
F 42
L 42
F 43
L 43
F 44
L 44
F 45
L 45
F 46
L 46
F 47
L 47
F 48
L 48
F 49
L 49
F 50
L 50
F 51
L 51
F 52
L 52
F 53
L 53
F 54
L 54
F 55
L 55
F 56
L 56
F 57
L 57
F 58
L 58
F 59
L 59
F 60
L 60
F 61
L 61
F 62
L 62
F 63
L 63
F 64
L 64
F 65
L 65
F 66
L 66
F 67
L 67
F 68
L 68
F 69
L 69
F 70
L 70
F 71
L 71
F 72
L 72
F 73
L 73
F 74
L 74
F 75
L 75
F 76
L 76
F 77
L 77
F 78
L 78
F 79
L 79
F 80
L 80
F 81
L 81
F 82
L 82
F 83
L 83
F 84
L 84
F 85
L 85
F 86
L 86
F 87
L 87
F 88
L 88
F 89
L 89
F 90
L 90
F 91
L 91
F 92
L 92
F 93
L 93
F 94
L 94
F 95
L 95
F 96
L 96
F 97
L 97
F 98
L 98
F 99
L 99
F 100
L 100

FIGURES

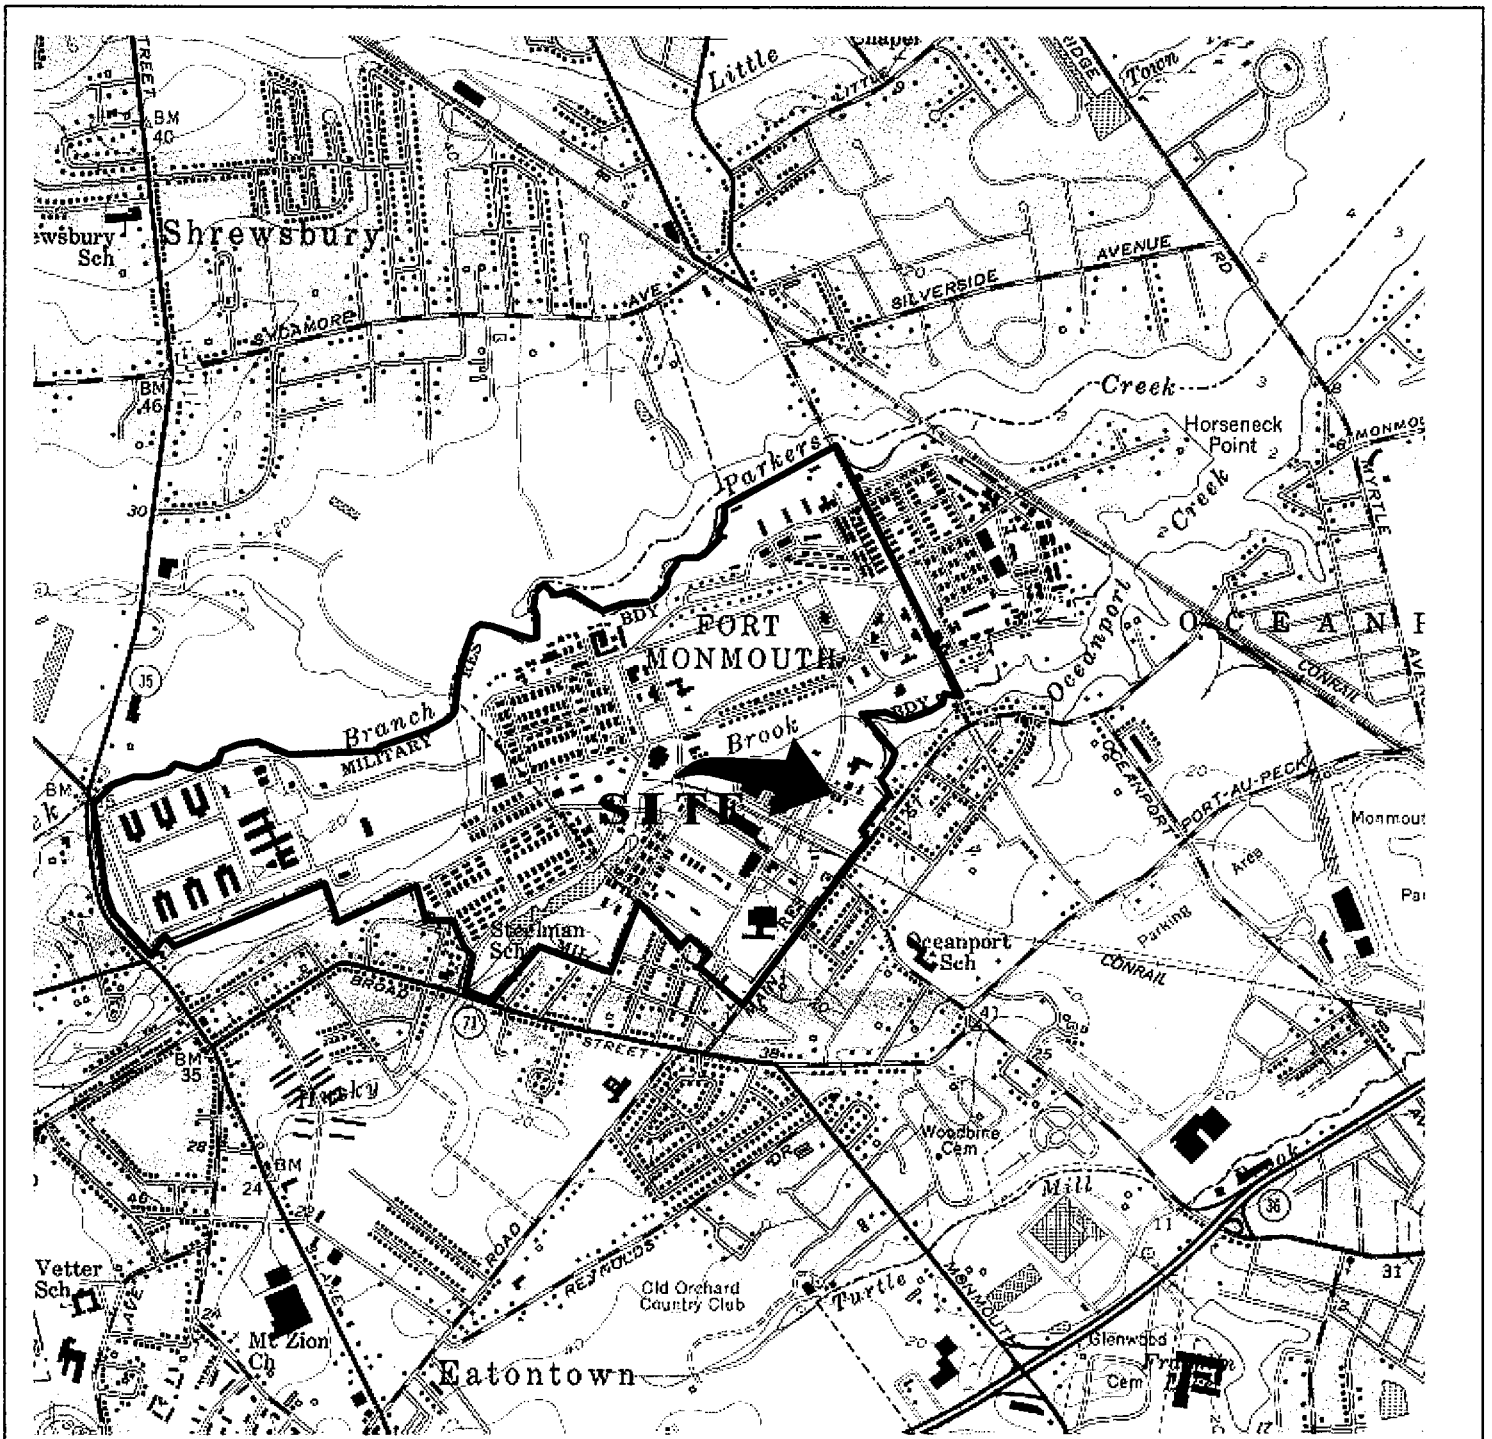


FIGURE 1

LOCATION MAP
 Building 915
 Main-Post West
 Fort Monmouth Army Base
 Monmouth County, NJ

VERSAR
 Engineers, Managers, Scientists, & Planners
 Bristol, PA

Scale: 1" = 2000'

Date: MARCH 1998

LONG BRANCH, N. J.

40073-C8-TF-024

1954

PHOTOREVISED 1981

DMA 6164 I SE-SERIES V822



NEW JERSEY
 QUADRANGLE LOCATION

Geologic Map of New Jersey

SEDIMENTARY ROCKS

CENOZOIC

- Holocene: sand
- ▨ Tertiary: sand, silt, clay

MESOZOIC

- ▨ Cretaceous: sand, silt, clay
- Jurassic: siltstone, shale, sandstone
- Triassic: siltstone, shale, sandstone

PALEOZOIC

- ▨ Devonian: conglomerate, sandstone,
- Silurian: conglomerate, sandstone, shale, limestone
- Ordovician: shale, limestone
- Cambrian: limestone, sandstone

IGNEOUS AND METAMORPHIC ROCKS

MESOZOIC

- Jurassic: basalt
- Jurassic: diabase

PRECAMBRIAN

- marble
- gneiss, granite

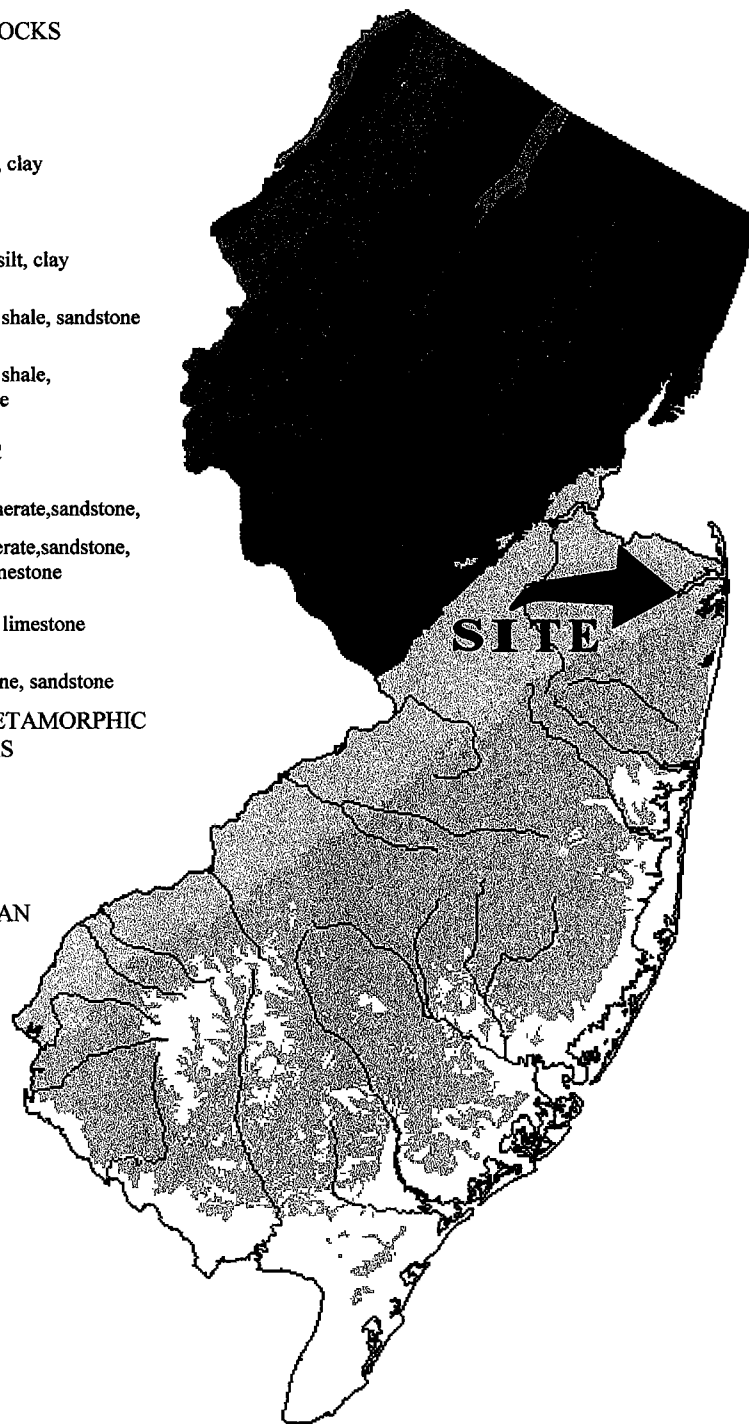


FIGURE 1A
GEOLOGICAL MAP
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
 Engineers, Managers, Scientists & Planners
 Bristol, Pennsylvania

915 FIG2

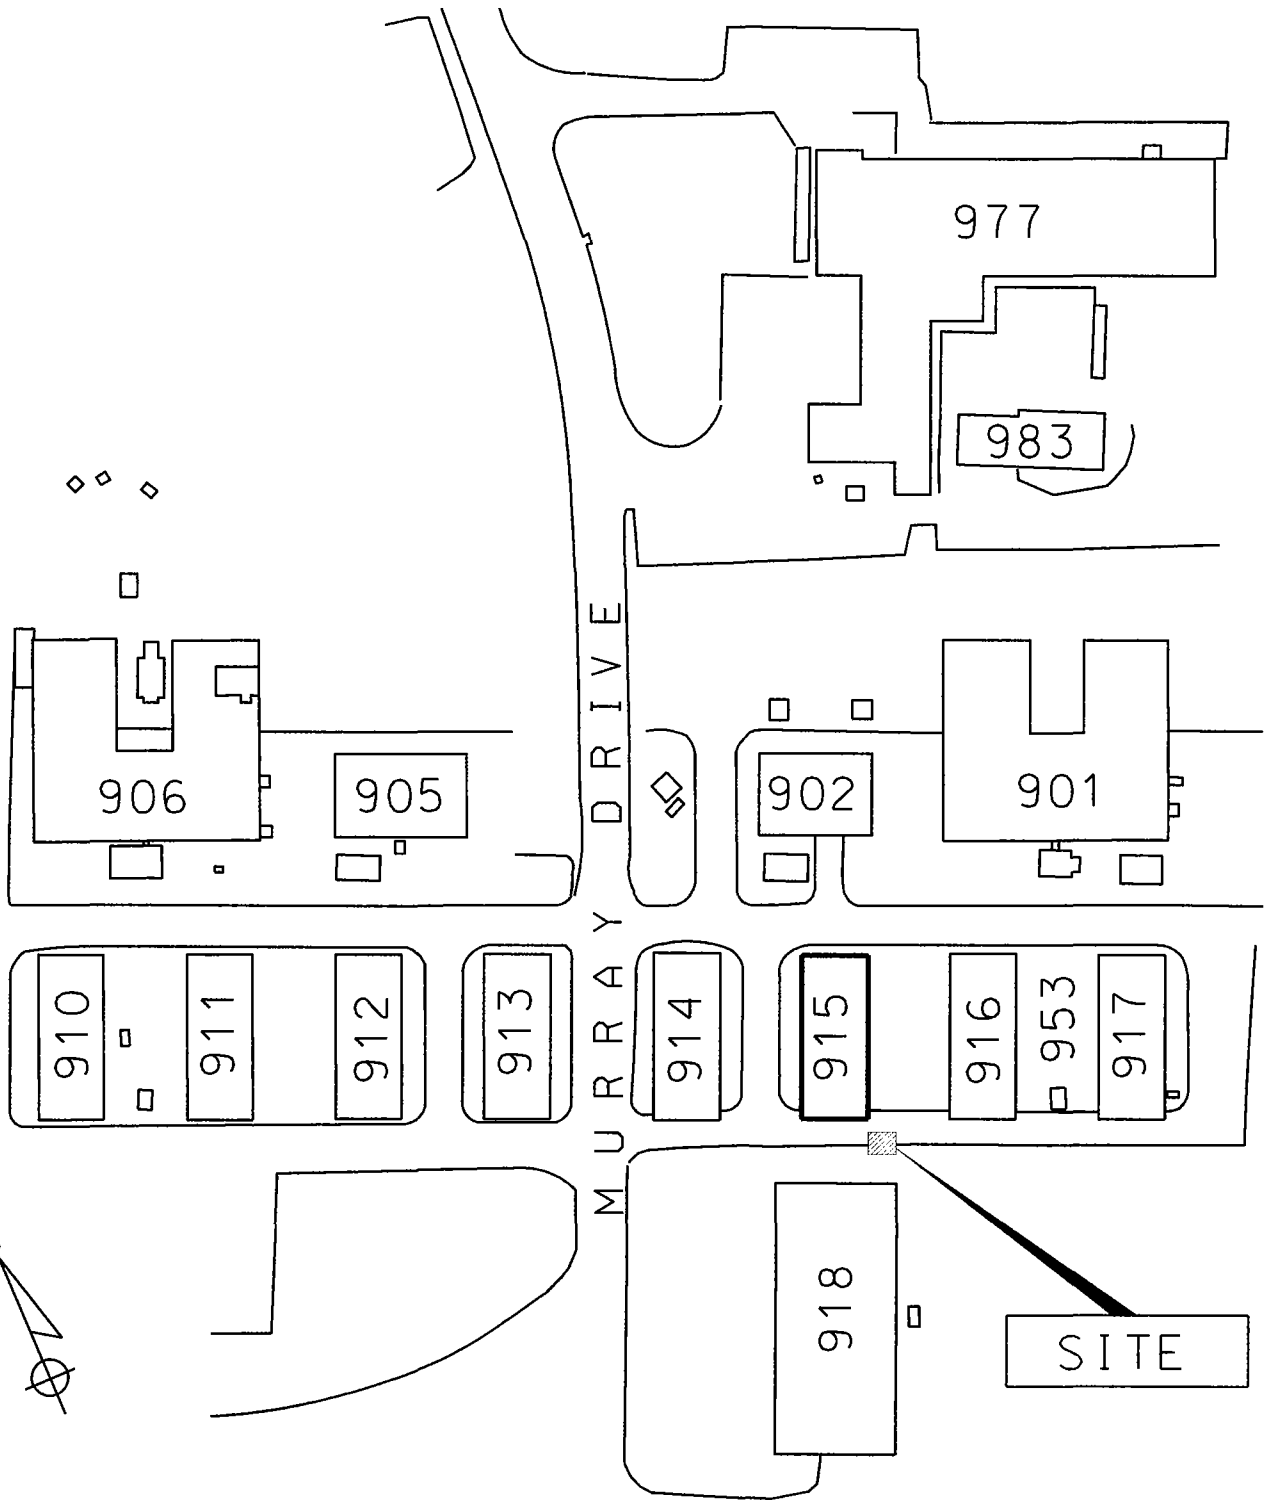


FIGURE 2
 SITE MAP
 BUILDING 915
 FORT MONMOUTH ARMY BASE
 MONMOUTH COUNTY, NJ

VERSAR
 ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
 BRISTOL, PA.

SCALE: 1"=100' DATE: MARCH 1998

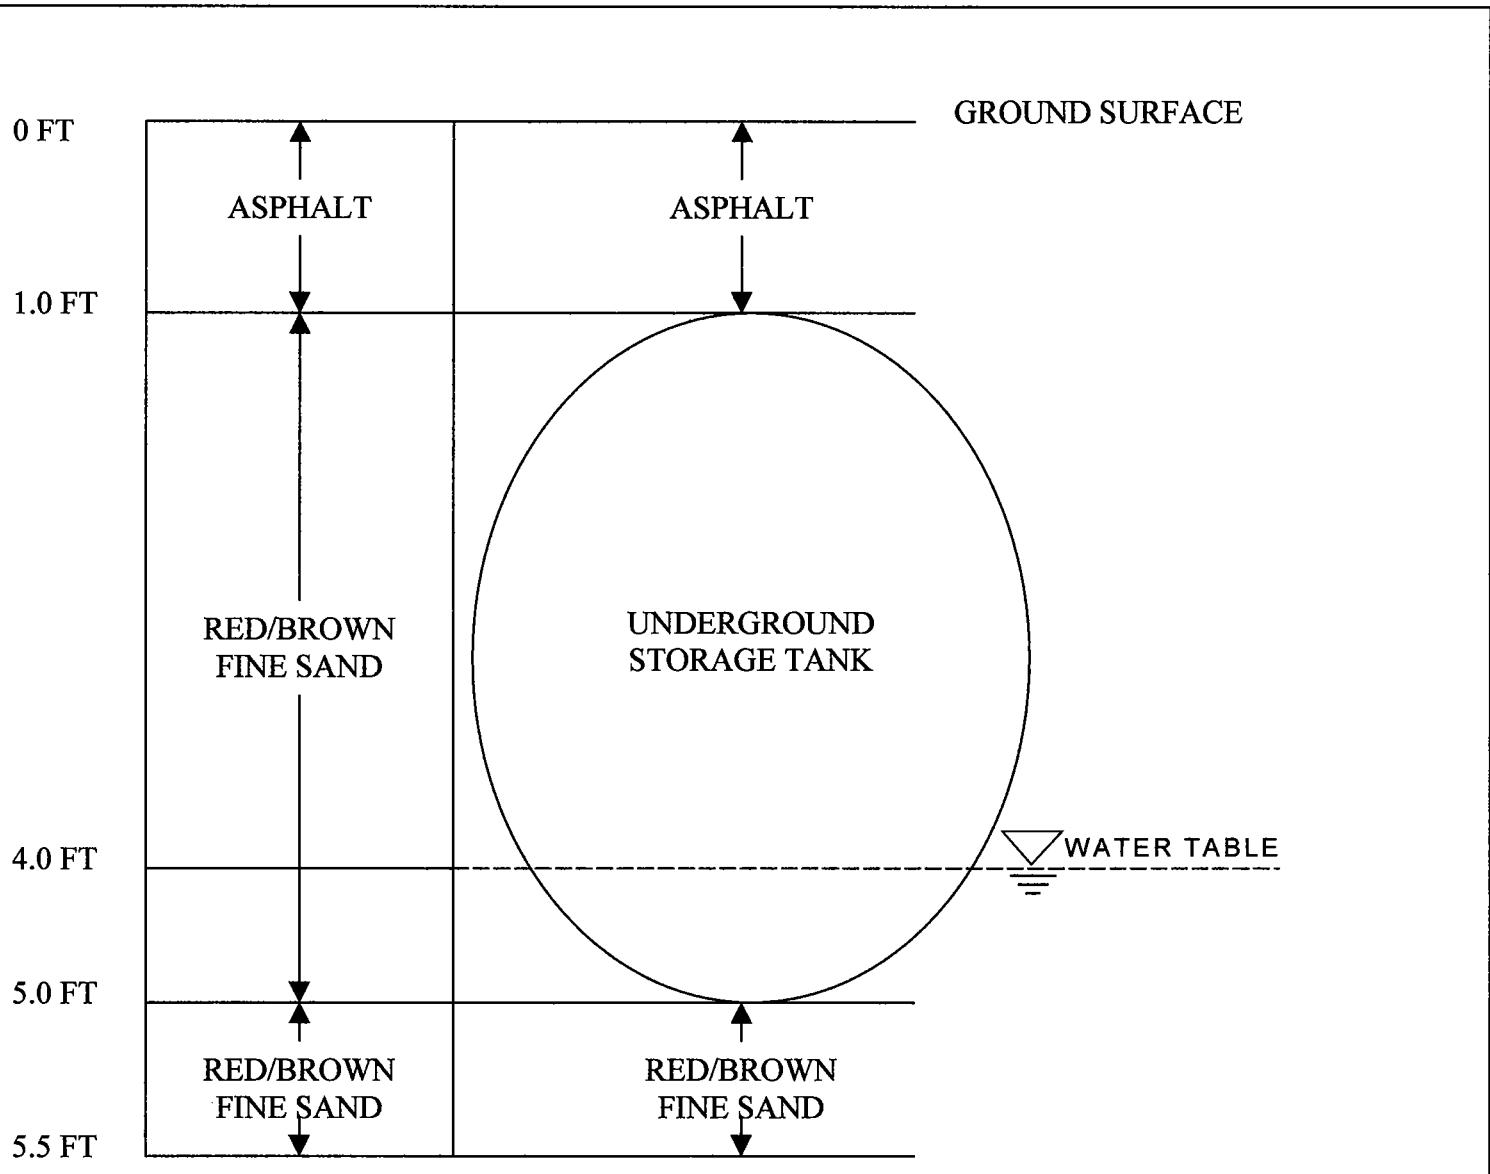


FIGURE 3
CROSS SECTIONAL VIEW
BUILDING 915
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
 Engineers, Managers, Scientists & Planners
 Bristol, Pennsylvania

SCALE: NTS	DATE: MARCH 1998
------------	------------------

BUILDING 915



915-P / 2.0' BGS
TPHC | ND

DUP-P / 2.0' BGS
TPHC | ND

FORMER
FUEL LINE

915-B / 3.5' BGS
TPHC | ND

915-E / 3.5' BGS
TPHC | ND


FORMER 1080
GALLON UST

915-C / 3.5' BGS
TPHC | ND

915-A / 5.5' BGS
TPHC | ND

DUP-A / 5.5' BGS
TPHC | ND

915-D / 3.5' BGS
TPHC | ND



LEGEND

● SOIL SAMPLE LOCATION
(MARCH 24, 1998)

■ SOIL SAMPLE LOCATION
(MAY 17, 1999)

▨ LIMIT OF EXCAVATION
(MAY 17, 1999)

NOTES:

1. ALL RESULTS IN MG/KG.
2. SEE TABLE 2 FOR NJDEP SOIL CLEANUP CRITERIA
3. BGS = BELOW GROUND SURFACE

FIGURE 4
SOIL SAMPLING LOCATION MAP
BUILDING 915
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.


SCALE: 1"=10'

DATE: MARCH 1998

BUILDING 915

FORMER
FUEL LINE

FORMER 1080
GALLON UST



SAMPLING LOCATION: SAMPLING DEPTH: SAMPLING DATE:	HIGHER OF NJDEP GWOS AND POL	BLDG 915 7-12' BGS 12/3/99	BLDG 915 7-12' BGS 1/8/00
VOLATILE ORGANIC COMPOUNDS:			
ACETONE:	700 UG/L	13.52 UG/L	ND
2-BUTANONE:	300 UG/L	5.74 UG/L	ND
SEMIVOLATILE ORGANIC COMPOUNDS:		ND	ND



LEGEND



GROUNDWATER SAMPLE LOCATION
(DECEMBER 3, 1999 AND JANUARY 8, 2000)



LIMIT OF EXCAVATION
(MAY 17, 1999)

NOTES:

1. ND=INDICATES COMPOUND NOT DETECTED
2. NLE= NO LIMIT ESTABLISHED
3. ALL RESULTS IN UG/L
4. BGS = BELOW GROUND SURFACE

FIGURE 5
GROUNDWATER SAMPLING MAP
BUILDING 915
FORT MONMOUTH ARMY BASE
MONMOUTH COUNTY, NJ

VERSAR
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS
BRISTOL, PA.

SCALE: 1"=10'

DATE: MARCH 1998

P. 1
L. 2
P. 3
L. 4
P. 5
L. 6
P. 7
L. 8
P. 9
L. 10
P. 11
L. 12
P. 13
L. 14
P. 15
L. 16
P. 17
L. 18
P. 19
L. 20
P. 21
L. 22
P. 23
L. 24
P. 25
L. 26
P. 27
L. 28
P. 29
L. 30
P. 31
L. 32
P. 33
L. 34
P. 35
L. 36
P. 37
L. 38
P. 39
L. 40
P. 41
L. 42
P. 43
L. 44
P. 45
L. 46
P. 47
L. 48
P. 49
L. 50
P. 51
L. 52
P. 53
L. 54
P. 55
L. 56
P. 57
L. 58
P. 59
L. 60
P. 61
L. 62
P. 63
L. 64
P. 65
L. 66
P. 67
L. 68
P. 69
L. 70
P. 71
L. 72
P. 73
L. 74
P. 75
L. 76
P. 77
L. 78
P. 79
L. 80
P. 81
L. 82
P. 83
L. 84
P. 85
L. 86
P. 87
L. 88
P. 89
L. 90
P. 91
L. 92
P. 93
L. 94
P. 95
L. 96
P. 97
L. 98
P. 99
L. 100

APPENDIX A
NJDEP-STANDARD REPORTING FORM

Tank Identification Number	TANK NO.		TANK NO.		TANK NO.		TANK NO.		TANK NO.			
8. Type of Monitoring/Detection System K. None L. Other (please specify)	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping		
9. Overfill Protection (tank only) (Mark one X for each tank) A. Yes B. No												
10. Spill Containment Around Fill Pipe (Mark one X for each tank) A. Yes B. No												
11. Tank Status (Mark one X for each tank) A. In-use B. Empty less than 12 months C. Empty 12 months or more D. Emergency spill tank (sump) E. Emergency backup generator tank F. Abandoned in Place G. Removed H. Other (please specify)	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping		
12. If box 11B, C, or D above has been marked, indicate the estimated date last used (month/day/year)	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year
13. Closure Information - Tank ID No.	TANK NO. 0153		TANK NO.		TANK NO.		TANK NO.		TANK NO.			
A. Date abandoned in place	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year
B. Date taken temporarily out of service												
C. Date removed	03	23	1998									
D. Date of Sale or Transfer												
E. TMS # (if applicable)												
F. ISRA # (if applicable)												

SECTION C - FINANCIAL RESPONSIBILITY

Does this facility have a Financial Responsibility Assurance Mechanism as required in 40 CFR 280? YES NO
Please list the appropriate financial information below:

Type	Carrier / Issuing Agency
Effective Date: ___/___/___	Policy Number: _____
Expiration Date: ___/___/___	Amount: \$ _____

SECTION D - MONITORING SYSTEMS

Does this facility have a release detection monitoring system which is in compliance with N.J.A.C. 7:14B-6? YES NO
If "No", please be aware that the facility must meet the appropriate deadline. (See "Dates to Know" on Page 4)

SECTION E - RECORDKEEPING/COMPLIANCE

Please answer all the questions in this section on a facility basis. Any one tank not in compliance requires a "NO" answer for the entire facility.

- Does this facility have cathodic protection systems for all steel tanks and piping?
If "Yes", are the systems properly operated and maintained pursuant to N.J.A.C. 7:14B-5? YES NO
- Are the performance claims and documentation of monitoring systems maintained by the owner or operator pursuant to N.J.A.C. 7:14B-5? YES NO
- Are the proper monitoring, testing, sampling, repair and inventory records kept on-site pursuant to N.J.A.C. 7:14B-5 and 6? YES NO
- Is the proper Release Response Plan kept on-site pursuant to N.J.A.C. 7:14B-5? YES NO
- Does the facility have spill and over fill protection systems pursuant to N.J.A.C. 7:14B-4? YES NO
- Have all Fill Ports been permanently marked as per API #1637 pursuant to N.J.A.C. 7:14B-5? YES NO

IMPORTANT INFORMATION

- FEE:** Please make checks payable to: "Treasurer, State of New Jersey". Use of the enclosed return envelope will expedite processing. Registration and Billing Schedule can be found in N.J.A.C. 7:14B. All Initial Registration fees are \$100 per facility.
- PENALTY:** Failure by owner or operator of a regulated underground storage tank to comply with any requirement of the State UST Act or regulations may result in the penalties set forth in N.J.S.A. 58:10A-10.
- EMERGENCY:** If a discharge or spill occurs, the NJDEP Hotline at (609) 292-7172 must be called IMMEDIATELY - 24 hours a day.
- UPGRADE EXEMPTION:** Residential heating oil underground storage tanks are exempt from all upgrade requirements.

DATES TO KNOW (critical deadlines)

- December 22, 1988 — All new federally regulated tank systems must have cathodic protection and spill/overflow protection.
- September 4, 1990 — All new State-only regulated tank systems must have cathodic protection and spill/overflow protection.
- December 22, 1990 — All federally regulated piping must have begun leak detection.
- February 19, 1993 — All federally regulated tank systems must maintain financial responsibility assurance.
- December 22, 1993 — All federally regulated tank systems must have begun leak detection.
- December 22, 1998 — All regulated tanks shall install cathodic protection and spill/overflow protection.

CERTIFICATIONS

NOTE: IF THE PERSON SIGNING CERTIFICATION NO. 2 IS THE SAME AS THE PERSON SIGNING CERTIFICATION NO. 1, THEN CERTIFICATION NO. 2 NEED NOT BE SIGNED. (If different persons are required to sign No. 1 and No. 2, then they must do so.)

CERTIFICATION NO. 1:

Must be signed by the highest ranking individual at the facility with overall responsibility

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

JAMES OTT
(Typed / Printed Name)
DIRECTOR, PUBLIC WORKS

(Title)

[Signature]
(Signature)
3/27/98
(Date)

CERTIFICATION NO. 2:

Must be signed as follows:

- For a corporation, by a principal executive officer of at least the level of vice president
- For a partnership or sole proprietorship, by a general partner or the proprietor, respectively
- For a municipality, State, Federal or other public agency, by either a principal executive officer or ranking elected official
- For persons other than indicated above, by the person with legal responsibility for the site

"I certify under penalty of law that I have personally examined and am familiar with the information submitted herein and all attached documents, and that based on my inquiry of those individuals immediately responsible for obtaining the information. I believe that the submitted information is true, accurate and complete. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

JAMES OTT
(Typed / Printed Name)
DIRECTOR, PUBLIC WORKS

(Title)

[Signature]
(Signature)
3/27/98
(Date)

CERTIFICATION NO. 3:

If applicable, must be signed by the individual who is certified to perform services.

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

DINKER. M. DESAI
(Typed / Printed Name) (Title)

[Signature]
(Signature)
3/27/98
(Date)
0010173
(N.J. Certification Number)

(Name of Firm, if applicable)

APPENDIX B
SITE ASSESSMENT SUMMARY

Site Remediation Program

UST Site/Remedial Investigation Report Certification Form

A. Facility Name : U.S. Army Fort Monmouth New Jersey

Facility Street Address : Directorate of Public Works Building 173

Municipality: Oceanport County : Monmouth

Block: Lot(s): Telephone Number : 732-532-6224

B. Owner (RP)'s Name:

Street Address: City :

State: Zip: Telephone Number :

C. (Check as appropriate)

- Site Investigation Report (SIR) \$500 Fee
Remedial Investigation Report (RIR) \$1000 Fee

X NA - Federal Agreement

D. (Complete all that apply)

- Assigned Case Manager : Ian Curtis, Federal Case Manager
UST Registration Number : 81533-153 (7 digits)
Incident Report Number (10 or 12 digits)
Tank Closure Number : Federal Case Manager

E. Certification by the Subsurface Evaluator:

The attached report conforms to the specific reporting requirements of N.J.A.C. 7:26EYes No

Name: Charles Appleby Signature: See signed subsurface removal log UST Cert. No.: 2056

Firm: U.S. Army Fort Monmouth Firm's UST Cert. Number: NA-U.S. Army

Firm Address: Directorate of Public Works Building 173 City: Fort Monmouth

State: NJ Zip: 07703 Telephone Number : 732-532-6224

(NOTE: Certification numbers required only if work was conducted on USTs regulated per N.J.S.A. 58:10A-21 et seq.)

F. Certification by the Responsible Party(ies) of the Facility:

The following certification shall be signed [according to the requirements of N.J.A.C. 7:14B-1.7(b)]as follows:

- 1. For a Corporation by a person authorized by a resolution of the board of directors to sign the document. A copy of the resolution, certified as a true copy by the secretary of the corporation, shall be submitted along with the certification; or
2. For a partnership or sole proprietorship, by a general partner or the proprietor, respectively; or
3. For a municipality, State, federal or other public agency by either a principal executive officer or ranking elected Official.

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attached documents, and that based on my inquiry of those individuals responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete. I am aware that there are significant civil penalties for knowingly submitting false, inaccurate, or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Name (Print or Type): James Ott Title: Directorate of Public Works

Signature: [Handwritten Signature]

Company Name: U.S. Army Fort Monmouth Date: 9/4/00


US ARMY, SELFM-PW-EV
DAILY UST SUBSURFACE REMOVAL LOG

BLDG.#: 915 REG.#: 0081533 - 153 CLOSURE#: _____
 DATE: 3/18/98 TOA: 1405 TOD: 1430
 GOV. SSE: Charles Appleby NJDEP CERT.#: _____
 REMOVAL CONTRACTOR: _____
 CLOSURE SUPERVISOR: Emmy Fanello NJDEP CERT.#: _____
 WEATHER: rain - overcast ~ 45°F

ACTIVITY	YES / NO
THE SUPERVISOR (CLOSURE CERT.) WAS ON-SITE DURING ALL CLOSURE RELATED ACTIVITIES	yes
THE SSE WAS ON-SITE DURING <u>UST REMOVAL</u> AND SITE SCREENING AND SAMPLING ACTIVITIES	yes
ALL ON-SITE PERSONNEL HAD TRAINING IAW ALL SAFETY REQUIREMENTS (E.G. 29CFR)	yes
A CONFINED ENTRY PERMIT WAS COMPLETED AND POSTED ON-SITE BY THE CONTRACTOR ^{seen} _{outside}	NA
THE UST WAS PLACED <u>ONTO PLASTIC</u> , SCRAPED OFF, INSPECTED FOR HOLES AND PHOTOGRAPHED	yes ^{or}
A DISCHARGE WAS REPORTED TO THE NJDEP (609-292-7172), CASE# _____	NA
PHOTOS HAVE UST#, BLDG. #, DATE, TIME, NAME OF SSE AND DESCR. WRITTEN ON BACK ^{yes}	yes
GROUNDWATER WAS ENCOUNTERED AT <u>4.5</u> FEET BG, A SHEEN (WAS <u>WAS NOT</u>) OBSERVED ON GW	clean
IF OVA/Hnu WAS USED: WAS IT CAL. AND FOUND TO BE OPERATIONAL (cal. data on COC)	NA
IF SAMPLES WERE TAKEN: COC, SCALED SITE MAP (VERT. SOIL HORIZONS AND PLOT PLAN)	NA
ALL SAMPLE COLLECTION ACTIVITIES WERE AS DESCRIBED IN THE NJDEP FSPM, 1992	NA
ALL SAMPLING WAS BIASED TOWARD HIGHEST OVA/FID RECORDED SITES IAW 7:26E-3.6 et seq.	NA
ALL PETROL. CONT. SOILS WERE SECURED FROM THE WEATHER BY CLOSE OF BUSINESS TODAY	yes NA
THE SSE AUTHORIZED BACKFILLING THE EXCAVATION (STONE TO 1" ABOVE GROUNDWATER)	NO
ADDITIONAL NOTES WERE TAKEN AND ARE RECORDED ON THE BACK OF THIS FORM	NO
THE FOLLOWING DOCUMENTS WERE ADDED TO THE PROJECT FOLDER TODAY: (CIRCLE EACH) SCRAP TICKET, CSE PERMIT, ACCIDENT REPORT, HAZ. WASTE MANIFEST, DAILY UST CLOSURE LOG, SCALED SITE MAP (SAMPLING), SRF-CLOSURE, CHAIN OF CUSTODY, SOIL ANALYTICAL RESULTS, CLEAN FILL TICKETS (IN YDS ³), PHOTOGRAPHS (UST, EXCAVATION, SAMPLING POINTS)	SRF

CHECK ALL BOXES, LEAVE NO BLANKS

I certify under penalty of law that tank decommissioning activities were performed in compliance with N.J.A.C. 7:14B-9.2(b)3 and 7:26 et seq.. I am aware that there are significant penalties for submitting false, inaccurate, or incomplete information, including fines and/or imprisonment.

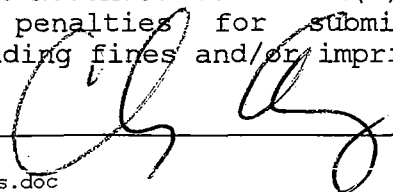SIGNATURE:  DATE: 3/18/98

ca\ms\ust\removal\sitessls.doc
 - Clean Site
 - No holes in tank.

APPENDIX C
WASTE MANIFEST



RD. 1, BOX 5A - OLD BRIDGE, NJ 08857

NON-HAZARDOUS WASTE MANIFEST

1. Generator's US EPA ID No.

NJ3210020597

Manifest Document No.

14073

2. Page 1 of 1

NHZ 014023

3. Generator's Name and Mailing Address
U.S. Army Communications Electronics Command
main Post, Bldg. 173 Joe Fallon BTTn: SCLEM-PW-EV

4. Generator's Phone (732) 532-6223 Fort Monmouth, NJ 07703

SUMA

5. Transporter 1 Company Name
LIONETTI OIL RECOVERY CO INC

6. US EPA ID Number
NJ D 0 8 4 0 4 4 0 6 4

A. Transporter's Phone
908 721-0900

7. Transporter 2 Company Name

8. US EPA ID Number

B. Transporter's Phone

9. Designated Facility Name and Site Address
LIONETTI OIL RECOVERY CO INC DBA LORCO PETROLEUM SVCS
RUNYON&CHEESEQUAKE RDS
OLD BRIDGE, NJ 08857

10. US EPA ID Number
NJ D 0 8 4 0 4 4 0 6 4

C. Facility's Phone
908 721-0900

11. Waste Shipping Name and Description

a. PETROLEUM OIL (PETROLEUM OIL)
COMBUSTIBLE LIQUID UN1270 PGIII

12. Containers		13. Total Quantity	14. Unit Wt/Vol
No.	Type		
001	T	1220	G

D. Additional Descriptions for Materials Listed Above
T,L PETROLEUM OIL 90%
WATER 10%

E. Handling Codes for Wastes Listed Above
T04 FILTRATION

15. Special Handling Instructions and Additional Information
24 HR EMERGENCY RESPONSE#(908) 721-0900
DECAL 87066 ERG#128 DEXSIL TEST KIT RESULTS 4000PM
MANIFEST USED FOR TRACKING PURPOSES ONLY

16. GENERATOR'S CERTIFICATION: I certify the materials described above on this manifest are not subject to federal regulations for reporting proper disposal of Hazardous Waste.

Printed/Typed Name
DINKER, M. DESAI

Signature
[Signature]

Month Day Year
06 01 98

17. Transporter 1 Acknowledgement of Receipt of Materials

Printed/Typed Name
Anibal Vazquez

Signature
[Signature]

Month Day Year
06 01 98

18. Transporter 2 Acknowledgement of Receipt of Materials

Printed/Typed Name

Signature

Month Day Year

19. Discrepancy Indication Space

20. Facility Owner or Operator: Certification of receipt of waste materials covered by this manifest except as noted in Item 19.

Printed/Typed Name
Richard Belle

Signature
[Signature]

Month Day Year
06 01 98

ORIGINAL - RETURN TO GENERATOR

GENERATOR

TRANSPORTER

FACILITY

APPENDIX D
UST DISPOSAL CERTIFICATE

1768

MAZZA & SONS, INC.
 RECYCLING DIVISION
 P.O. BOX 246
 OAKHURST, NJ 07755

DATE 4/9/98

55-7233/2212

THIS CHECK IS DELIVERED FOR PAYMENT ON THE FOLLOWING ACCOUNTS.

DATE	AMOUNT

PAY TO THE ORDER OF Tecom Vinnell
Ninety Seven & 80/100

\$ 97.80

DOLLARS

Sovereign Bank

(Signature)

⑆001768⑆ ⑈221272332⑆000 1091099286⑆

B. 915

MAZZA & SONS, INC.

Metal Recyclers
 3230 Shafto Rd.
 Tinton Falls, NJ
 (908) 922-9292

NO. _____


DATE. 9 April 98

Customer's Name Tecom Vinnell

Address _____

Weight	Price
Cast Iron	
Steel	<i>30.00</i>
Lt. Iron	
Copper #1	
Copper #2	

Weight	Price
Lt. Copper	
Brass	
Alum Clean	
Lead	
Stainless	
Battery	
	<i>30.00</i>

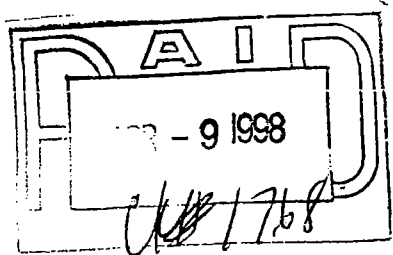

TOTAL AMOUNT:

Weigher _____ Customer *(Signature)*

APPENDIX E
SOIL ANALYTICAL DATA PACKAGE

**US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461**

REPORT OF ANALYSIS

Client: U.S. Army
DPW, SELFM-PW-EV
Bldg. 173
Ft. Monmouth, NJ 07703

Project: Total Petroleum Hydrocarbons
98-0001_
Bldg. 915

Project # 3427
Date Rec. 03/24/98
Date Compl. 03/25/98
Released by:



Daniel K. Wright
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Cover Sheet	1
Table of Contents	2
Method Summary	3
Conformance/Non-Conformance	4
Chain of Custody	5-6
Results Summary	7
Initial Calibration Summary	8
Continuing Calibration Summary	9
Surrogate Results Summary	10
MS/MSD Results Summary	11
Quality Control Spike Summary	12
Raw Sample Data	13-26
Laboratory Deliverable Checklist	27

Method Summary

NJDEP Method OOA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.


The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

PHC Conformance/Non-conformance Summary Report


	<u>No</u>	<u>Yes</u>
1. Method Detection Limits provided.	—	✓
2. Method Blank Contamination - If yes, list the sample and the corresponding concentrations in each blank. _____ _____	✓	—
3. Matrix Spike Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	—	✓
4. Duplicate Results Summary Meet Criteria. (If not met, list the sample and corresponding recovery which falls outside the acceptable range). _____ _____	—	✓
5. IR Spectra submitted for standards, blanks, & samples	—	NA
6. Chromatograms submitted for standards, blanks, and samples if GC fingerprinting was conducted.	—	✓
7. Analysis holding time met. (If not met, list number of days exceeded for each sample) _____ _____	—	✓
Additional Comments: _____ _____ _____		

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW 846 for Solid Waste Analysis. I have personally examined the information contained in this report, and to the best of my knowledge, I believe that the submitted information is true, accurate, complete, and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

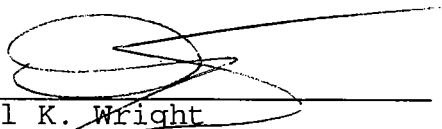

Daniel K. Wright
Laboratory Manager

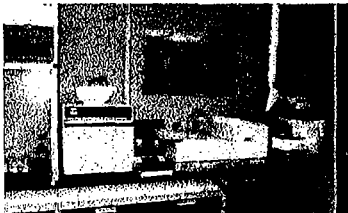

Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-3484 EMail:appleby@doitm6.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: DRW-ENV				Project No: 98-0001		Analysis Parameters					Comments: * = SAMPLES KEPT BELOW 4°C.	
Phone #:				Location: B. 915		TPHC	% Solids	Manganese				OVA
() DERA (X) DMA () Other:												
Samplers Name / Company: GARY DIMARTINIS - TVS				Sample #								Remarks / Preservation Method
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles							
3427.01	915-A	3-24-98	1403	SOIL	1	X	X	X			ND	EXC. FLOOR @ 5.5' *
02	B		1412								ND	SIDEWALL @ 3.5'
03	C		1408								ND	
04	D		1410								ND	
05	E		1415								ND	
06	F		1328								ND	Piping Run @ 1.0'
07	DUP										-	FIELD DUPLICATE
NOTE: OVA (#AS2114) CALIBRATED w/ 95 ppm CH4 + ZERO (W) AIR @ 1320 HRS. ON 3/24/98 by G. DIMARTINIS.												
Relinquished by (signature): <i>[Signature]</i>		Date/Time: 3-24-98/1456	Received by (signature): <i>[Signature]</i>		Relinquished by (signature):		Date/Time:	Received by (signature):				
Relinquished by (signature):		Date/Time:	Received by (signature):		Relinquished by (signature):		Date/Time:	Received by (signature):				
Report Type: () Full, (X) Reduced, () Standard, () Screen / non-certified					Remarks: DEDICATED SAMPLING TOOLS USED.							
Turnaround time: (X) Standard 4 wks, () Rush Days, () ASAP Verbal Hrs.												

Report of Analysis
 U.S. Army, Fort Monmouth Environmental Laboratory
 NJDEP Certification # 13461

Client :	U.S. Army	Lab. ID # :	3427
	DPW. SELFM-PW-EV	Date Rec'd:	24-Mar-98
	Bldg. 173	Analysis Start:	25-Mar-98
	Ft. Monmouth, NJ 07703	Analysis Complete:	25-Mar-98

Analysis:	OQA-QAM-025	UST Reg. #:	
Matrix:	Soil	Closure #:	
Analyst:	D.DEINHARDT	DICAR #:	
Ext. Meth:	Shake	Location #:	B.915

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
3427.01	915-A	1.00	15.34	83.42	184	ND
3427.02	915-B	1.00	15.15	85.83	181	ND
3427.03	915-C	1.00	15.14	89.08	174	ND
3427.04	915-D	1.00	15.45	83.36	182	ND
3427.05	915-E	1.00	15.57	81.53	185	ND
3427.06	915-F	1.00	15.30	88.96	173	2601.77
3427.07	915-DUP	1.00	15.55	87.85	172	ND
METHOD BLANK	25-Mar-98	1.00	15.00	100.00	157	ND

ND = Not Detected
 MDL = Method Detection Limit


 Daniel K. Wright
 Laboratory Director

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
- 2. Table of Contents submitted
- 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
- 4. Document paginated and legible
- 5. Chain of Custody submitted
- 6. Samples submitted to lab within 48 hours of sample collection
- 7. Methodology Summary submitted
- 8. Laboratory Chronicle and Holding Time Check submitted
- 9. Results submitted on a dry weight basis
- 10. Method Detection Limits submitted
- 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

Laboratory Manager or Environmental Consultant's Signature

Date 4/6/93

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732)532-6224 FAX: (732)532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

NJDEP LABORATORY CERTIFICATION # 13461



ANALYTICAL DATA REPORT
Fort Monmouth Environmental Laboratory
ENVIRONMENTAL DIVISION
Fort Monmouth, New Jersey
PROJECT: #99-0008

Bldg. 915

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
915-P	4489.01	Soil	17-May-99 11:30	05/17/99
915-P Dup	4489.01	Soil	17-May-99 11:32	05/17/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
TPHC, %SOLIDS


 6-2-99
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Method Summary	1
Conformance/Non-Conformance	2
Chain of Custody	3
Results Summary	4
Initial Calibration Summary	5-12
Surrogate Results Summary	13
MS/MSD Results Summary	14
Blank Spike Summary	15
Raw Sample Data	16-22
Laboratory Deliverable Checklist	23
Laboratory Authentication Statement	24

Method Summary

NJDEP Method OQA-QAM-025-10/97

Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty five milliliters(25mL) Methylene Chloride is added to the flask and it is secured on a gyrotory shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.

The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

000001

PHC Conformance/Non-conformance Summary Report

- | | Indicate
Yes, No, N/A |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------|
| 1. Method Detection Limits provided. | <u>yes</u> |
| 2. Method Blank Contamination – If yes, list the sample and the corresponding concentrations in each blank.

_____ | <u>NO</u> |
| 3. Matrix Spike Results Summary Meet Criteria
(If not met, list the sample and corresponding recovery which falls outside the acceptable range).

_____ | <u>yes</u> |
| 4. Duplicate Results Summary Meet Criteria
(If not met, list the sample and corresponding recovery which falls outside the acceptable range).

_____ | <u>yes</u> |
| 5. IR Spectra submitted for standards, blanks and samples. | <u>NA</u> |
| 6. Chromatograms submitted for standards, blanks and samples if GC fingerprinting was conducted. | <u>yes</u> |
| 7. Analysis holding time met.
(If not met, list number of days exceeded for each sample).

_____ | <u>yes</u> |

Additional comments: _____



Laboratory Manager

6-2-99

Date

000002

Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:appleby@mail1.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: Charles Appleby				Project No: 99-0008				Analysis Parameters				Comments:		
Phone #: X26224				Location: BLDG 915				TPHC	% SOLIDS	VOA+15	VOA ID Number	H-Nu Reading	* = Samples Kept <4 Celsius	
() DERA (X) OMA UST Assessment				UST# 81533-153									Remarks / Preservation Method	
Samplers Name / Company : Steve Schipper/TVS						Sample #								
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles									
4189, 01	915-P	5/17/99	11:30	S	1	X						0		
02	915-P DUP	5/17/99	11:32	S	1	X						0		
OVA sn# <u>1</u> was calibrated with zero air & at <u>95</u> ppm <u>METHANE</u> read <u>0+95</u> ppm. <u>5/17/99 9:20 SK</u> (time/date & initial)														
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):		Date/Time:		Received by (signature):				
		5-17-99 1300												
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):		Date/Time:		Received by (signature):				
Report Type: () Full, () Reduced, (X) Standard, () Screen / non-certified						Remarks: Dedicated Sampling Tools Used								
Turnaround time: () Standard 4 wks, () Rush <u>2</u> Days, () ASAP Verbal _____ Hrs.														


000000

Report of Analysis
 U.S. Army, Fort Monmouth Environmental Laboratory
 NJDEP Certification # 13461

Client :	U.S. Army DPW. SELFM-PW-EV Bldg. 173 Ft. Monmouth, NJ 07703	Lab. ID # :	4489
		Date Rec'd:	17-May-99
		Analysis Start:	19-May-99
		Analysis Complete:	20-May-99
Analysis:	OQA-QAM-025	UST Reg. #:	81533-153
Matrix:	Soil	Closure #:	
Analyst:	D.DEINHARDT	DICAR #:	
Inst. ID.	GC TPHC INST. #1	Injection Volume	1 ul
Column Type	RTX 5	Column ID	0.32 um
Ext. Meth:	Shake	Location #:	Bldg-915

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
4489.01	915-P	1.00	15.20	90.51	171	ND
4489.02	915-P DUP	1.00	15.15	90.76	171	ND
METHOD BLANK	TBLK 237	1.00	15.00	100.00	157	ND

ND = Not Detected
 MDL = Method Detection Limit


 Daniel K. Wright
 Laboratory Director

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- | | |
|--------------------------------------------------------------------------------------------------------------|-------------------------------------|
| 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted | <input checked="" type="checkbox"/> |
| 2. Table of Contents submitted | <input checked="" type="checkbox"/> |
| 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted | <input checked="" type="checkbox"/> |
| 4. Document paginated and legible | <input checked="" type="checkbox"/> |
| 5. Chain of Custody submitted | <input checked="" type="checkbox"/> |
| 6. Samples submitted to lab within 48 hours of sample collection | <input checked="" type="checkbox"/> |
| 7. Methodology Summary submitted | <input checked="" type="checkbox"/> |
| 8. Laboratory Chronicle and Holding Time Check submitted | <input checked="" type="checkbox"/> |
| 9. Results submitted on a dry weight basis | <input checked="" type="checkbox"/> |
| 10. Method Detection Limits submitted | <input checked="" type="checkbox"/> |
| 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP | <input checked="" type="checkbox"/> |

Laboratory Manager or Environmental Consultant's Signature

Date 6/2/99



Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance.

000023

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

A handwritten signature in black ink, consisting of several loops and a horizontal line extending to the right. The date "6-2-97" is written in the right margin of the signature.

Daniel K. Wright
Laboratory Manager

000024

APPENDIX F

GROUNDWATER ANALYTICAL DATA PACKAGE

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699




ANALYTICAL DATA REPORT
Fort Monmouth Environmental Laboratory
ENVIRONMENTAL DIVISION
Fort Monmouth, New Jersey
PROJECT: UST Program

Bldg. 915

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
Bldg. 915	4976.01	Aqueous	03-Dec-99 09:51	12/03/99

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS


Daniel Wright/Date
Laboratory Director

4-8-00

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-15
Tune Results Summary	16-19
Method Blank Results Summary	20
Calibration Summary	21-22
Surrogate Recovery Summary	23
MS/MSD Results Summary	24-25
Internal Standard Area & RT Summary	26
Chromatograms	27-30
Base Neutrals	31
Analytical Results Summary	32-37
Tune Results Summary	38-43
Method Blank Results Summary	44
Calibration Summary	45-48
Surrogate Recovery Summary	49-50
MS/MSD Results Summary	51-54
Internal Standard Area & RT Summary	55-58
Chromatograms	59-62
Laboratory Deliverables Checklist	63
Laboratory Authentication Statement	64

**CHAIN
OF
CUSTODY**

000001



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:appleby@mail1.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: <u>D. DeMB</u>		Project No:		Analysis Parameters						Comments: HCL / 24°C		
Phone #: <u>K21475</u>		Location: <u>UST Bldg 915</u> <u>1st Rnd</u>		VOTIS	Xylene	BNTIS						
() DERA (X) OMA () Other: _____		Samplers Name / Company: <u>Cory McCormack, TVS</u>										
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles							Remarks / Preservation Method
<u>4976.01</u>	<u>Bldg 915</u>	<u>12/3/99</u>	<u>0951</u>	<u>AG</u>	<u>3</u>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>				
Relinquished by (signature): <u>Cory McCormack</u>	Date/Time: <u>12/3/99 1500</u>	Received by (signature): <u>[Signature]</u>	Relinquished by (signature):	Date/Time:	Received by (signature):							
Relinquished by (signature):	Date/Time:	Received by (signature):	Relinquished by (signature):	Date/Time:	Received by (signature):							
Report Type: <input type="checkbox"/> Full, <input type="checkbox"/> Reduced, <input checked="" type="checkbox"/> Standard, <input type="checkbox"/> Screen / non-certified			Remarks: <u>Shus Trip / FB from 289 sun date</u> <u>Shus Dye from 977 same date. cpm</u>									
Turnaround time: <input checked="" type="checkbox"/> Standard 3 wks, <input type="checkbox"/> Rush _____ Days, <input type="checkbox"/> ASAP Verbal _____ Hrs.												

000002

METHODOLOGY SUMMARY

000003

Method Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

000004

CONFORMANCE NON-CONFORMANC SUMMARY

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms Labeled/Compounds Identified (Field Samples and Method Blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency - Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration - Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration Requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination - If yes, List compounds and concentrations in each blank: yes
 - a. VOA Fraction Methylene Chloride @ 2.83 ppb
 - b. B/N Fraction _____
 - c. Acid Fraction _____
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____

If not met, were the calculations checked and the results qualified as "estimated"?

9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria (If not met, list those compounds and their recoveries, which fall outside the acceptable range) yes
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction _____

GC/MS Analysis Conformance/Non-Conformance Summary (cont.)

Indicate
Yes,
No,
N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria yes
(If not met, list those compounds, which fall outside the acceptable range)
a. VOA Fraction _____
b. B/N Fraction _____
c. Acid Fraction _____

11. Extraction Holding Time Met yes
If not met, list number of days exceeded for each sample: ____

12. Analysis Holding Time Met yes
If not met, list number of days exceeded for each sample: ____

Additional Comments:

Laboratory Manager :  Date: 4-8-00

LABORATORY CHRONICLE

000008

Laboratory Chronicle

Lab ID: 4976

Site: Bldg. 915

	Date	Hold Time
Date Sampled	12/03/99	NA
Receipt/Refrigeration	12/03/99	NA
Extractions		
1. Base Neutral	12/06/99	14 days
Analyses		
1. Volatile Organics	12/06,07/99	14 days
2. Base Neutral	12/07/99	40 days

000009

VOLATILE ORGANICS

000010

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

MDL : Method Detection Limit
J : Compound identified below detection limit
B : Compound in both sample and blank
D : Results from dilution of sample
U : Compound searched for but not detected
E : Compound exceeds calibration limit

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB004963.D**
 Operator **Skelton**
 Date Acquired **6 Dec 1999 10:02 am**

Sample Name **Vblk151**
 Field ID **Vblk151**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride	11.44	65495	2.83 ug/L	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Vblk151

Lab Name: FMETL Project: 100004
NJDEP#: 13461 Case No.: 4976 Location: 915 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Vblk151
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB004963.D
Level: (low/med) LOW Date Received: 12/3/99
% Moisture: not dec. _____ Date Analyzed: 12/6/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VB004987.D**
 Operator **Skelton**
 Date Acquired **7 Dec 1999 2:18 am**

Sample Name **4976.01**
 Field ID **Bldg915**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone	9.23	101077	13.52 ug/L	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-34-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone	15.54	63663	5.74 ug/L	300	0.62 ug/L	
156-59-4	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6.2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Bldg915

Lab Name: FMETL Project: 100004
NJDEP#: 13461 Case No.: 4976 Location: 915 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 4976.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB004987.D
Level: (low/med) LOW Date Received: 12/3/99
% Moisture: not dec. _____ Date Analyzed: 12/7/99
GC Column: RTX502. ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

VOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
BROMOFLUOROBENZENE (BFB)

Lab Name: FMETL Project: 100004
 NJDEP#: 13461 Case No.: 4976 Location: 915 SDG No.: _____
 Lab File ID: VB004750.D BFB Injection Date: 11/12/99
 Instrument ID: GCMS#2 BFB Injection Time: 8:31
 GC Column: RTX502.2 ID: 0.25 (mm) Heated Purge: (Y/N) N

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
50	8.0 - 40.0% of mass 95	20.8
75	30.0 - 66.0% of mass 95	49.7
95	Base peak, 100% relative abundance	100.0
96	5.0 - 9.0% of mass 95	6.3
173	Less than 2.0% of mass 174	0.0 (0.0)1
174	50.0 - 120.0% of mass 95	73.7
175	4.0 - 9.0% of mass 174	5.5 (7.4)1
176	93.0 - 101.0% of mass 174	72.7 (98.6)1
177	5.0 - 9.0% of mass 176	4.6 (6.3)2

1-Value is % mass 174

2-Value is % mass 176

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	Lab ID.	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	VSTD020	VSTD020	VB004751.D	11/12/99	9:25
02	VSTD010	VSTD010	VB004752.D	11/12/99	10:19
03	VSTD005	VSTD005	VB004753.D	11/12/99	10:58
04	VSTD100	VSTD100	VB004754.D	11/12/99	11:37
05	VSTD050	VSTD050	VB004755.D	11/12/99	12:17

Data File : C:\HPCHEM\1\DATA\991112\VB004750.D

Vial: 1

Acq On : 12 Nov 1999 8:31 am

Operator: Skelton

Sample : BFB Tune

Inst : GC VOA 2



Misc : BFB Tune

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M262439.M (RTE Integrator)

Title : Volatile Organics by GC/MS Method 624/8260/TCLP

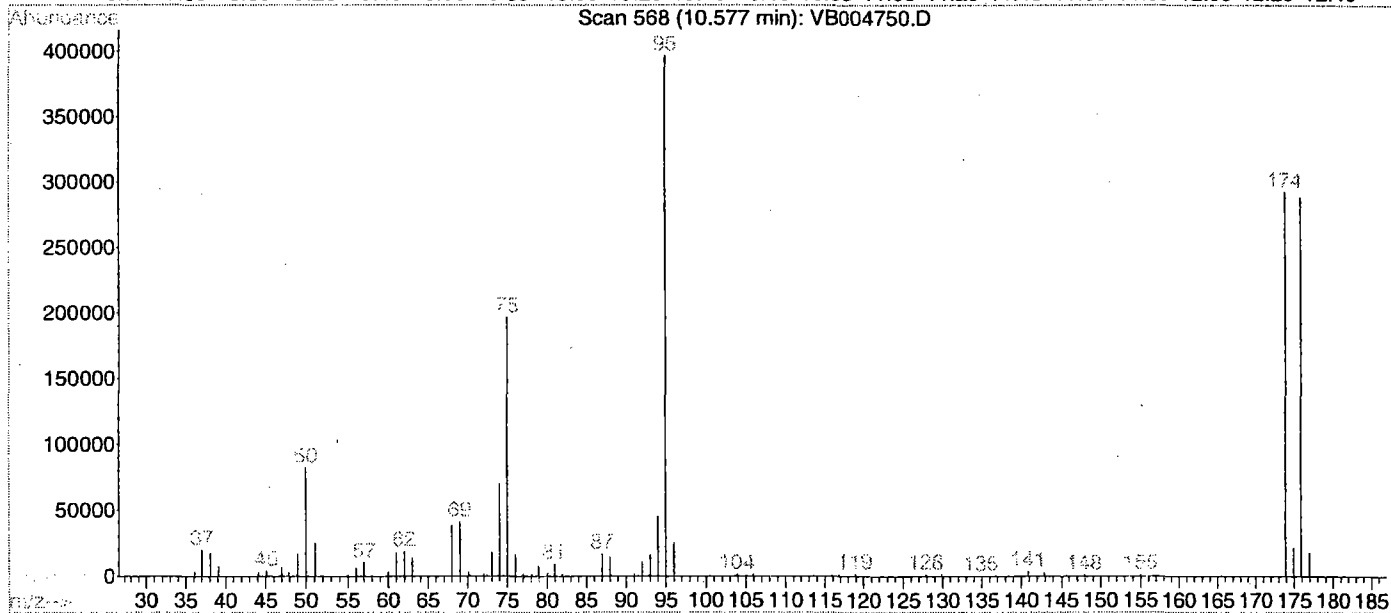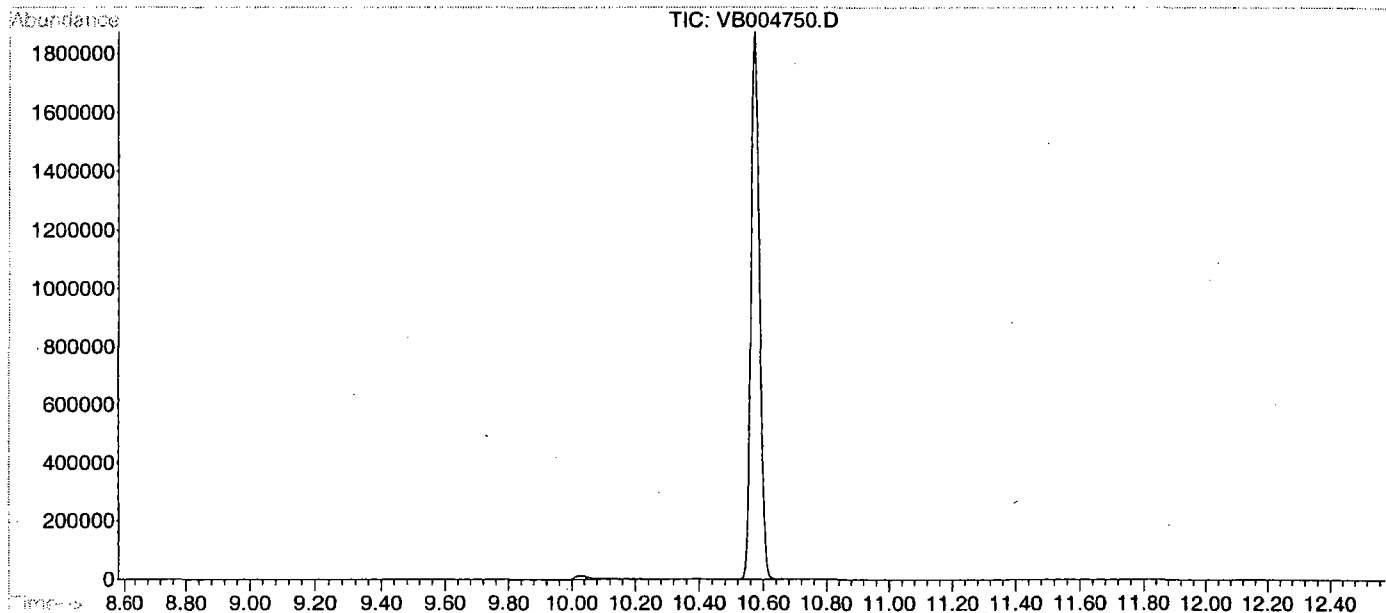

Spectrum Information: Scan 568

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
50	95	15	40	20.8	82488	PASS
75	95	30	60	49.7	197248	PASS
95	95	100	100	100.0	396992	PASS
96	95	5	9	6.3	25080	PASS
173	174	0.00	2	0.0	0	PASS
174	95	50	100	73.7	292736	PASS
175	174	5	9	7.4	21792	PASS
176	174	95	101	98.6	288640	PASS
177	176	5	9	6.3	18264	PASS

**BASE
NEUTRAL**

000031

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BN04072.D**
 Operator **Bhaskar**
 Date Acquired **7-Dec-99**

Sample Name **Sblk325**
 Misc Info **Sblk325 A 991206**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.79 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report
Page 2

Data File Name **BN04072.D**
Operator **Bhaskar**
Date Acquired **7-Dec-99**

Sample Name **Sblk325**
Misc Info **Sblk325 A 991206**
Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benizidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
D= Value from dilution
B= Compound in Related Blank
PQL= Practical Quantitation Limit

MDL= Method Detection Limit
NLE= No Limit Established
R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

Sblk325

Lab Name: FMETL Lab Code 13461
Project: UST Case No.: 4976 Location: Bld.915 SDG No: _____
Matrix: (soil/water) WATER Lab Sample ID: Sblk325
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BN04072.D
Level: (low/med) LOW Date Received: 12/3/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 12/6/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/7/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BN04076.D**
 Operator **Bhaskar**
 Date Acquired **7-Dec-99**

Sample Name **4976.01**
 Misc Info **Bldg.915**
 Sample Multiplier **1.25**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	2.29 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	1.14 ug/L	
62-53-3	Aniline			not detected	NLE	2.04 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.60 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.51 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.49 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.28 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.41 ug/L	
39638-32-9	bis(2-chloroisopropyl)ether			not detected	300	1.74 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	1.00 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.88 ug/L	
98-95-3	Nitrobenzene			not detected	10	1.21 ug/L	
78-59-1	Isophorone			not detected	100	1.26 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.51 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.53 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.59 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.36 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.89 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.35 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.65 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.26 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.99 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.90 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	1.20 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	1.01 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.99 ug/L	
83-32-9	Acenaphthene			not detected	400	1.38 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.25 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	1.09 ug/L	
84-66-2	Diethylphthalate			not detected	5000	2.03 ug/L	
86-73-7	Fluorene			not detected	300	1.24 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.38 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.31 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.26 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.84 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.95 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	1.18 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.54 ug/L	
120-12-7	Anthracene			not detected	2000	1.40 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	2.13 ug/L	
206-44-0	Fluoranthene			not detected	300	2.05 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BN04076.D**
 Operator **Bhaskar**
 Date Acquired **7-Dec-99**

Sample Name **4976.01**
 Misc Info **Bldg.915**
 Sample Multiplier **1.25**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	5.23 ug/L	
129-00-0	Pyrene			not detected	200	1.56 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.31 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.49 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	2.19 ug/L	
218-01-9	Chrysene			not detected	20	1.73 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	2.18 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.80 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.56 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.61 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.31 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	1.04 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.80 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	1.05 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

Field ID:

Bldg.915

Lab Name: FMETL Lab Code 13461
Project: UST Case No.: 4976 Location: Bld.915 SDG No: _____
Matrix: (soil/water) WATER Lab Sample ID: 4976.01
Sample wt/vol: 800 (g/ml) ML Lab File ID: BN04076.D
Level: (low/med) LOW Date Received: 12/3/99
% Moisture: _____ decanted: (Y/N) N Date Extracted: 12/6/99
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 12/7/99
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: _____

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461
 Project 100004 Case No.: 4976 Location Bld.915 SDG No.: _____
 Lab File ID: BNA03321.D DFTPP Injection Date: 10/27/99
 Instrument ID: BNA#2 DFTPP Injection Time: 9:32

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	60.0
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	56.4
70	Less than 2.0% of mass 69	0.3 (0.6)1
127	25.0 - 75.0% of mass 198	53.8
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	7.1
275	10.0 - 30.0% of mass 198	19.9
365	Greater than 0.75% of mass 198	2.0
441	Present, but less than mass 443	8.7
442	40.0 - 110.0% of mass 198	59.1
443	15.0 - 24.0% of mass 442	12.0 (20.4)2

1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD050	50 PPM CAL	BNA03325.D	10/27/99	12:40
02	4871.04DUP	4871.04DUP	BNA03332.D	10/27/99	18:28
03	4871.04MS	4871.04MS	BNA03333.D	10/27/99	19:17

Data File : C:\HPCHEM\1\DATA\991027\BNA03321.D

Vial: 99

Acq On : 27 Oct 1999 9:32 am

Operator: Bhaskar

Sample : DFTPP TUNE

Inst : GC BNA 2



Misc : 50NG/2UL

Multiplr: 1.00

MS Integration Params: RTEINT.P

Method : C:\HPCHEM\1\METHODS\M262534.M (RTE Integrator)

Title : BNA Calibration

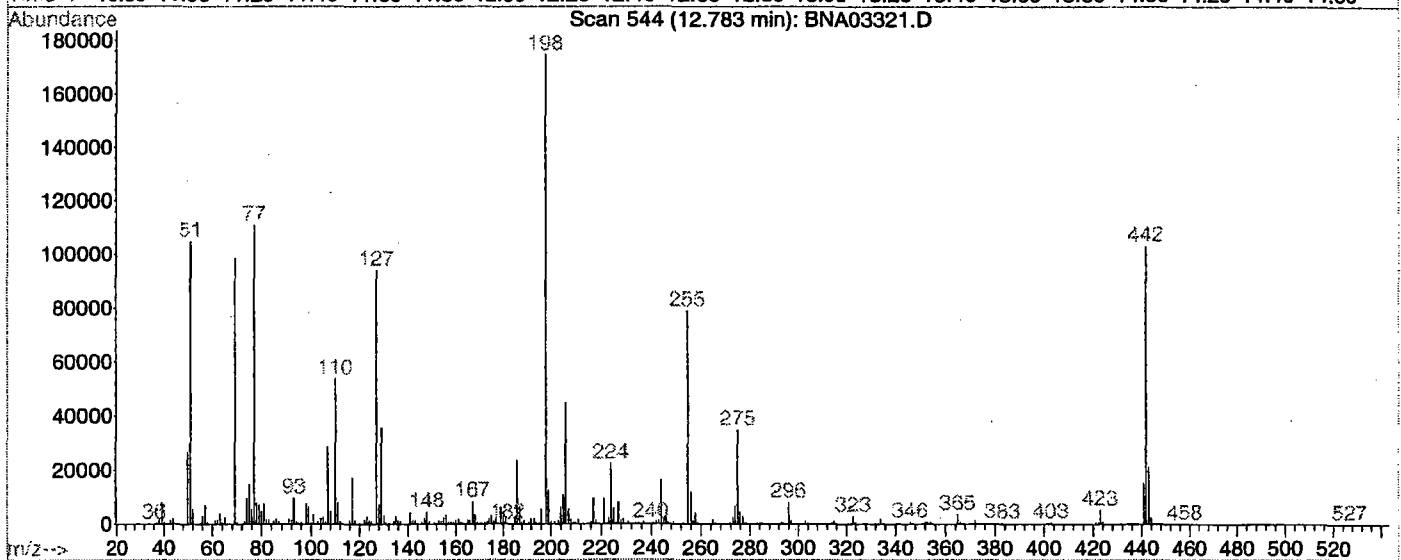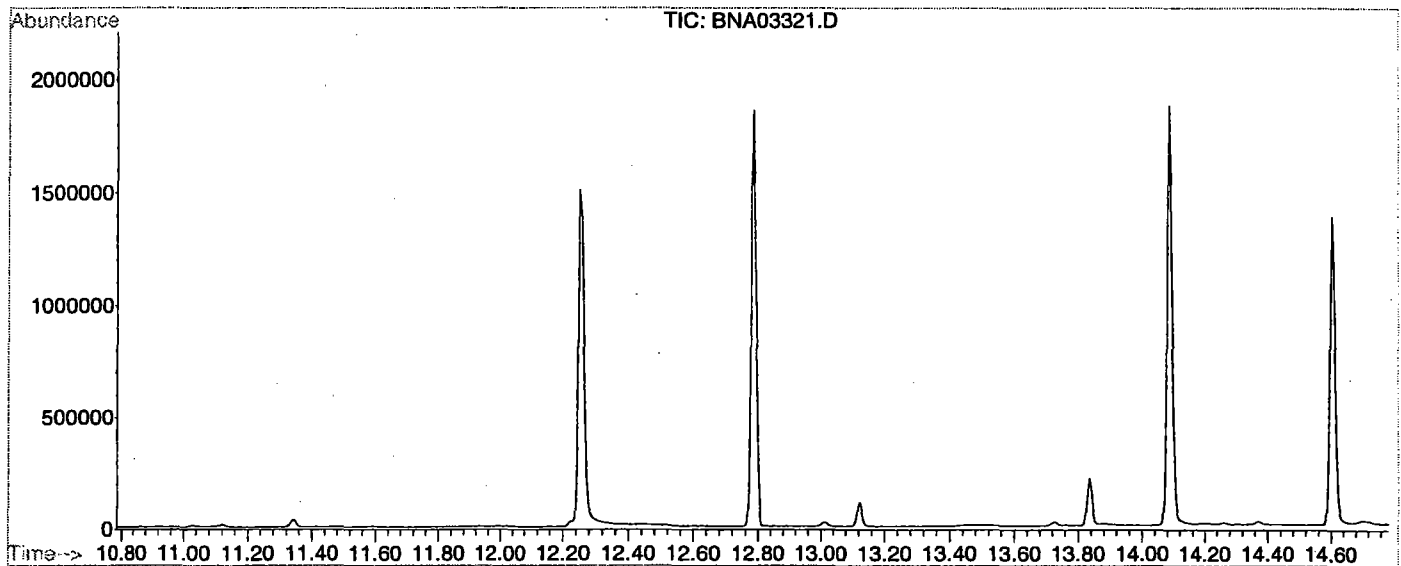

Spectrum Information: Scan 544

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	60.0	104832	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	56.4	98600	PASS
70	69	0.00	2	0.6	593	PASS
127	198	40	60	53.8	94000	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	174720	PASS
199	198	5	9	7.1	12479	PASS
275	198	10	30	19.9	34848	PASS
365	198	1	100	2.0	3527	PASS
441	443	1	99	72.0	15134	PASS
442	198	40	100	59.1	103184	PASS
443	442	17	23	20.4	21008	PASS

SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)

Lab Name: FMETL Lab Code 13461
 Project: UST Case No.: 4976 Location: Bld.915 SDG No: _____
 Lab File ID: BN04064.D DFTPP Injection Date: 11/29/99
 Instrument ID: SVoa#1 DFTPP Injection Time: 13:16

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	48.2
68	Less than 2.0% of mass 69	0.0 (0.0)1
69	Mass 69 Relative abundance	59.4
70	Less than 2.0% of mass 69	0.3 (0.5)1
127	25.0 - 75.0% of mass 198	44.0
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	6.8
275	10.0 - 30.0% of mass 198	15.3
365	Greater than 0.75% of mass 198	1.4
441	Present, but less than mass 443	6.7
442	40.0 - 110.0% of mass 198	41.9
443	15.0 - 24.0% of mass 442	8.2 (19.6)2

1-Value is % mass 69




2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	Field ID:	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BN04065.D	11/29/99	13:47
02	SSTD080	80 PPM CAL	BN04066.D	11/29/99	14:37
03	SSTD050	50 PPM CAL	BN04067.D	11/29/99	15:21
04	SSTD020	20 PPM CAL	BN04068.D	11/29/99	16:06
05	SSTD010	10 PPM CAL	BN04069.D	11/29/99	16:52

DFTPP

Data File : C:\HPCHEM\1\DATA\991129\BN04064.D Vial: 99
 Acq On : 29 Nov 1999 1:16 pm Operator: Bhaskar
 Sample : DFTPP TUNE Inst : GC/MS Ins
 Misc : 50 NG/2UL Multiplr: 1.00
 MS Integration Params: RTEINT.P GC Integration Params: rteint2.p
 Method : C:\HPCHEM\1\METHODS\M62538.M (RTE Integrator)
 Title : BNA Calibration

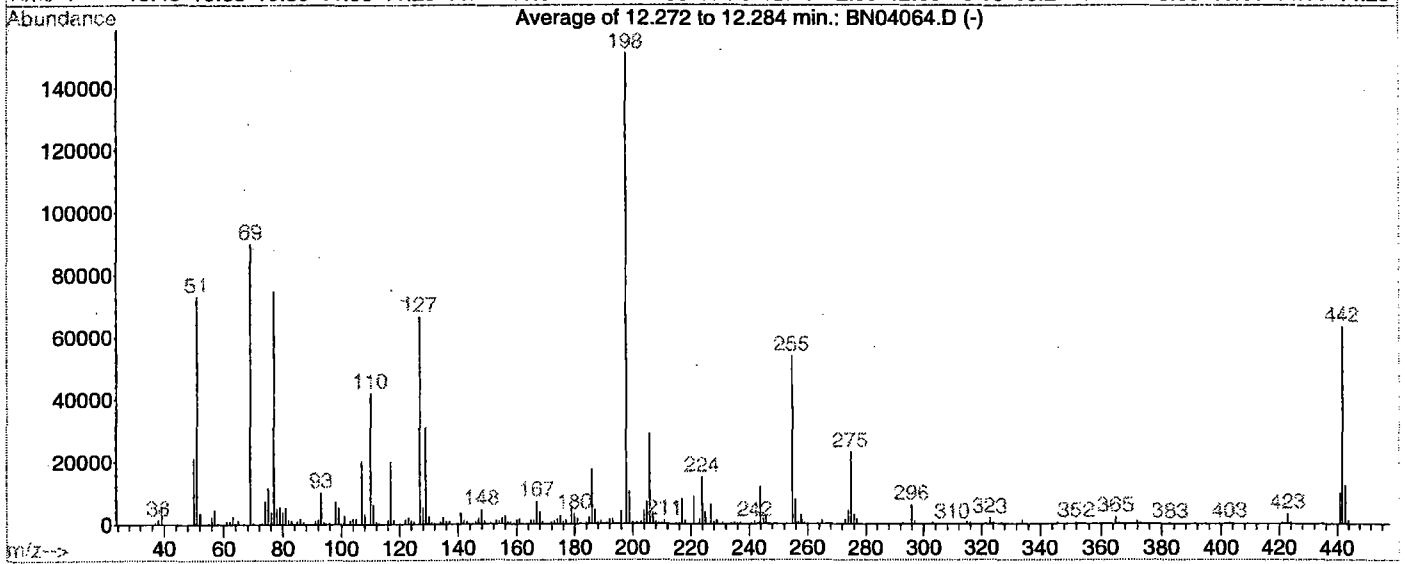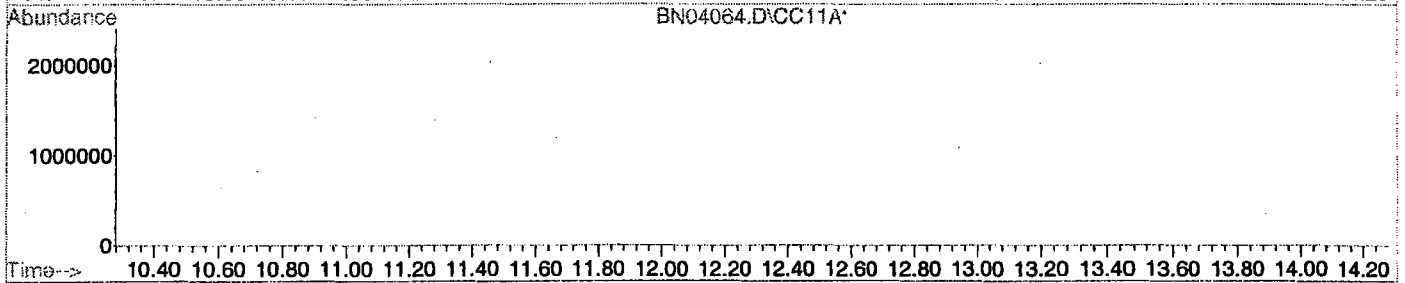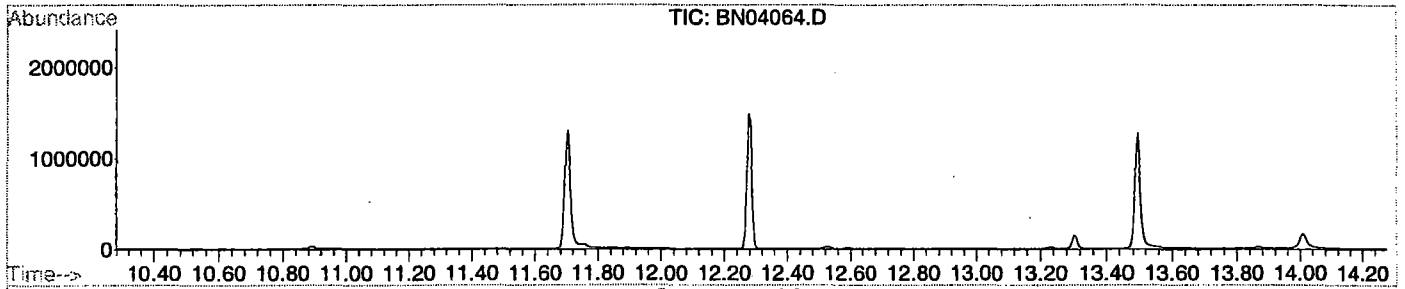

Spectrum Information: Average of 12.272 to 12.284 min.

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	48.2	73005	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	59.4	90010	PASS
70	69	0.00	2	0.5	426	PASS
127	198	40	60	44.0	66547	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	151413	PASS
199	198	5	9	6.8	10318	PASS
275	198	10	30	15.3	23106	PASS
365	198	1	100	1.4	2185	PASS
441	443	1	99	81.1	10084	PASS
442	198	40	100	41.9	63450	PASS
443	442	17	23	19.6	12433	PASS

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS


The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- | | |
|--------------------------------------------------------------------------------------------------------------|-------------------------------------|
| 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted | <input checked="" type="checkbox"/> |
| 2. Table of Contents submitted | <input checked="" type="checkbox"/> |
| 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted | <input checked="" type="checkbox"/> |
| 4. Document paginated and legible | <input checked="" type="checkbox"/> |
| 5. Chain of Custody submitted | <input checked="" type="checkbox"/> |
| 6. Samples submitted to lab within 48 hours of sample collection | <input checked="" type="checkbox"/> |
| 7. Methodology Summary submitted | <input checked="" type="checkbox"/> |
| 8. Laboratory Chronicle and Holding Time Check submitted | <input checked="" type="checkbox"/> |
| 9. Results submitted on a dry weight basis | <input checked="" type="checkbox"/> |
| 10. Method Detection Limits submitted | <input checked="" type="checkbox"/> |
| 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP | <input checked="" type="checkbox"/> |

Laboratory Manager or Environmental Consultant's Signature

Date 4/8/00




Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance.

000063

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

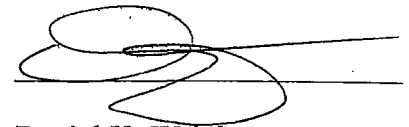

Daniel K. Wright
Laboratory Manager

000064

FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT
Fort Monmouth Environmental Laboratory
ENVIRONMENTAL DIVISION
Fort Monmouth, New Jersey
PROJECT: UST Program

Bldg. 915

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
915-1 7-12'	5082.01	Aqueous	08-Jan-00 10:35	01/10/00
Field Dup. 7-12'	5082.02	Aqueous	08-Jan-00	01/10/00

ANALYSIS:
FORT MONMOUTH ENVIRONMENTAL LAB
VOA+15, BN+15

ENCLOSURE:
CHAIN OF CUSTODY
RESULTS


 5-8-00
Daniel Wright/Date
Laboratory Director

Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-7
Laboratory Chronicle	8-9
Volatile Organics	10-11
Analytical Results Summary	12-17
Tune Results Summary	18-21
Method Blank Results Summary	22-23
Calibration Summary	24-25
Surrogate Recovery Summary	26
MS/MSD Results Summary	27-28
Internal Standard Area & RT Summary	29-30
Chromatograms	31-36
Base Neutrals	37
Analytical Results Summary	38-46
Tune Results Summary	47-50
Method Blank Results Summary	51
Calibration Summary	52-55
Surrogate Recovery Summary	56
MS/MSD Results Summary	57-60
Internal Standard Area & RT Summary	61-62
Chromatograms	63-73
Laboratory Deliverables Checklist	74
Laboratory Authentication Statement	75

CHAIN OF CUSTODY

000001



Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:wrightd@mail1.monmouth.army.mil

NJDEP Certification #13461

Chain of Custody Record

Customer: <u>D. DESAI</u>		Project No:				Analysis Parameters							Comments:	
Phone #:		Location: <u>BLOS. 915</u>				V O A + 15	B N + 15							
() DERA () MA () Other: _____		Samplers Name / Company: <u>MANU LAVERA - VIS - PWS-07</u>				Sample #								Remarks / Preservation Method
Lab Sample ID.	Sample Location	Date	Time	Type	bottles									
<u>5082 1</u>	<u>915-1 7-12'</u>	<u>1-8-00</u>	<u>1035</u>	<u>AG</u>	<u>3</u>	x	x	x					<u>HCL - 24hr</u>	
<u>2</u>	<u>FIELD DUP. "</u>	<u>"</u>	<u>-</u>	<u>"</u>	<u>"</u>	x	x	x					<u>" - "</u>	
Relinquished by (signature): <u>[Signature]</u>		Date/Time: <u>1-10-00 0800</u>		Received by (signature): <u>[Signature]</u>		Relinquished by (signature):		Date/Time:		Received by (signature):				
Relinquished by (signature):		Date/Time:		Received by (signature):		Relinquished by (signature):		Date/Time:		Received by (signature):				
Report Type: () Full, () Reduced, () Standard, () Screen / non-certified, () EDD						Remarks: <u>SHARED T.O. + F.B. w/ BLOS. 977</u>								
Turnaround time: () Standard 3 wks, () Rush Days, () ASAP Verbal Hrs.														

0000002

METHODOLOGY SUMMARY

000003

Method Summary

EPA Method 624

Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

EPA Method 3510/8270

Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

000004

**CONFORMANCE
NON-CONFORMANC
SUMMARY**

000005

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT

Indicate
Yes, No, N/A

1. Chromatograms labeled/Compounds identified
(Field samples and method blanks) yes
2. Retention times for chromatograms provided yes
3. GC/MS Tune Specifications
 - a. BFB Meet Criteria yes
 - b. DFTPP Meet Criteria yes
4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
6. GC/MS Calibration requirements
 - a. Calibration Check Compounds Meet Criteria yes
 - b. System Performance Check Compounds Meet Criteria yes
7. Blank Contamination – If yes, List compounds and concentrations in each blank: no
 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

If not met, were the calculations checked and the results qualified as "estimated"?

9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

 - a. VOA Fraction _____
 - b. B/N Fraction _____
 - c. Acid Fraction NA

GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)

Indicate
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction _____
- b. B/N Fraction _____
- c. Acid Fraction NA _____

11. Extraction Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

12. Analysis Holding Time Met

yes

If not met, list the number of days exceeded for each sample: _____

Additional Comments:

Laboratory Manager:  Date: 5-8-00

LABORATORY CHRONICLE

000008

Laboratory Chronicle

Lab ID: 5082 Site: Bldg. 915

	Date	Hold Time
Date Sampled	01/08/00	NA
Receipt/Refrigeration	01/08/00	NA
Extractions		
1. Base Neutral	01/10/00	14 days
Analyses		
1. Volatile Organics	01/11,12/00	14 days
2. Base Neutral	01/11/00	40 days

- Samples collected and refrigerated on 01/08/00, Laboratory received the sample on Monday 01/10/00.

000009

**VOLATILE
ORGANICS**

000010

US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY
NJDEPE # 13461

Definition of Qualifiers

- MDL** : Method Detection Limit
- J** : Compound identified below detection limit
- B** : Compound in both sample and blank
- D** : Results from dilution of sample
- U** : Compound searched for but not detected
- E** : Compound exceeds calibration limit

000011

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001962.D**
 Operator **Skelton**
 Date Acquired **11 Jan 2000 11:17 am**

Sample Name **Vblk51**
 Field ID **Vblk51**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Vblk51

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 5081 Location: 915 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Vblk51
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001962.D
Level: (low/med) LOW Date Received: 1/10/00
% Moisture: not dec. _____ Date Analyzed: 1/11/00
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001989.D**
 Operator **Skelton**
 Date Acquired **12 Jan 2000 6:14 am**

Sample Name **5082.01**
 Field ID **915-1**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	660	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6.2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

915-1

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 5081 Location: 915 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 5082.01
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001989.D
Level: (low/med) LOW Date Received: 1/10/00
% Moisture: not dec. _____ Date Analyzed: 1/12/00
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File **VC001990.D**
 Operator **Skelton**
 Date Acquired **12 Jan 2000 6:56 am**

Sample Name **5082.02**
 Field ID **Field Dup**
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
75718	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75343	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156594	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m-p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

Qualifiers

B = Compound found in related blank
 E = Value above linear range
 D = Value from dilution
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit
 NLE = No Limit Established
 R.T. = Retention Time

1E
VOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Field Dup

Lab Name: FMETL NJDEP#: 13461
Project: 100004 Case No.: 5081 Location: 915 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 5082.02
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001990.D
Level: (low/med) LOW Date Received: 1/10/00
% Moisture: not dec. _____ Date Analyzed: 1/12/00
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0
Soil Extract Volume: _____ (uL) Soil Aliquot Volume: _____ (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

VOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK
BROMOFLUOROBENZENE (BFB)

Lab Name: FMETL NJDEP#: 13461
 Project: 100004 Case No.: 5081 Location: 915 SDG No.: _____
 Lab File ID: VC001924.D BFB Injection Date: 1/10/00
 Instrument ID: Voalnst#3 BFB Injection Time: 9:00
 GC Column: RTX502.2 ID: 0.25 (mm) Heated Purge: (Y/N) N

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
50	8.0 - 40.0% of mass 95	18.4
75	30.0 - 66.0% of mass 95	52.8
95	Base peak, 100% relative abundance	100.0
96	5.0 - 9.0% of mass 95	6.6
173	Less than 2.0% of mass 174	0.0 (0.0)1
174	50.0 - 120.0% of mass 95	59.3
175	4.0 - 9.0% of mass 174	4.1 (6.9)1
176	93.0 - 101.0% of mass 174	56.3 (95.0)1
177	5.0 - 9.0% of mass 176	3.1 (5.5)2

1-Value is % mass 174



2-Value is % mass 176

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID:	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	VSTD020	VSTD020	VC001925.D	1/10/00	9:32
02	VSTD010	VSTD010	VC001926.D	1/10/00	10:30
03	VSTD100	VSTD100	VC001928.D	1/10/00	11:52
04	VSTD050	VSTD050	VC001929.D	1/10/00	12:33
05	VSTD005	VSTD005	VC001930.D	1/10/00	13:15
06	VBLK50	VBLK50	VC001931.D	1/10/00	14:08
07	5071.29MS	5071.29MS	VC001957.D	1/11/00	8:05
08	5071.29MSD	5071.29MSD	VC001958.D	1/11/00	8:46

Data File : C:\HPCHEM\1\DATA\000110\VC001924.D
 Acq On : 10 Jan 2000 9:00 am
 Sample : BFB Tune
 Misc : BFB Tune
 MS Integration Params: RTEINT.P
 Method : C:\HPCHEM\1\METHODS\M362417.M (RTE Integrator)
 Title : Volatile Organics by GC/MS Method 624/8260/TCLP

Vial: 1
 Operator: Skelton
 Inst : GC/MS Ins
 Multiplr: 1.00

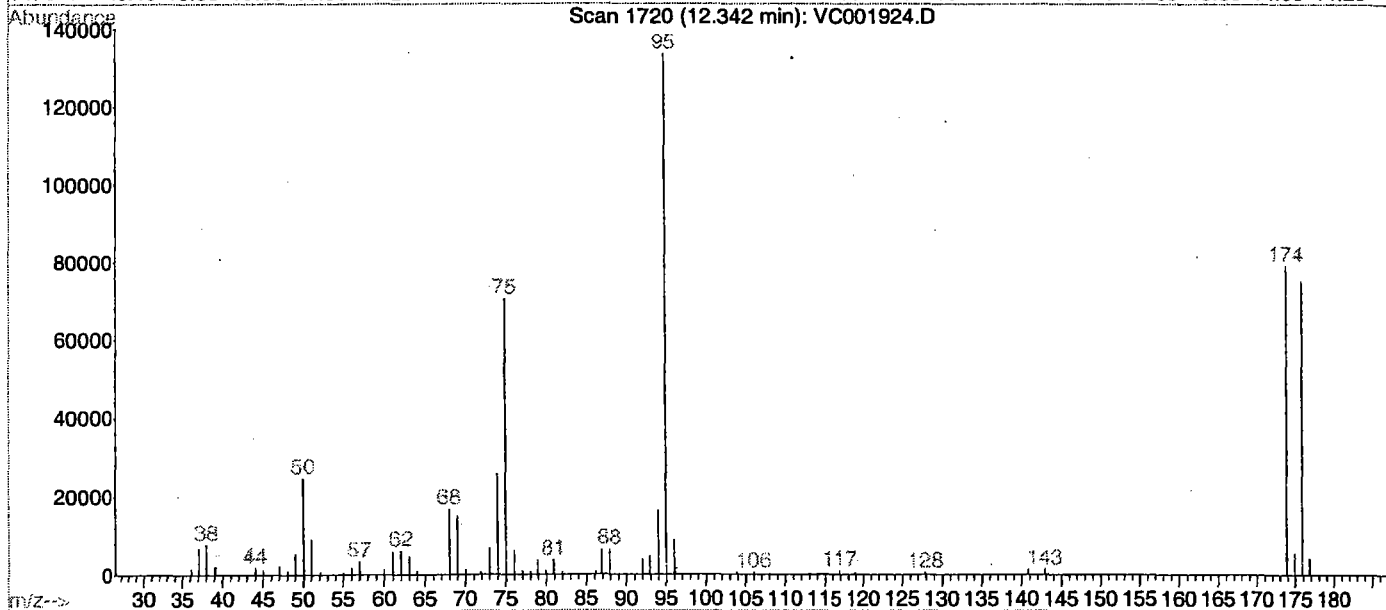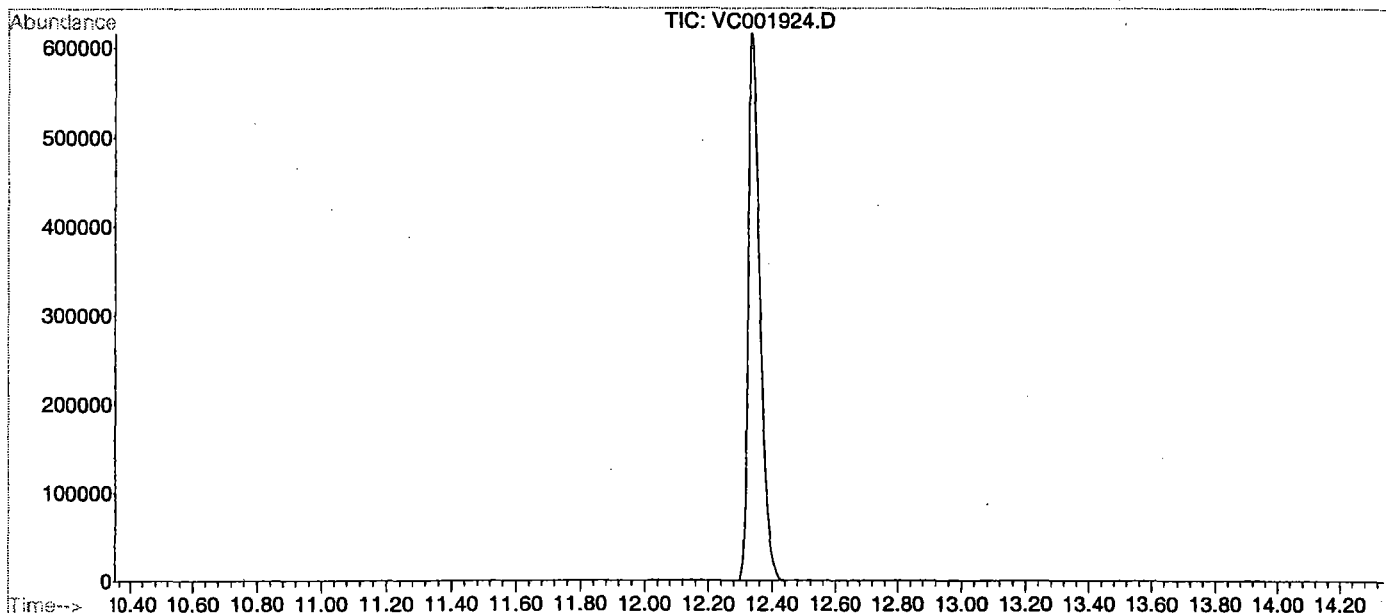

Spectrum Information: Scan 1720

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
50	95	15	40	18.4	24568	PASS
75	95	30	60	52.8	70520	PASS
95	95	100	100	100.0	133504	PASS
96	95	5	9	6.6	8789	PASS
173	174	0.00	2	0.0	0	PASS
174	95	50	100	59.3	79112	PASS
175	174	5	9	6.9	5442	PASS
176	174	95	101	95.0	75160	PASS
177	176	5	9	5.5	4130	PASS

BASE NEUTRAL

000037

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BNA03543.D**
 Operator **Bhaskar**
 Date Acquired **11-Jan-00**

Sample Name **Sblk335**
 Misc Info **Sblk335 A 000110**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report
Page 2

Data File Name **BNA03543.D**
Operator **Bhaskar**
Date Acquired **11-Jan-00**

Sample Name **Sblk335**
Misc Info **Sblk335 A 000110**
Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
D= Value from dilution
B= Compound in Related Blank
PQL= Practical Quantitation Limit

MDL= Method Detection Limit
NLE= No Limit Established
R.T.=Retention Time

1F

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Sblk335

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5082 Location Bld.915 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: Sblk335
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03543.D
Level: (low/med) LOW Date Received: 1/10/00
% Moisture: _____ decanted: (Y/N) N Date Extracted: 1/10/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 1/11/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BNA03540.D**
 Operator **Bhaskar**
 Date Acquired **11-Jan-00**

Sample Name **5082.01**
 Misc Info **915-1**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report
Page 2

Data File Name **BNA03540.D**
Operator **Bhaskar**
Date Acquired **11-Jan-00**

Sample Name **5082.01**
Misc Info **915-1**
Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
D= Value from dilution
B= Compound in Related Blank
PQL= Practical Quantitation Limit

MDL= Method Detection Limit
NLE= No Limit Established
R.T.=Retention Time

1F
SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET FIELD ID
TENTATIVELY IDENTIFIED COMPOUNDS

915-1

Lab Name: FMETL Lab Code 13461
Project 100004 Case No.: 5082 Location Bld.915 SDG No.: _____
Matrix: (soil/water) WATER Lab Sample ID: 5082.01
Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03540.D
Level: (low/med) LOW Date Received: 1/10/00
% Moisture: _____ decanted: (Y/N) N Date Extracted: 1/10/00
Concentrated Extract Volume: 1000 (uL) Date Analyzed: 1/11/00
Injection Volume: 1.0 (uL) Dilution Factor: 1.0
GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

Semi-Volatile Analysis Report
U.S. Army, Fort Monmouth Environmental Laboratory
NJDEP Certification #13461

Data File Name **BNA03541.D**
 Operator **Bhaskar**
 Date Acquired **11-Jan-00**

Sample Name **5082.02**
 Misc Info **Field Dup.**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

Semi-Volatile Analysis Report

Page 2

Data File Name **BNA03541.D**
 Operator **Bhaskar**
 Date Acquired **11-Jan-00**

Sample Name **5082.02**
 Misc Info **Field Dup.**
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

Qualifiers

E= Value Exceeds Linear Range
 D= Value from dilution
 B= Compound in Related Blank
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit
 NLE= No Limit Established
 R.T.=Retention Time

Page 2 of 2

000045

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Field Dup.

Lab Name: FMETL Lab Code 13461

Project 100004 Case No.: 5082 Location Bld.915 SDG No.: _____

Matrix: (soil/water) WATER Lab Sample ID: 5082.02

Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03541.D

Level: (low/med) LOW Date Received: 1/10/00

% Moisture: _____ decanted: (Y/N) N Date Extracted: 1/10/00

Concentrated Extract Volume: 1000 (uL) Date Analyzed: 1/11/00

Injection Volume: 1.0 (uL) Dilution Factor: 1.0

GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

Laboratory Manager or Environmental Consultant's Signature

Date 5/31/00

Laboratory Certification #13461

*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance.

000074

Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.



Daniel K. Wright
Laboratory Manager

000075

APPENDIX G
PHOTOGRAPHS



3-23-98-B915
HOLE LOOKS CLEAN!



B. 915
3/23/98


MARCH 23, 1998
PHOTOGRAPHIC LOG

UST NO. 81533-153

Building 915
Main Post-West
Fort Monmouth


VERSAR
Engineers, Managers, Scientists & Planners
Bristol, PA

APPENDIX H
ELECTRONIC DATA DELIVERABLES

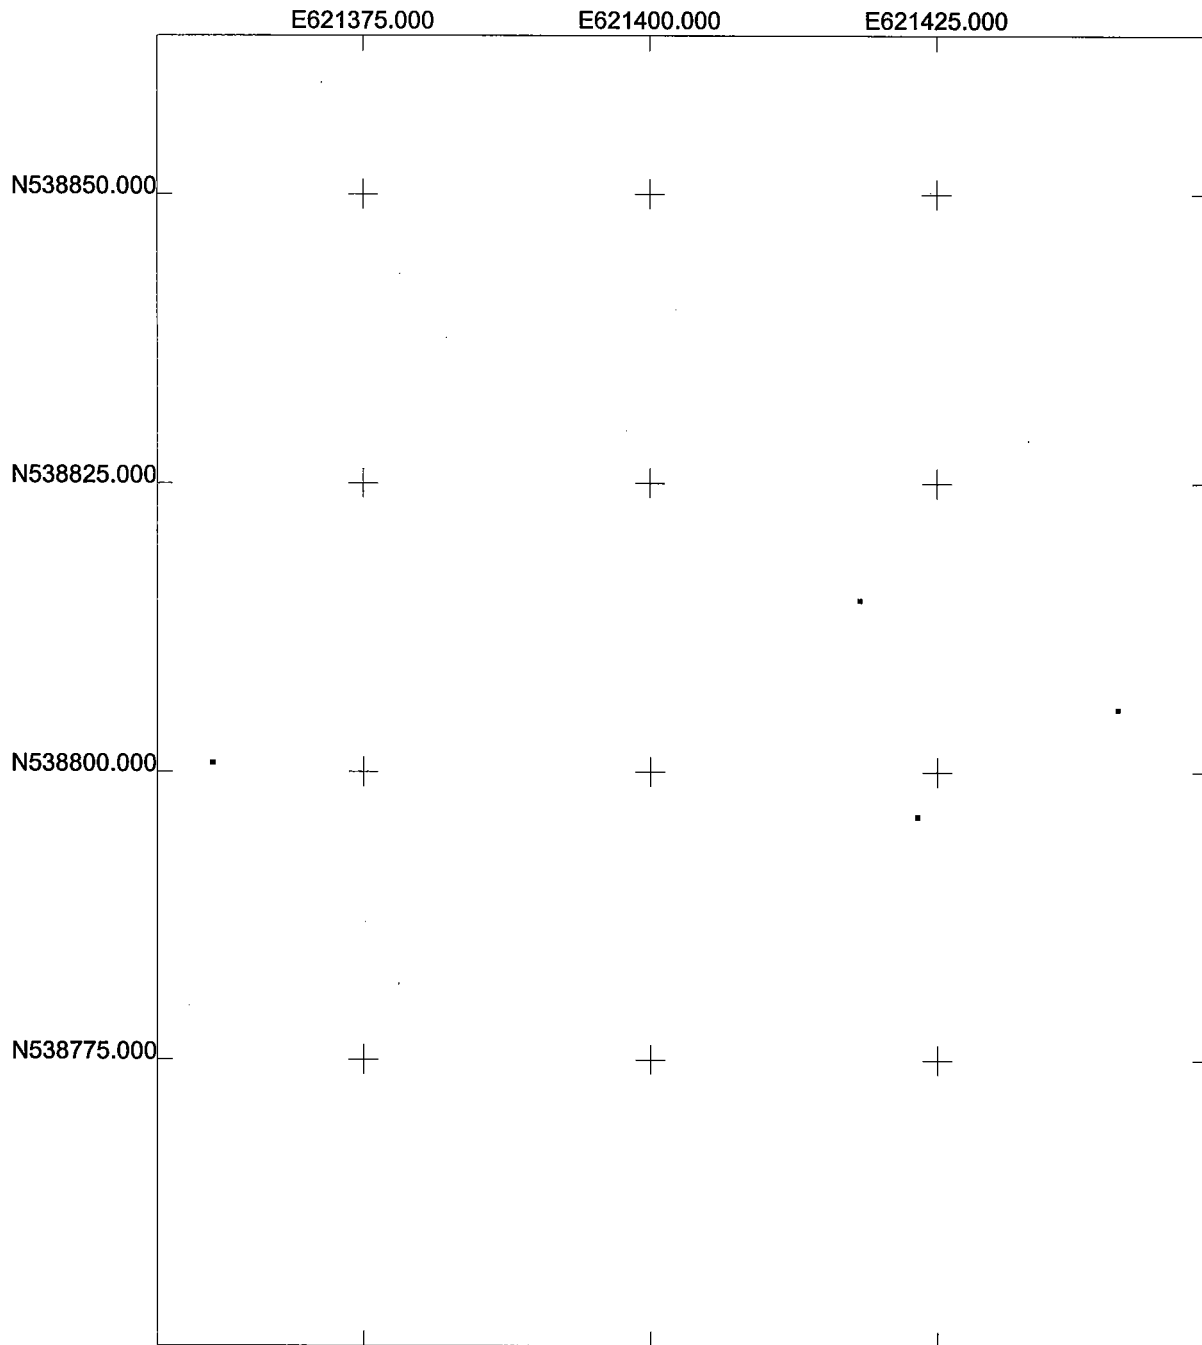

Bldg. 915 UST Ground Water Sample GPS Map

US State Plane 1983
New Jersey (NY East) 2900
NAD 1983 (Conus)

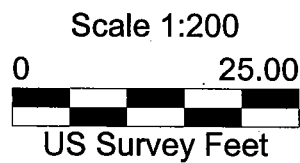

gw bldg 915.ssf
5/19/2000
Pathfinder Office
 **Trimble**

BLDG. 915 UST GROUND WATER SAMPLE GPS POSITION & COORDINATES

US STATE PLANE 1983 NJ (NY EAST) 2900 NAD 1983 (CONUS)


(IN US SURVEY FEET)

SAMPLE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
915 GW (GW denotes <u>G</u> round <u>W</u> ater)	538796.207	621423.214


REFERENCE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTHING)</u>	<u>X COORD. (EASTING)</u>
BLDG. 915 CORNER	538814.933	621418.216
FIRE HYDRANT	538805.463	621440.579
BLDG. 918 CORNER	538800.866	621361.883

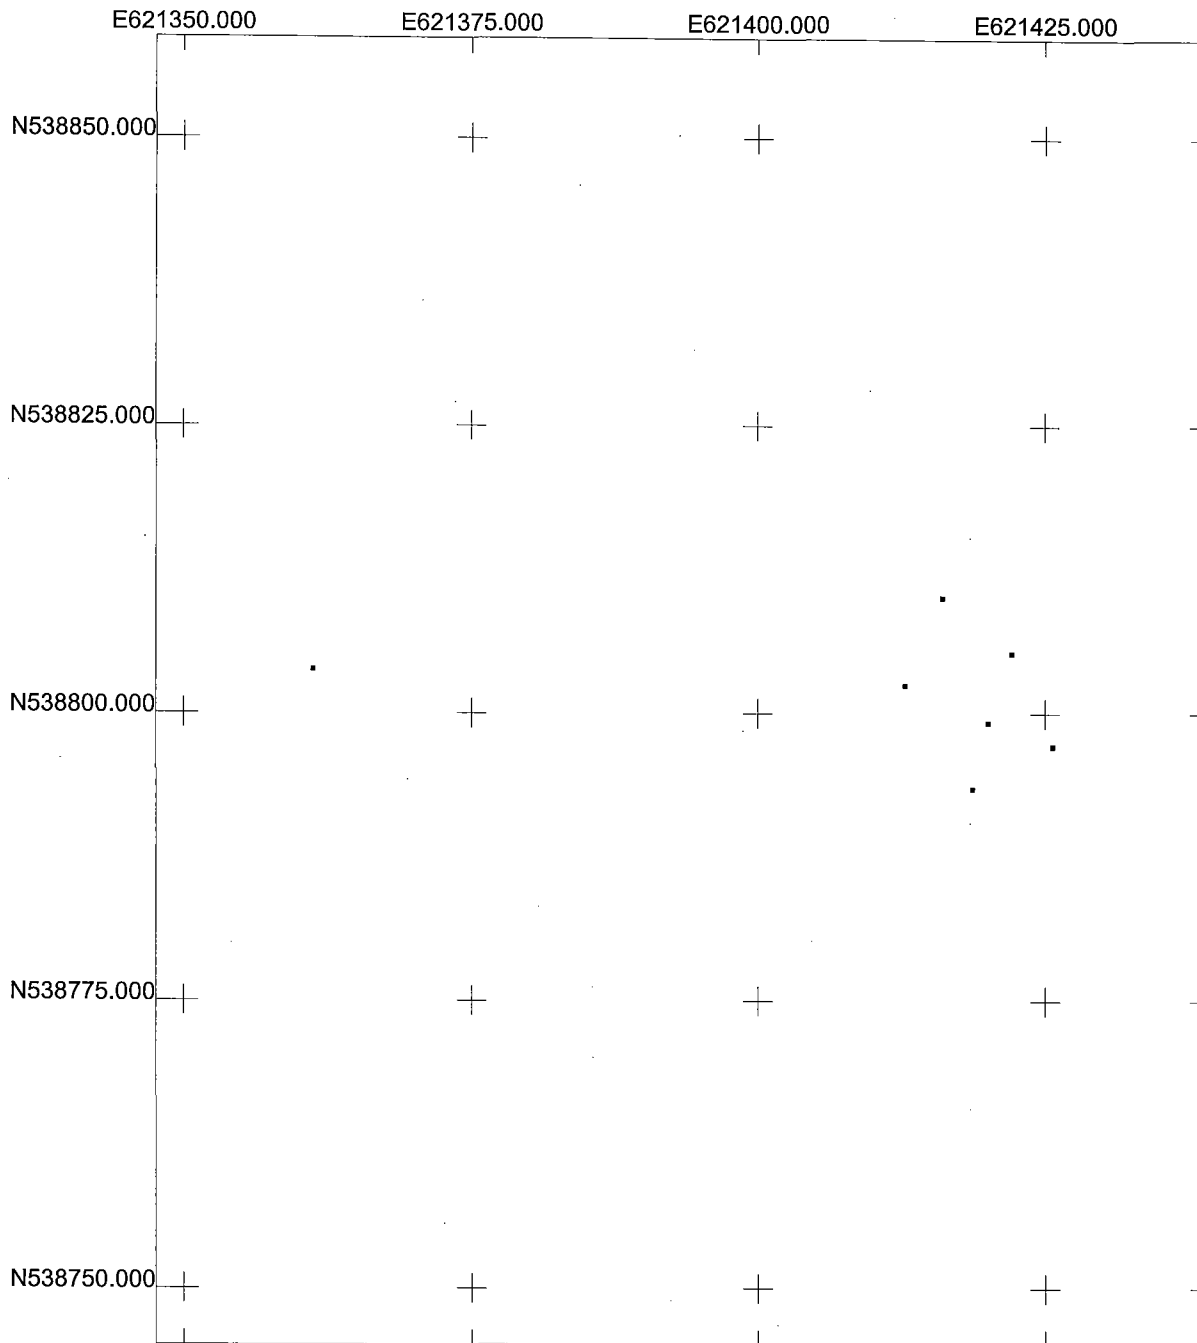

Bldg. 915 UST Site Samples GPS Map

US State Plane 1983
 New Jersey (NY East) 2900
 NAD 1983 (Conus)

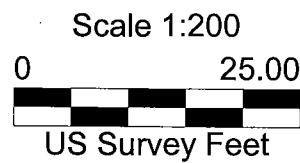

r010419a.cor
 7/11/2000
 Pathfinder Office
Trimble

BLDG. 915 UST SITE SAMPLES GPS POSITION & COORDINATES

US STATE PLANE 1983 NJ (NY EAST) 2900 NAD 1983 (CONUS)

(IN US SURVEY FEET)

SAMPLE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTING)</u>	<u>X COORD. (EASTING)</u>
915 A	538799.275	621419.99
915 B	538802.517	621412.754
915 C	538797.213	621425.598
915 D	538793.494	621418.56
915 E	538805.302	621422.009
915 F	538810.119	621415.977

REFERENCE POINTS

<u>POSITION / DESC.</u>	<u>Y COORD. (NORTING)</u>	<u>X COORD. (EASTING)</u>
918 BLDG. CORNER	538803.859	621361.131