

**United States Army**  
Fort Monmouth, New Jersey

---

**Underground Storage Tank  
Closure and Site Investigation  
Report**

***Building 1006  
Main Post-West Area***

---

**NJDEP UST Registration No. 81533-159**

**March 2000**

**UNDERGROUND STORAGE TANK  
CLOSURE AND SITE INVESTIGATION REPORT**

**BUILDING 1006**

**MAIN POST-WEST AREA  
NJDEP UST REGISTRATION NO. 81533-159**

**MARCH 2000**

**PREPARED FOR:**

**UNITED STATES ARMY, FORT MONMOUTH, NEW JERSEY  
DIRECTORATE OF PUBLIC WORKS  
BUILDING 167  
FORT MONMOUTH, NJ 07703**

**PREPARED BY:**

**VERSAR  
1900 FROST ROAD  
SUITE 110  
BRISTOL, PA 19007**

**PROJECT NO. 4435-018**

# TABLE OF CONTENTS

<b>EXECUTIVE SUMMARY</b>	<b>iv</b>
<b>1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES</b>	<b>1</b>
<b>1.1 OVERVIEW</b>	<b>1</b>
<b>1.2 SITE DESCRIPTION</b>	<b>2</b>
<b>1.2.1 Geological/Hydrogeological Setting</b>	<b>2</b>
<b>1.3 HEALTH AND SAFETY</b>	<b>4</b>
<b>1.4 REMOVAL OF UNDERGROUND STORAGE TANK</b>	<b>4</b>
<b>1.4.1 General Procedures</b>	<b>4</b>
<b>1.4.2 Underground Storage Tank Excavation and Cleaning</b>	<b>4</b>
<b>2.0 SITE INVESTIGATION ACTIVITIES</b>	<b>5</b>
<b>2.1 OVERVIEW</b>	<b>5</b>
<b>2.2 SOIL SAMPLING</b>	<b>6</b>
<b>2.3 GROUNDWATER SAMPLING</b>	<b>6</b>
<b>3.0 CONCLUSIONS AND RECOMMENDATIONS</b>	<b>7</b>
<b>3.1 SOIL SAMPLING RESULTS</b>	<b>7</b>
<b>3.2 GROUNDWATER SAMPLING RESULTS</b>	<b>7</b>
<b>3.3 CONCLUSIONS AND RECOMMENDATIONS</b>	<b>8</b>

## TABLE OF CONTENTS (CONTINUED)

### TABLES

<b>Table 1</b>	<b>Summary of Post-Excavation Sampling Activities</b>
<b>Table 2</b>	<b>Post-Excavation Soil Sampling Results</b>
<b>Table 3</b>	<b>Groundwater Sampling Results</b>

### FIGURES

<b>Figure 1</b>	<b>Site Location Map</b>
<b>Figure 1A</b>	<b>Geological Map</b>
<b>Figure 2</b>	<b>Site Map</b>
<b>Figure 3</b>	<b>Soil Sampling Location Map</b>
<b>Figure 4</b>	<b>Groundwater Sampling Location Map</b>

### APPENDICES

<b>Appendix A</b>	<b>NJDEP Standard Reporting Form</b>
<b>Appendix B</b>	<b>Site Assessment Summary</b>
<b>Appendix C</b>	<b>Waste Manifest</b>
<b>Appendix D</b>	<b>Soil Analytical Data Package</b>
<b>Appendix E</b>	<b>Groundwater Analytical Data Package</b>
<b>Appendix F</b>	<b>Electronic Data Deliverables</b>

## EXECUTIVE SUMMARY

### Site Assessment

The site assessment was performed by U.S. Army personnel in accordance with the NJDEP *Technical Requirements for Site Remediation* (N.J.A.C. 7:26E) and the NJDEP *Field Sampling Procedures Manual*. The sampling and laboratory analysis conducted during the site assessment were performed in accordance with Section 7:26E-2.1 of the *Technical Requirements for Site Remediation*.

Fort Monmouth has identified that UST # 81533-159 was closed at some time prior to January 1, 1991. On May 5, 1998, the site was excavated in anticipation of the removal of the UST. After a great deal of exploration, no UST was found. Piping from the UST was found. The piping included a vent, oil product and return lines as well as a remote fill pipe. The remote fill pipe was pressure tested and abandoned IAW NJDEP requirements.

On November 13, 1999, and January 8, 2000, a more detailed site investigation was conducted at Building 1006. Using site maps and test pits, four (4) soil samples and two (2) groundwater samples were taken at the location of the former UST.

All post excavation soil samples collected from the UST excavation at Building 1006 contained TPHC concentrations below the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 milligrams per kilogram (mg/kg) (N.J.A.C. 7:26D and revisions dated February 3, 1994).

The two (2) groundwater samples collected at Building 1006 on November 13, 1999, and January 8, 2000, were sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). All groundwater analytical results were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 81533-159 at Building 1006.

# 1.0 UNDERGROUND STORAGE TANK DECOMMISSIONING ACTIVITIES

## 1.1 OVERVIEW

One underground storage tank (UST), New Jersey Department of Environmental Protection (NJDEP) Registration No. 81533-159, was closed at Building 1006 at the Main Post-West area of U.S. Army Fort Monmouth, Fort Monmouth, New Jersey. Refer to the site location map on Figure 1. This report presents the results of the Department of Public Works' (DPW) implementation of the UST Decommissioning/Closure Plan approved by the NJDEP. The UST was a steel 2,000-gallon tank containing No. 2 fuel oil.

Decommissioning activities for UST No. 81533-159 complied with all applicable Federal, State, and Local laws and ordinances in effect at the date of decommissioning. These laws included but were not limited to N.J.A.C. 7:14B-1 et seq., N.J.A.C. 5:23-1 et seq., and Occupational Safety and Health Administration (OSHA) 1910.146 & 1910.120. All permits including but not limited to the NJDEP approved Decommissioning/Closure Plan were posted onsite for inspection. The decommissioning activities were conducted by DPW personnel who are registered and certified by the NJDEP for performing UST closure activities. Closure of UST No. 81533-159 proceeded under the approval of the NJDEP Bureau of Federal Case Management (NJDEP-BFCM). The Standard Reporting Form and signed Site Assessment Summary form for UST No. 81533-159 are included in Appendices A and B, respectively.

This UST Closure and Site Investigation Report has been prepared by Versar, to assist the U.S. Army DPW in complying with the NJDEP regulations. The applicable NJDEP regulations at the date of closure were the *Interim Closure Requirements for Underground Storage Tank Systems* (N.J.A.C. 7:14B-1 et seq. October 1990 and revisions dated November 1, 1991).

This report was prepared using information collected at the time of closure. Section 1 of this UST Closure and Site Investigation Report provides a summary of the UST decommissioning activities. Section 2 of this report describes the site investigation activities. Conclusions and recommendations, including the results of the soil sampling and groundwater investigation, are presented in the final section of this report.

## 1.2 SITE DESCRIPTION

Building 1006 is located in the Main Post-West area of the Fort Monmouth Army Base. UST No. 0081533-159 was located northwest of Building 1006 and appurtenant copper piping ran approximately two (2) feet southeast from the excavation to Building 1006. A site map is provided on Figure 2.

### 1.2.1 Geological/Hydrogeological Setting

The following is a description of the geological/hydrogeological setting of the area surrounding Building 1006. Included is a description of the regional geology of the area surrounding Fort Monmouth as well as descriptions of the local geology and hydrogeology of the Main Post area. A geological map is provided on Figure 1A.

#### Regional Geology

Monmouth County lies within the New Jersey Section of the Atlantic Coastal Plain physiographic province. The Main Post, Charles Wood, and the Evans areas are located in what may be referred to as the Outer Coastal Plain subprovince, or the Outer Lowlands.

In general, New Jersey Coastal Plain formations consist of a seaward-dipping wedge of unconsolidated deposits of clay, silt, and gravel. These formations typically strike northeast-southwest with a dip ranging from 10 to 60 feet per mile and were deposited on Precambrian and lower Paleozoic rocks (Zapeczka, 1989). These sediments, predominantly derived from deltaic, shallow marine, and continental shelf environments, date from Cretaceous through the Quaternary Periods. The mineralogy ranges from quartz to glauconite.

The formations record several major transgressive/regressive cycles and contain units which are generally thicker to the southeast and reflect a deeper water environment. More than 20 regional geologic units are present within the sediments of the Coastal Plain. Regressive, upward coarsening deposits are usually aquifers (e.g., Englishtown and Kirkwood Formations, and the Cohansey Sand) while the transgressive deposits act as confining units (e.g., the Merchantville, Marshalltown, and Navesink Formations). The individual thicknesses for these units vary greatly (i.e., from several feet to several hundred feet). The Coastal Plain deposits thicken to the southeast from the Fall Line to greater than 6,500 feet in Cape May County (Brown and Zapeczka, 1990).

#### Local Geology

Based on the regional geologic map (Jablonski, 1968), the Cretaceous age Red Bank and Tinton Sands outcrop at the Main Post area. The Red Bank sand conformably overlies the Navesink Formation and dips to the southeast at 35 feet per mile. The upper member (Shrewsbury) of the Red Bank sand is a yellowish-gray to reddish brown clayey, medium-to-coarse-grained sand that contains abundant rock fragments, minor mica and glauconite (Jablonski). The lower member (Sandy Hook) is a dark gray to black, medium-to-fine grained sand with abundant clay, mica, and glauconite.

The Tinton sand conformably overlies the Red Bank Sand and ranges from a clayey medium to very coarse grained feldspathic quartz and glauconite sand to a glauconitic coarse sand. The color varies from dark yellowish orange or light brown to moderate brown and from light olive to grayish olive. Glauconite may constitute 60 to 80 percent of the sand fraction in the upper part of the unit (Minard, 1969). The upper part of the Tinton is often highly oxidized and iron oxide encrusted (Minard).

### Hydrogeology

The water table aquifer in the Main Post area is identified as part of the "composite confining units," or minor aquifers. The minor aquifers include the Navesink formation, Red Bank Sand, Tinton Sand, Hornerstown Sand, Vincentown Formation, Manasquan Formation, Shark River Formation, Piney Point Formation, and the basal clay of the Kirkwood Formation.

Based on records of wells drilled in the Main Post area, water is typically encountered at depths of 2 to 9 feet below ground surface (bgs). According to Jablonski, wells drilled in the Red Bank and Tinton Sands may produce 2 to 25 gallons per minute (gpm). Some well owners have reported acidic water that requires treatment to remove iron.

Due to the proximity of the Atlantic Ocean to Fort Monmouth, shallow groundwater may be tidally influenced and may flow toward creeks and brooks as the tide goes out, and away from creeks and brooks as the tide comes in. However, an abundance of clay lenses and sand deposits were noted in borings installed throughout Fort Monmouth. Therefore, the direction of shallow groundwater should be determined on a case-by-case basis.

Shallow groundwater is locally influenced within the Main Post area by the following factors:

- tidal influence (based on proximity to the Atlantic Ocean, rivers, and tributaries)
- topography
- nature of the fill material within the Main Post area
- presence of clay and silt lenses in the natural overburden deposits
- local groundwater recharge areas (i.e., streams, lakes)

Due to the fluvial nature of the overburden deposits (i.e., sand and clay lenses), shallow groundwater flow direction is best determined on a case-by-case basis. This is consistent with lithologies observed in borings installed within the Main Post area, which primarily consisted of fine-to-medium grained sands, with occasional lenses or laminations of gravel silt and/or clay.

Building 1006 is located approximately 2000 feet south of Husky Brook, the nearest water body. Based on the Main Post topography, the groundwater flow in the area of Building 1006 is anticipated to be to the north.

### **1.3 HEALTH AND SAFETY**

Before, during, and after all decommissioning activities, hazards at the work site which may have posed a threat to the Health and Safety of all personnel who were involved with, or were affected by, the decommissioning of the UST system were minimized. All areas, which posed, or may have been suspected to pose a vapor hazard were monitored by a qualified individual utilizing an organic vapor analyzer (OVA). The individual ascertained if the area was properly vented to render the area safe, as defined by OSHA.

### **1.4 REMOVAL OF UNDERGROUND STORAGE TANK**

#### **1.4.1 General Procedures**

- The contractor performing the closure prior to excavation activities identified all underground obstructions (utilities, etc.).
- All activities were carried out with the greatest regard to safety and health and the safeguarding of the environment.
- All excavated soils were visually examined and screened with an OVA for evidence of contamination. Potentially contaminated soils were identified and logged during closure activities.
- Surface materials (i.e., asphalt, concrete, etc.) were excavated and staged separately from all soil and recycled in accordance with all applicable regulations and laws.
- A Sub-Surface Evaluator from the DPW was present during all site assessment activities.

#### **1.4.2 Underground Storage Tank Excavation and Cleaning**

Fort Monmouth has identified that UST # 81533-159 was closed at some time prior to January 1, 1991. On May 5, 1998, the site was excavated in anticipation of the removal of the UST. After much exploration, no UST was found. Piping from the UST was found. The piping included a vent, oil product and return lines as well as a remote fill pipe. The remote fill pipe was pressure tested and abandoned IAW NJDEP requirements. Approximately 5 gallons of liquid from the piping were transported by Casie Protank to Casie Ecology Oil Salvage, Inc. facility, a NJDEP-approved petroleum recycling and disposal company located in Vineland, New Jersey. Refer to Appendix C for the waste manifest.

## 2.0 SITE INVESTIGATION ACTIVITIES

### 2.1 OVERVIEW

The Site Investigation was managed and carried out by U.S. Army DPW personnel. All analyses were performed and reported by U.S. Army Fort Monmouth Environmental Laboratory, a NJDEP certified testing laboratory. All sampling was performed under the direct supervision of a NJDEP Certified Sub-Surface Evaluator according to the methods described in the NJDEP *Field Sampling Procedures Manual* (1992). Sampling frequency and parameters analyzed complied with the NJDEP document *Interim Closure Requirements for Underground Storage Tank Systems* (October 1990 and revisions dated November 1, 1991) which was the applicable regulation at the date of the closure. The Fort Monmouth DPW Environmental Office maintains all records of the Site Investigation activities.

The following Parties participated in Closure and Site Investigation Activities:

- Subsurface Evaluator: Charles Appleby  
Employer: U.S. Army, Fort Monmouth  
Phone Number: (908) 532-0989  
NJDEP Certification No.: 2056
- Analytical Laboratory: U.S. Army Fort Monmouth Environmental laboratory  
Contact Person: Daniel K. Wright  
Phone Number: (908) 532-4359  
NJDEP Company Certification No.: 13461
- Hazardous Waste Hauler: Casie Protank Environmental Services  
Contact Person: Shawn Lee  
Phone Number: (609) 696-4401  
NJDEP Company Certification No.: 16931

## 2.2 SOIL SAMPLING

On November 13, 1999, following the site investigation, four (4) soil samples 1, 2, 3, 4, and DUP 2 were collected at a depth of 8.5 feet bgs. All samples were analyzed for total petroleum hydrocarbons (TPHC) and total solids.

U.S. Army personnel in accordance with the NJDEP Technical Requirements and the NJDEP Field Sampling Procedures Manual performed the site assessment. A summary of sampling activities including parameters analyzed is provided in Table 1. The post-excavation soil samples were collected using NJDEP *Field Sampling Procedures Manual* (1992) standard sampling procedures. Following soil sampling activities, the samples were chilled and delivered to U.S. Army Fort Monmouth Environmental Laboratory located in Fort Monmouth, New Jersey, for analysis.

## 2.3 GROUNDWATER SAMPLING

On November 13, 1999, and January 8, 2000, Building 1006 was sampled for volatile organic compounds calibrated for xylene plus 15 tentatively identified compounds (VOC's), and semivolatile organic compounds plus 15 tentatively identified compounds (SVOC's). Sampling and analysis were performed in accordance with the NJDEP *Field Sampling Procedures Manual* and the *Technical Requirements For Site Remediation*.

## **3.0 CONCLUSIONS AND RECOMMENDATIONS**

### **3.1 SOIL SAMPLING RESULTS**

To evaluate soil conditions, four (4) soil samples were collected on November 13, 1999. All samples were analyzed for TPHC and total solids. The post-excavation sampling results were compared to the NJDEP residential direct contact total organic contaminants soil cleanup criteria of 10,000 mg/kg (N.J.A.C. 7:26D and revisions dated February 3, 1994). A summary of the analytical results and comparison to the NJDEP soil cleanup criteria is provided in Table 2 and the soil sampling locations are shown on Figure 3. The analytical data package is provided in Appendix D.

All post-excavation soil samples collected on November 13, 1999, from the UST excavation and from below piping associated with the UST contained concentrations of TPHC below the NJDEP soil cleanup criteria. Soil samples contained TPHC concentrations ranging from non-detect to 192.96 mg/kg.

### **3.2 GROUNDWATER SAMPLING RESULTS**

No compounds were detected in the samples collected from Building 1006 on November 13, 1999, and January 8, 2000.

A summary of the analytical results and comparison to the NJDEP groundwater cleanup criteria is provided in Table 3 and the groundwater sampling locations are shown on Figure 4. The analytical data package is provided in Appendix E. The full data package, including quality control, is on file at U.S. Army Fort Monmouth, Fort Monmouth, New Jersey.

Groundwater samples collected on November 13, 1999, and January 8, 2000, were either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 81533-159 at Building 1006.

### 3.3 CONCLUSIONS AND RECOMMENDATIONS

The analytical results for all post-excavation soil samples collected from the UST closure excavation at Building 1006 were below the NJDEP soil cleanup criteria for total organic contaminants.

Based on the post-excavation sampling results, soil with TPHC concentrations exceeding the NJDEP soil cleanup criteria for total organic contaminants of 10,000 mg/kg, do not exist in the former location of the UST or associated piping.

Based on the analytical results of the groundwater samples collected at Building 1006 on November 13, 1999, and January 8, 2000, groundwater quality at Building 1006 was either below the detection limit or in compliance with the New Jersey Ground Water Quality Criteria (GWQC).

No further action is proposed in regard to the closure and site assessment of UST No. 81533-159 at Building 1006.

f-1  
f-2  
f-3  
f-4  
f-5  
f-6  
f-7  
f-8  
f-9  
f-10  
f-11  
f-12  
f-13  
f-14  
f-15  
f-16  
f-17  
f-18  
f-19  
f-20  
f-21  
f-22  
f-23  
f-24  
f-25  
f-26  
f-27  
f-28  
f-29  
f-30  
f-31  
f-32  
f-33  
f-34  
f-35  
f-36  
f-37  
f-38  
f-39  
f-40  
f-41  
f-42  
f-43  
f-44  
f-45  
f-46  
f-47  
f-48  
f-49  
f-50  
f-51  
f-52  
f-53  
f-54  
f-55  
f-56  
f-57  
f-58  
f-59  
f-60  
f-61  
f-62  
f-63  
f-64  
f-65  
f-66  
f-67  
f-68  
f-69  
f-70  
f-71  
f-72  
f-73  
f-74  
f-75  
f-76  
f-77  
f-78  
f-79  
f-80  
f-81  
f-82  
f-83  
f-84  
f-85  
f-86  
f-87  
f-88  
f-89  
f-90  
f-91  
f-92  
f-93  
f-94  
f-95  
f-96  
f-97  
f-98  
f-99  
f-100

**TABLES**

TABLE 1

SUMMARY OF POST-EXCAVATION SAMPLING ACTIVITIES  
 BUILDING 1006, MAIN POST-WEST AREA  
 FORT MONMOUTH, NEW JERSEY

Page 1 of 2

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	NJDEP Method
1	11/13/99	11/17/99	Soil	Post-Excavation	TPHC	OQA-QAM-025
2	11/13/99	11/17/99	Soil	Post-Excavation	TPHC	OQA-QAM-025
3	11/13/99	11/17/99	Soil	Post-Excavation	TPHC	OQA-QAM-025
4	11/13/99	11/17/99	Soil	Post-Excavation	TPHC	OQA-QAM-025
DUP 2	11/13/99	11/17/99	Soil	Post-Excavation	TPHC	OQA-QAM-025

Note:

\* TPHC Total Petroleum Hydrocarbons

TABLE 1

SUMMARY OF SAMPLING ACTIVITIES  
BUILDING 1006, MAIN POST-WEST AREA  
FORT MONMOUTH, NEW JERSEY

Page 2 of 2

---

Sample ID	Date of Collection	Date Analysis Started	Matrix	Sample Type	Analytical Parameters*	Sampling Method**
4937.08	11/13/99	11/16/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
5009.01	12/11/99	12/13/99	Aqueous	Groundwater	VOCs, SVOCs	PPNDP
5081.01	1/8/00	1/10/00	Aqueous	Groundwater	VOCs, SVOCs	PPNDP

## Note:

- \*VOCs: Volatile Organic Compounds plus 15 tentatively identified compounds  
\*SVOCs: Semivolatile organic compounds plus 15 tentatively identified compounds  
\*\*PPNDP: Passively Placed Narrow Diameter Point

TABLE 2

POST-EXCAVATION SOIL SAMPLING RESULTS  
 BUILDING 1006, MAIN POST-WEST AREA  
 FORT MONMOUTH, NEW JERSEY

Page 1 of 1

Sample ID/ Depth	Sample Laboratory ID	Sample Date	Analysis Date	Analytical Parameters	Method Detection Limit (mg/kg)	Compound of Concern	Results (mg/kg) *	NJDEP Soil Cleanup Criteria ** (mg/kg)	Exceeds Cleanup Criteria
1/8.5' =	4937.03	11/13/99	11/17/99	Total Solid	--	--	95.29 %	--	--
				TPHC	145	yes	157.44	10,000	No
2/8.5' =	4937.04	11/13/99	11/17/99	Total Solid	--	--	92.86 %	--	--
				TPHC	167	Yes	177.07	10,000	No
3/8.5' =	4937.05	11/13/99	11/17/99	Total Solid	--	--	93.79 %	--	--
				TPHC	167	Yes	ND	10,000	No
4/8.5' =	4937.06	11/13/99	11/17/99	Total Solid	--	--	94.61 %	--	--
				TPHC	159	yes	192.96	10,000	No
DUP 2/8.5' =	4937.08	11/13/99	11/17/99	Total Solid	--	--	94.24 %	--	--
				TPHC	163	Yes	ND	10,000	No

## Note:

- \* Total Solid results are expressed as a percentage.
- \*\* NJDEP Residential Direct Contact soil cleanup criteria for total organics
- \*\*\* Sample location was further remediated and resampled
- ND Not detected above stated method detection limit
- TPHC Total Petroleum Hydrocarbons

Table 3  
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER  
 Date Sampled: 11/13/99 Location: 1006 Lab Sample ID: 4937.08(Bldg 1006)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3  
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER  
 Date Sampled: 11/13/99 Location: 1006 Lab Sample ID: 4937.08(Bldg 1006)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,1,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3  
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 11/13/99Location: 1006Lab Sample ID: 4937.08(Bldg 1006)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3  
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER  
 Date Sampled: 11/13/99 Location: 1006 Lab Sample ID: 4937.08(Bldg 1006)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no

Table 3  
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER  
 Date Sampled: 12/11/99 Location: 1006 Lab Sample ID: 5009.01(Bldg 1006)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
107028	Acrolein	1.85	Not Detected	--	50	no
107131	Acrylonitrile	2.78	Not Detected	--	50	no
75650	tert-Butyl alcohol	8.52	Not Detected	--	nle	no
1634044	Methyl-tert-Butyl ether	0.16	Not Detected	--	nle	no
108203	Di-isopropyl ether	0.25	Not Detected	--	nle	no
	Dichlorodifluoromethane	1.68	Not Detected	--	nle	no
74-87-3	Chloromethane	1.16	Not Detected	--	30	no
75-01-4	Vinyl Chloride	1.06	Not Detected	--	5	no
74-83-9	Bromomethane	1.10	Not Detected	--	10	no
75-00-3	Chloroethane	1.01	Not Detected	--	nle	no
75-69-4	Trichlorofluoromethane	0.50	Not Detected	--	nle	no
75-35-4	1, 1-Dichloroethene	0.24	Not Detected	--	2	no
67-64-1	Acetone	1.36	Not Detected	--	700	no
75-15-0	Carbon Disulfide	0.46	Not Detected	--	nle	no
75-09-2	Methylene Chloride	0.24	Not Detected	--	2	no
156-60-5	trans-1,2-Dichloroethene	0.16	Not Detected	--	100	no
75-35-3	1,1-Dichloroethane	0.12	Not Detected	--	70	no
108-05-4	Vinyl Acetate	0.78	Not Detected	--	nle	no
78-93-3	2-Butanone	0.62	Not Detected	--	300	no
156-59-2	cis-1,2-Dichloroethene	0.17	Not Detected	--	10	no
67-66-3	Chloroform	0.30	Not Detected	--	6	no
75-55-6	1,1,1-Trichloroethane	0.23	Not Detected	--	30	no
56-23-5	Carbon Tetrachloride	0.47	Not Detected	--	2	no
71-43-2	Benzeze	0.23	Not Detected	--	1	no
107-06-2	1,2-Dichloroethane	0.18	Not Detected	--	2	no
79-01-6	Trichloroethene	0.23	Not Detected	--	1	no
78-87-5	1, 2-Dichloropropane	0.40	Not Detected	--	1	no
75-27-4	Bromodichloromethane	0.55	Not Detected	--	1	no
110-75-8	2-Chloroethyl vinyl ether	0.65	Not Detected	--	nle	no
10061-01-5	cis-1,3-Dichloropropene	0.69	Not Detected	--	nle	no

Table 3  
VOLATILE ORGANICS ANALYSIS DATA SHEET

Lab Name: FMETL NJDEP # 13461 Matrix: (soil/water) WATER  
 Date Sampled: 12/11/99 Location: 1006 Lab Sample ID: 5009.01(Bldg 1006)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
108-10-1	4-Methyl-2-Pentanone	0.59	Not Detected	--	400	no
108-88-3	Toluene	0.37	Not Detected	--	1000	no
10061-02-6	trans-1,3-Dichloropropene	0.87	Not Detected	--	nle	no
79-00-5	1,1,2-Trichloroethane	0.48	Not Detected	--	3	no
127-18-4	Tetrachloroethene	0.32	Not Detected	--	1	no
591-78-6	2-Hexanone	0.71	Not Detected	--	nle	no
126-48-1	Dibromochloromethane	0.86	Not Detected	--	10	no
108-90-7	Chlorobenzene	0.39	Not Detected	--	4	no
100-41-4	Ethylbenzene	0.65	Not Detected	--	700	no
1330-20-7	m+p-Xylenes	1.14	Not Detected	--	nle	no
1330-20-7	o-Xylene	0.62	Not Detected	--	nle	no
100-42-5	Styrene	0.56	Not Detected	--	100	no
75-25-2	Bromoform	0.70	Not Detected	--	4	no
79-34-5	1,1,2,2-Tetrachloroethane	0.47	Not Detected	--	2	no
541-73-1	1,3-Dichlorobenzene	0.55	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	0.57	Not Detected	--	75	no
95-50-1	1,2-Dichlorobenzene	0.64	Not Detected	--	600	no

Table 3  
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 1/8/00Location: 1006Lab Sample ID: 5081.01(Bldg 1006)


CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
110-86-1	Pyridine	1.83	Not Detected	--	nle	no
62-75-9	N-nitroso-dimethylamine	0.91	Not Detected	--	20	no
62-53-3	Aniline	1.63	Not Detected	--	nle	no
111-44-4	bis(2-Chloroethyl)ether	1.28	Not Detected	--	10	no
541-73-1	1,3-Dichlorobenzene	1.19	Not Detected	--	600	no
106-46-7	1,4-Dichlorobenzene	1.02	Not Detected	--	75	no
100-51-6	Benzyl alcohol	1.02	Not Detected	--	nle	no
95-50-1	1,2-Dichlorobenzene	1.13	Not Detected	--	600	no
108-60-1	bis(2-chloroisopropyl)ether	1.39	Not Detected	--	300	no
621-64-7	n-Nitroso-di-n-propylamine	1.50	Not Detected	--	20	no
67-72-1	Hexachloroethane	0.97	Not Detected	--	10	no
98-95-3	Nitrobenzene	1.01	Not Detected	--	10	no
78-59-1	Isophorone	1.21	Not Detected	--	100	no
111-91-1	bis(2-Chloroethoxy)methane	1.75	Not Detected	--	nle	no
120-82-1	1,2,4-Trichlorobenzene	1.22	Not Detected	--	9	no
91-20-3	Naphthalene	1.27	Not Detected	--	nle	no
106-47-8	4-Chloroaniline	1.09	Not Detected	--	nle	no
87-68-3	Hexachlorobutadiene	0.71	Not Detected	--	1	no
91-57-6	2-Methylnaphthalene	1.08	Not Detected	--	nle	no
77-47-4	Hexachlorocyclopentadiene	1.32	Not Detected	--	50	no
91-58-7	2-Chloronaphthalene	1.01	Not Detected	--	nle	no
88-74-4	2-Nitroaniline	0.79	Not Detected	--	nle	no
131-11-3	Dimethylphthalate	1.52	Not Detected	--	7000	no
208-96-8	Acenaphthylene	0.96	Not Detected	--	nle	no

Table 3  
SEMI-VOLATILE ANALYSIS DATA SHEET

Lab Name: FMETLNJDEP # 13461Matrix: (soil/water) WATERDate Sampled: 1/8/00Location: 1006Lab Sample ID: 5081.01(Bldg 1006)

CAS NO.	COMPOUND NAME	MDL (ug/L)	RESULTS	QUALIFIER	REGULATORY LEVEL(ug/L)	EXCEEDS CRITERIA
606-20-2	2,6-Dinitrotoluene	0.81	Not Detected	--	nle	no
99-09-2	3-Nitroaniline	0.79	Not Detected	--	nle	no
83-32-9	Acenaphthene	1.10	Not Detected	--	400	no
132-64-9	Dibenzofuran	1.00	Not Detected	--	nle	no
121-14-2	2,4-Dinitrotoluene	0.87	Not Detected	--	10	no
84-66-2	Diethylphthalate	1.62	Not Detected	--	5000	no
86-73-7	Fluorene	0.99	Not Detected	--	300	no
7005-72-3	4-Chlorophenyl-phenylether	1.10	Not Detected	--	nle	no
100-01-6	4-Nitroaniline	1.05	Not Detected	--	nle	no
86-30-6	n-Nitrosodiphenylamine	1.01	Not Detected	--	20	no
103-33-3	Azobenzene	0.67	Not Detected	--	nle	no
101-55-3	4-Bromophenyl-phenylether	0.76	Not Detected	--	nle	no
118-74-1	Hexachlorobenzene	0.94	Not Detected	--	10	no
85-01-8	Phenanthrene	1.23	Not Detected	--	nle	no
120-12-7	Anthracene	1.12	Not Detected	--	2000	no
84-74-2	Di-n-butylphthalate	1.70	Not Detected	--	900	no
206-44-0	Fluoranthene	1.64	Not Detected	--	300	no
92-87-5	Benzidine	4.18	Not Detected	--	50	no
129-00-0	Pyrene	1.25	Not Detected	--	200	no
85-68-7	Butylbenzylphthalate	1.05	Not Detected	--	100	no
56-55-3	Benzo[a]anthracene	1.19	Not Detected	--	10	no
91-94-1	3,3'-Dichlorobenzidine	1.75	Not Detected	--	60	no
218-01-9	Chrysene	1.38	Not Detected	--	20	no
117-81-7	bis(2-Ethylhexyl)phthalate	1.74	Not Detected	--	30	no
117-84-0	Di-n-octylphthalate	1.44	Not Detected	--	100	no
205-99-2	Benzo[b]fluoranthene	1.25	Not Detected	--	10	no
207-08-9	Benzo[k]fluoranthene	1.29	Not Detected	--	2	no
50-32-8	Benzo[a]pyrene	1.05	Not Detected	--	20	no
193-39-5	Indeno[1,2,3-cd]pyrene	0.83	Not Detected	--	20	no
53-70-3	Dibenz[a,h]anthracene	0.64	Not Detected	--	20	no
191-24-2	Benzo[g,h,i]perylene	0.84	Not Detected	--	nle	no



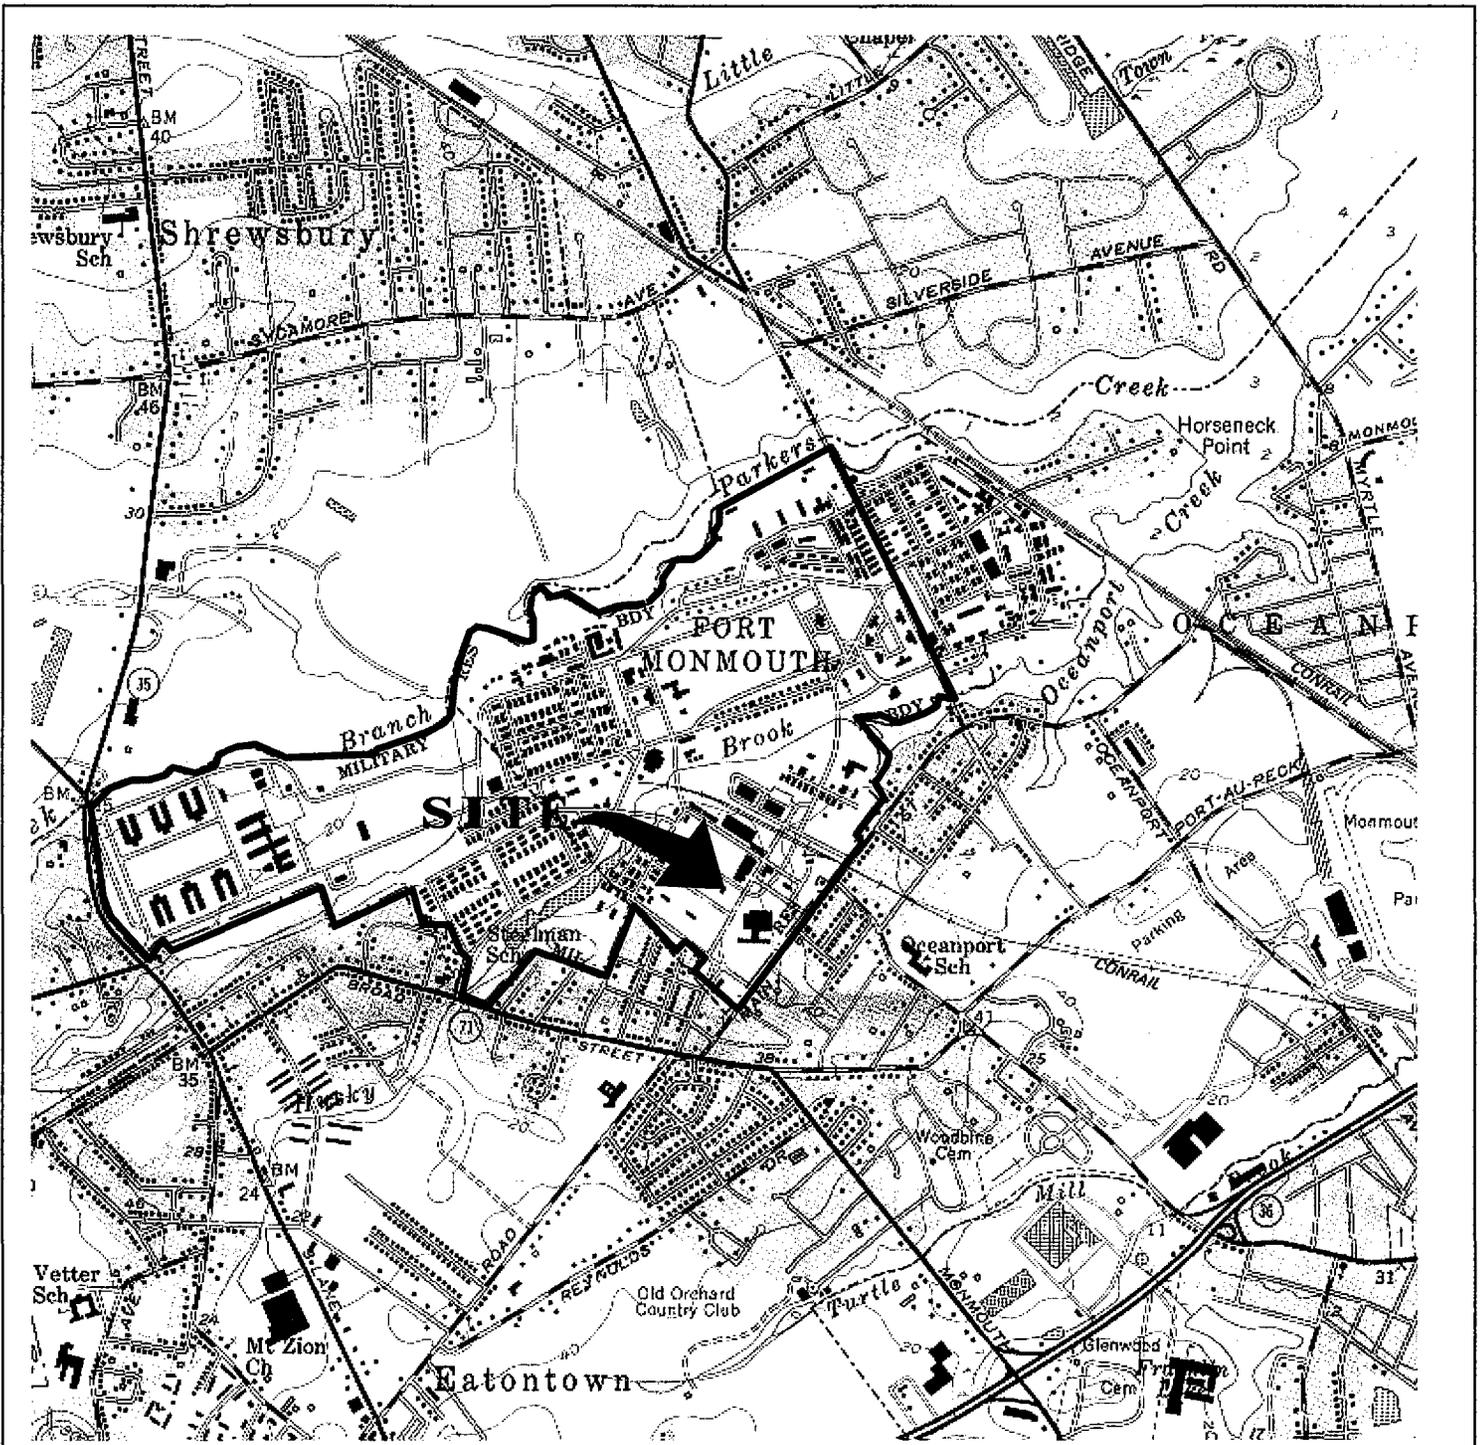

**FIGURE 1**

**LOCATION MAP**  
 Building 1006  
 Main-Post West  
 Fort Monmouth Army Base  
 Monmouth County, NJ

**VERSAR**  
 Engineers, Managers, Scientists, & Planners  
 Bristol, PA

Scale; 1" = 2000'

Date: Jan. 1991

**LONG BRANCH, N. J.**  
 40073-C8-TF-024

1954  
 PHOTOREVISED 1981  
 DMA 6164 I SE-SERIES V822



# Geologic Map of New Jersey

## SEDIMENTARY ROCKS

### CENOZOIC

- Holocene: sand
- Tertiary: sand, silt, clay

### MESOZOIC

- Cretaceous: sand, silt, clay
- Jurassic: siltstone, shale, sandstone
- Triassic: siltstone, shale, sandstone

### PALEOZOIC

- Devonian: conglomerate, sandstone,
- Silurian: conglomerate, sandstone, shale, limestone
- Ordovician: shale, limestone
- Cambrian: limestone, sandstone


## IGNEOUS AND METAMORPHIC ROCKS

### MESOZOIC

- Jurassic: basalt
- Jurassic: diabase

### PRECAMBRIAN

- marble
- gneiss, granite

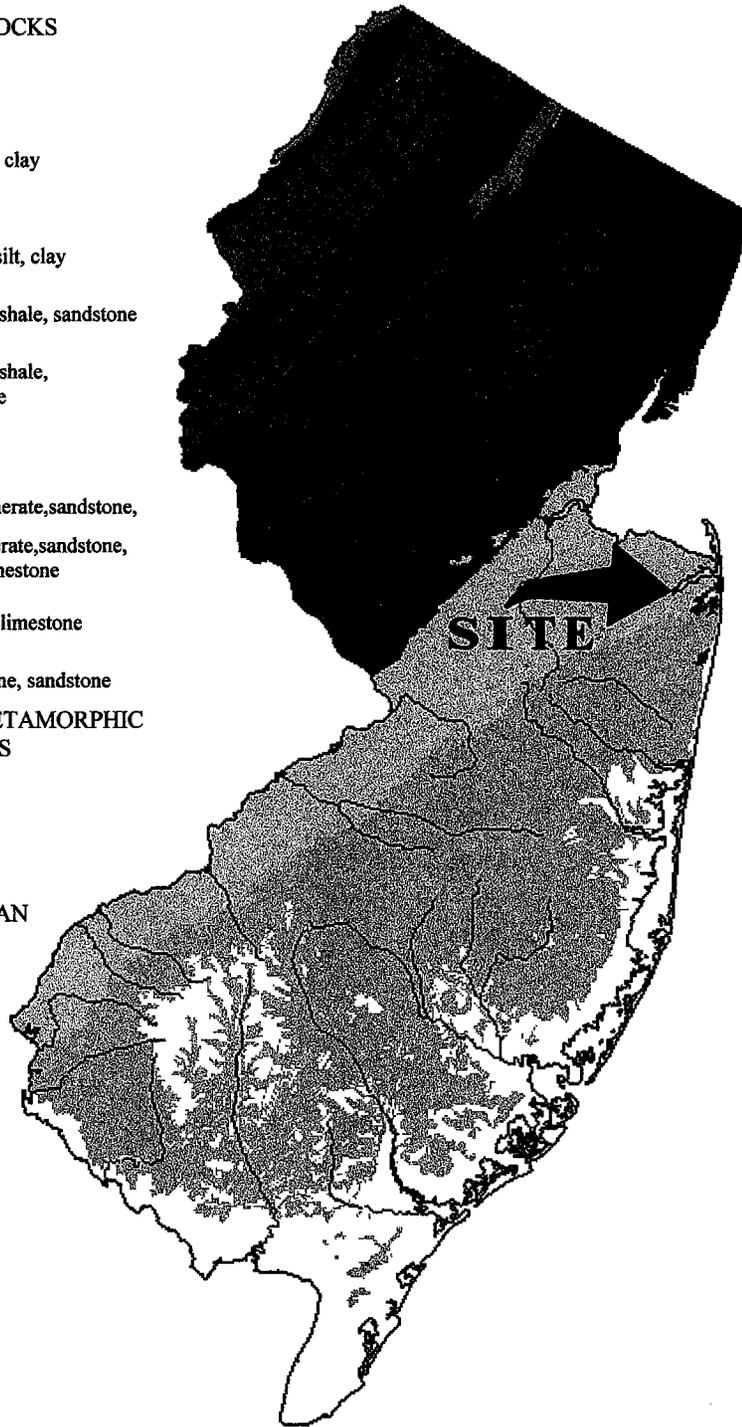

**FIGURE 1A**  
**GEOLOGICAL MAP**  
**FORT MONMOUTH ARMY BASE**  
**MONMOUTH COUNTY, NJ**

**VERSAR**  
 Engineers, Managers, Scientists & Planners  
 Bristol, Pennsylvania

1006 FIG 2

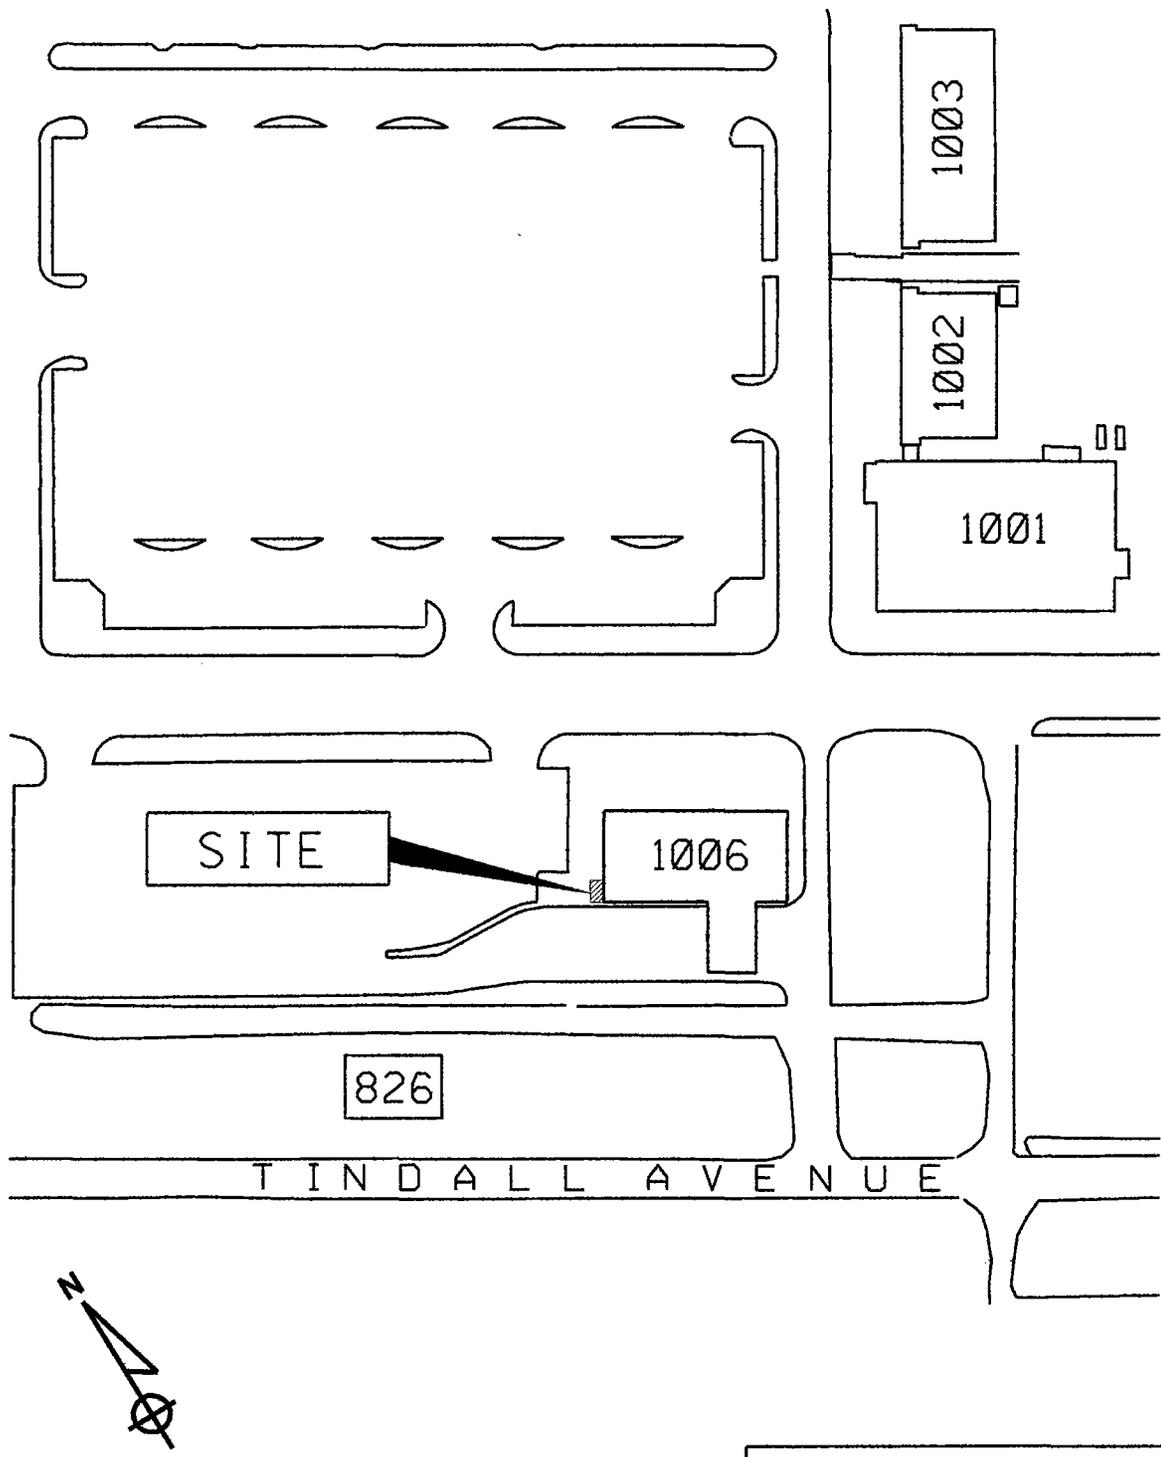


FIGURE 2  
 SITE MAP  
 BUILDING 1006  
 FORT MONMOUTH ARMY BASE  
 MONMOUTH COUNTY, NJ

VERSAR  
 ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS  
 BRISTOL, PA.

SCALE: 1"=100'      DATE: JAN 1991

BUILDING  
1006

1006-4/8.5' BGS  
TPHC 192.96


1006-3/8.5' BGS  
TPHC ND

1006-1/8.5' BGS  
TPHC 157.44

1006-2/8.5' BGS  
TPHC 177.07

DUP-2 /8.5' BGS  
TPHC ND

ABANDONED  
REMOTE FILL



**LEGEND**

● SOIL SAMPLE LOCATION  
(NOVEMBER 13, 1999)

▣ LIMIT OF EXCAVATION  
(MAY 5, 1998)

**NOTES:**

1. ALL RESULTS IN MG/KG.
2. SEE TABLE 2 FOR NJDEP SOIL CLEANUP CRITERIA
3. BGS = BELOW GROUND SURFACE

**FIGURE 3**  
SOIL SAMPLING LOCATION MAP  
BUILDING 1006  
FORT MONMOUTH ARMY BASE  
MONMOUTH COUNTY, NJ

**VERSAR**  
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS  
BRISTOL, PA.


SCALE: 1"=10'

DATE: JAN 1991

1006 FIG3

SAMPLING LOCATION: SAMPLING DEPTH: SAMPLING DATE:	HIGHER OF NJDEP GWOS AND PQL	BLDG 1006 9-12' BGS 11/13/99	BLDG 1006 12-17' BGS 1/8/00
VOLATILE ORGANIC COMPOUNDS:		ND	ND
SEMIVOLATILE ORGANIC COMPOUNDS:		ND	ND

BUILDING  
1006



ABANDONED  
REMOTE FILL



**LEGEND**

- GROUNDWATER SAMPLE LOCATION  
(NOVEMBER 13, 1999 AND JANUARY 8, 2000)
- ▣ LIMIT OF EXCAVATION  
(MAY 5, 1998)

**NOTES:**

1. ND=INDICATES COMPOUND NOT DETECTED
2. NLE= NO LIMIT ESTABLISHED
3. ALL RESULTS IN UG/L
4. BGS = BELOW GROUND SURFACE

FIGURE 4  
GROUNDWATER SAMPLING MAP  
BUILDING 1006  
FORT MONMOUTH ARMY BASE  
MONMOUTH COUNTY, NJ

VERSAR  
ENGINEERS, MANAGERS, SCIENTISTS & PLANNERS  
BRISTOL, PA.

SCALE: 1"=10'

DATE: JAN 1991

Page 1  
Page 2  
Page 3  
Page 4  
Page 5  
Page 6  
Page 7  
Page 8  
Page 9  
Page 10  
Page 11  
Page 12  
Page 13  
Page 14  
Page 15  
Page 16  
Page 17  
Page 18  
Page 19  
Page 20  
Page 21  
Page 22  
Page 23  
Page 24  
Page 25  
Page 26  
Page 27  
Page 28  
Page 29  
Page 30  
Page 31  
Page 32  
Page 33  
Page 34  
Page 35  
Page 36  
Page 37  
Page 38  
Page 39  
Page 40  
Page 41  
Page 42  
Page 43  
Page 44  
Page 45  
Page 46  
Page 47  
Page 48  
Page 49  
Page 50  
Page 51  
Page 52  
Page 53  
Page 54  
Page 55  
Page 56  
Page 57  
Page 58  
Page 59  
Page 60  
Page 61  
Page 62  
Page 63  
Page 64  
Page 65  
Page 66  
Page 67  
Page 68  
Page 69  
Page 70  
Page 71  
Page 72  
Page 73  
Page 74  
Page 75  
Page 76  
Page 77  
Page 78  
Page 79  
Page 80  
Page 81  
Page 82  
Page 83  
Page 84  
Page 85  
Page 86  
Page 87  
Page 88  
Page 89  
Page 90  
Page 91  
Page 92  
Page 93  
Page 94  
Page 95  
Page 96  
Page 97  
Page 98  
Page 99  
Page 100

**APPENDIX A**  
**NJDEP-STANDARD REPORTING FORM**

**NEW JERSEY DEPARTMENT OF ENVIRONMENTAL PROTECTION**  
 DIVISION OF RESPONSIBLE PARTY SITE REMEDIATION  
 BUREAU OF APPLICABILITY AND COMPLIANCE  
 Registration and Billing Unit  
 CN 028, Trenton, N.J. 08625-0028  
 1-609-984-3156

**FOR STATE USE ONLY**

Check In  Yes

STATUS  Active  Inactive

COMCODE

**UNDERGROUND STORAGE TANK  
 FACILITY QUESTIONNAIRE**

FACILITY UST # 0081533

*Bldg. 1006*

Completion of this Registration Questionnaire will satisfy the registration requirements of the Underground Storage of Hazardous Substances Act, N.J.S.A. 58:10A-21, and the Registration and Billing Regulations N.J.A.C. 7:14B-2.

[Check appropriate box(es)]

- A.  Is this a registration of a proposed or newly installed underground storage tank? (This form must be filed at least 30 days prior to operation)
- B.  Is this a registration of an existing underground storage tank not presently registered?
- C.  Is this a correction or amendment to an existing facility registration? UST # 0081533
- D.  There have been no changes to the facility registration since last submittal. UST # \_\_\_\_\_ (Go to certification page for signatures)

If "C" is checked above, please check the appropriate type of change(s) below

- |  |   |  |
|--|---|--|
| <input type="checkbox"/> Facility Name and/or Address Change     | <input type="checkbox"/> Type of Product(s) Stored                  | <input type="checkbox"/> Financial Responsibility Change                   |
| <input type="checkbox"/> Owner Name and/or Address Change        | <input type="checkbox"/> Spills, Leaks, Releases                    | <input type="checkbox"/> Substantial Modification(s)                       |
| <input type="checkbox"/> Facility Operator and/or Address Change | <input type="checkbox"/> Tank(s) and/or Piping Changes              | <input type="checkbox"/> Sale or Transfer (Complete Questions 4, 5, 6 & 7) |
| <input type="checkbox"/> Owner Contact Person Change             | <input checked="" type="checkbox"/> Closure (Complete Question #13) | <input type="checkbox"/> Other (please specify)                            |

**SECTION A - GENERAL FACILITY INFORMATION**

1. Facility Name Main Post West

2. Facility Location Ft Monmouth  
 NUMBER AND STREET \_\_\_\_\_  
 CITY OR MUNICIPALITY \_\_\_\_\_  
 COUNTY N.J. STATE N.J. ZIP CODE \_\_\_\_\_ BLOCK \_\_\_\_\_ LOT \_\_\_\_\_

3. Facility Operator \_\_\_\_\_ PERSON OR TITLE \_\_\_\_\_ Contact Tele. No. \_\_\_\_\_ (Area Code) \_\_\_\_\_ (Extension) \_\_\_\_\_

Operator Address (if different than #2) \_\_\_\_\_ NUMBER AND STREET \_\_\_\_\_  
 CITY OR MUNICIPALITY \_\_\_\_\_  
 STATE \_\_\_\_\_ ZIP CODE \_\_\_\_\_

4. Tank Owner \_\_\_\_\_

5. Tank Owner Address \_\_\_\_\_ NUMBER AND STREET \_\_\_\_\_  
 CITY OR MUNICIPALITY \_\_\_\_\_  
 STATE \_\_\_\_\_ ZIP CODE \_\_\_\_\_

Contact Person (Tank Owner) Charles Appley Contact Tele. No. 733 530 6004 (Area Code) \_\_\_\_\_ (Extension) \_\_\_\_\_

7. EPA ID #

8. Total number of regulated underground storage tanks at facility    (Complete Section B for each tank)

9. Total regulated underground storage tank capacity at facility (gallons)

*Bldg. 1006*

10. Facility Type: A  State C  County/Municipal E  Charitable / Public School G  Other  
 B  Commercial/Industrial D  Federal F  Residence H  Farm (as defined in N.J.S. 54:4-23.1 et seq.)

11. Is a copy of the facility site plan submitted with this registration pursuant to N.J.A.C. 7:14B-2?  YES  NO

**SECTION B - SPECIFIC TANK INFORMATION**

ALL underground tanks, including those taken out of operation (UNLESS THE TANK WAS REMOVED FROM THE GROUND PRIOR TO 9/3/86) must be registered. Report all tank/piping status changes unless previously submitted.

	TANK NO.		TANK NO.		TANK NO.		TANK NO.		TANK NO.	
1. Tank Identification Number	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>
2. CAS Number (hazardous substances only)	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>
3. Date Tank Installed (Month/Day/Year)	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year	Mo. Day Year
4. Tank Size (gallons)	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>	<input type="text"/>
5. Tank Contents (Mark one "X" for each tank)										
A. Leaded gasoline	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
B. Unleaded gasoline	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
C. Alcohol enriched gasoline	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
D. Light diesel fuel (No. 1-D)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
E. Medium diesel fuel (No. 2-D)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
F. Waste Oil	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
G. Kerosene (No. 1)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
H. Home heating oil (No. 2)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
J. Heating oil (No. 4)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
K. Heavy heating oil (No. 6)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
L. Aviation fuel	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
M. Motor oil	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
N. Lubricating oil	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
P. Sewage	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Q. Sewage sludge	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
R. Other hazardous substances (specify)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
S. Hazardous waste (specify ID number)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
T. Mixtures (please specify)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
U. Emergency spill tank (specify substance)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
V. Other petroleum products (please specify)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
W. Other (please specify)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
6. Tank & Piping Construction (Mark one each for both tank & piping)	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping
A. Bare Steel	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
B. Cathodically protected steel	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
C. Fiberglass-coated steel	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
D. Fiberglass-reinforced plastic	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
E. Internally lined	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
F. Other (please specify)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
7. Tank & Piping Structure (Mark one each for both tank & piping)	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping
A. Single wall	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
B. Double wall	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
C. Other (please specify)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
8. Type of Monitoring/Detection System (Mark all that apply for both tank & piping)	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping
A. Statistical Inventory Reconciliation	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
B. Manual Tank Gauging	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
C. Inventory Control	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
D. Interstitial	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
E. Precision Test	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
F. Ground water observation wells	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
G. Vapor observation wells	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
H. In-tank (automatic) monitoring gauge	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
J. Periodic Tank Test	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

*Blky 1006*

Tank Identification Number	TANK NO.		TANK NO.		TANK NO.		TANK NO.		TANK NO.			
8. Type of Monitoring/Detection System	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping		
K. None	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
L. Other (please specify)												
9. Overfill Protection (tank only) (Mark one X for each tank)												
A. Yes	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
B. No	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
10. Spill Containment Around Fill Pipe (Mark one X for each tank)												
A. Yes	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
B. No	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
11. Tank Status (Mark one X for each tank)	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping	Tank	Piping		
A. In-use	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
B. Empty less than 12 months	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
C. Empty 12 months or more	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
D. Emergency spill tank (sump)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
E. Emergency backup generator tank	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
F. Abandoned in Place	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
G. Removed	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>		
H. Other (please specify)												
12. If box 11B, C, or D above has been marked, indicate the estimated date last used (month/day/year)	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year
13. Closure Information - Tank ID No.	TANK NO.		TANK NO.		TANK NO.		TANK NO.		TANK NO.			
	<i>Blky 1006</i> C1157											
A. Date abandoned in place	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year	Mo.	Day	Year
B. Date taken temporarily out of service												
C. Date removed			<i>Price T2 -</i>			<i>6/10/1991</i>						
D. Date of Sale or Transfer												
E. TMS # (if applicable)												
F. ISRA # (if applicable)												

**SECTION C - FINANCIAL RESPONSIBILITY**

Does this facility have a Financial Responsibility Assurance Mechanism as required in 40 CFR 280?  YES  NO  
Please list the appropriate financial information below:

_____	_____	_____	_____
Type	Carrier / Issuing Agency		
____/____/____	____/____/____	_____	\$ _____
Effective Date	Expiration Date	Policy Number	Amount

**SECTION D - MONITORING SYSTEMS**

Does this facility have a release detection monitoring system which is in compliance with N.J.A.C. 7:14B-6?  YES  NO  
If "No", please be aware that the facility must meet the appropriate deadline. (See "Dates to Know" on Page 4)

**SECTION E - RECORDKEEPING/COMPLIANCE**

Please answer all the questions in this section on a facility basis. Any one tank not in compliance requires a "NO" answer for the entire facility.

- Does this facility have cathodic protection systems for all steel tanks and piping?  
If "Yes", are the systems properly operated and maintained pursuant to N.J.A.C. 7:14B-5?  YES  NO
- Are the performance claims and documentation of monitoring systems maintained by the owner or operator pursuant to N.J.A.C. 7:14B-5?  YES  NO
- Are the proper monitoring, testing, sampling, repair and inventory records kept on-site pursuant to N.J.A.C. 7:14B-5 and 6?  YES  NO
- Is the proper Release Response Plan kept on-site pursuant to N.J.A.C. 7:14B-5?  YES  NO
- Does the facility have spill and over fill protection systems pursuant to N.J.A.C. 7:14B-4?  YES  NO
- Have all Fill Ports been permanently marked as per API #1637 pursuant to N.J.A.C. 7:14B-5?  YES  NO

Bldg 1006

**IMPORTANT INFORMATION**

- FEE:** Please make checks payable to: "Treasurer, State of New Jersey". Use of the enclosed return envelope will expedite processing. Registration and Billing Schedule can be found in N.J.A.C. 7:14B. All Initial Registration fees are \$100 per facility.
- PENALTY:** Failure by owner or operator of a regulated underground storage tank to comply with any requirement of the State UST Act or regulations may result in the penalties set forth in N.J.S.A. 58:10A-10.
- EMERGENCY:** If a discharge or spill occurs, the NJDEP Hotline at (609) 292-7172 must be called IMMEDIATELY - 24 hours a day.
- UPGRADE EXEMPTION:** Residential heating oil underground storage tanks are exempt from all upgrade requirements.

**DATES TO KNOW (critical deadlines)**

- December 22, 1988 — All new federally regulated tank systems must have cathodic protection and spill/overflow protection.
- September 4, 1990 — All new State-only regulated tank systems must have cathodic protection and spill/overflow protection.
- December 22, 1990 — All federally regulated piping must have begun leak detection.
- February 19, 1993 — All federally regulated tank systems must maintain financial responsibility assurance.
- December 22, 1993 — All federally regulated tank systems must have begun leak detection.
- December 22, 1998 — All regulated tanks shall install cathodic protection and spill/overflow protection.

**CERTIFICATIONS**

**NOTE: IF THE PERSON SIGNING CERTIFICATION NO. 2 IS THE SAME AS THE PERSON SIGNING CERTIFICATION NO. 1, THEN CERTIFICATION NO. 2 NEED NOT BE SIGNED. (If different persons are required to sign No. 1 and No. 2, then they must do so.)**

**CERTIFICATION NO. 1:**

Must be signed by the highest ranking individual at the facility with overall responsibility

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Mr. James OTT  
 (Typed / Printed Name)  
Director of Public Works  
 (Title)

[Signature]  
 (Signature)  
8/4/98  
 (Date)

**CERTIFICATION NO. 2:**

Must be signed as follows:

- For a corporation, by a principal executive officer of at least the level of vice president
- For a partnership or sole proprietorship, by a general partner or the proprietor, respectively
- For a municipality, State, Federal or other public agency, by either a principal executive officer or ranking elected official
- For persons other than indicated above, by the person with legal responsibility for the site

"I certify under penalty of law that I have personally examined and am familiar with the information submitted herein and all attached documents, and that based on my inquiry of those individuals immediately responsible for obtaining the information. I believe that the submitted information is true, accurate and complete. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

NA  
 (Typed / Printed Name)  
 \_\_\_\_\_  
 (Title)

\_\_\_\_\_  
 (Signature)  
 \_\_\_\_\_  
 (Date)

**CERTIFICATION NO. 3:**

If applicable, must be signed by the individual who is certified to perform services.

"I certify under penalty of law that the information provided in this document is true, accurate and complete to the best of my knowledge, information and belief. I am aware that there are significant civil and criminal penalties for knowingly submitting false, inaccurate or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Charles Appleby, Env. Prot. Spec.  
 (Typed / Printed Name) (Title)  
U.S. Army  
 (Name of Firm, if applicable)

[Signature]  
 (Signature)  
8/4/98  
 (Date)  
2056  
 (N.J. Certification Number)

**APPENDIX B**

**SITE ASSESSMENT SUMMARY**

Site Remediation Program

UST Site/Remedial Investigation Report Certification Form

A. Facility Name : U.S. Army Fort Monmouth New Jersey

Facility Street Address : Directorate of Public Works Building 173

Municipality: Oceanport County : Monmouth

Block: Lot(s): Telephone Number : 732-532-6224

B. Owner (RP)'s Name:

Street Address: City :

State: Zip: Telephone Number :

C. (Check as appropriate)

- Site Investigation Report (SIR) \$500 Fee
Remedial Investigation Report (RIR) \$1000 Fee

X NA - Federal Agreement

D. (Complete all that apply)

- Assigned Case Manager : Ian Curtis, Federal Case Manager
UST Registration Number : 81533-159 (7 digits)
Incident Report Number (10 or 12 digits)
Tank Closure Number : Federal Case Manager

E. Certification by the Subsurface Evaluator:

The attached report conforms to the specific reporting requirements of N.J.A.C. 7:26E .....Yes No

Name: Charles Appleby Signature: UST Cert. No.: 2056

Firm: U.S. Army Fort Monmouth Firm's UST Cert. Number: NA-U.S. Army

Firm Address: Directorate of Public Works Building 173 City: Fort Monmouth

State: NJ Zip: 07703 Telephone Number : 732-532-6224

(NOTE: Certification numbers required only if work was conducted on USTs regulated per N.J.S.A. 58:10A-21 et seq.)

F. Certification by the Responsible Party(ies) of the Facility:

The following certification shall be signed [according to the requirements of N.J.A.C. 7:14B-1.7(b)]as follows:

- 1. For a Corporation by a person authorized by a resolution of the board of directors to sign the document.
2. For a partnership or sole proprietorship, by a general partner or the proprietor, respectively; or
3. For a municipality, State, federal or other public agency by either a principal executive officer or ranking elected Official.

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this application and all attached documents, and that based on my inquiry of those individuals responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete. I am aware that there are significant civil penalties for knowingly submitting false, inaccurate, or incomplete information and that I am committing a crime of the fourth degree if I make a written false statement which I do not believe to be true. I am also aware that if I knowingly direct or authorize the violation of any statute, I am personally liable for the penalties."

Name (Print or Type): James Ott Title: Directorate of Public Works

Signature: [Handwritten Signature]

Company Name: U.S. Army Fort Monmouth Date: 7/31/00

**US ARMY, FORT MONMOUTH**  
**DAILY UST CLOSURE LOG**

BLDG.#: 1006 REG.#: \_\_\_\_\_ CLOSURE#: \_\_\_\_\_  
 DATE: 5-5-98 TOA: \_\_\_\_\_ TOD: \_\_\_\_\_  
 CLOSURE SUPERVISOR: GD NJDEP CERT.#: \_\_\_\_\_  
 PERSONNEL: GI, EC, NW

ACTIVITY*	YES / NO
THE SUPERVISOR (CLOSURE CERT.) WAS ON-SITE DURING ALL CLOSURE RELATED ACTIVITIES	Y
THE SSE WAS ON-SITE DURING UST REMOVAL AND SITE SCREENING AND SAMPLING ACTIVITIES	↓
ALL ON-SITE PERSONNEL HAVE CURRENT TRAINING IAW ALL SAFETY REQ. (E.G. 29CFR)	↓
ALL UTILITIES WERE MARKED OUT PRIOR TO ANY EXCAVATION (VISUAL CONFIRM. YES/NO)	↓
HAND EXCAVATION WAS DONE WHEN EXCAVATING WITHIN 4 FT OF ANY UTILITIES	↓
ALL UST PIPING WAS BLOWN BACK AND DRAINED PRIOR TO ANY EXCAVATION WITH BACKHOE	↓
ALL UST PIPING WAS REMOVED PRIOR TO UST EXCAVATION <i>VENT WAS REMOVED, REMOTE FILL LEFT IN PLACE</i>	Y
A CONFINED ENTRY PERMIT WAS COMPLETED AND POSTED ON-SITE BY THE CONTRACTOR	N/A
THE UST WAS CLEANED AND NO RESIDUAL LIQUIDS WERE LEFT IN THE TANK	↓
THE UST WAS PLACED ONTO PLASTIC, SCRAPED OFF, INSPECTED FOR HOLES AND PHOTOGRAPHED	↓
<u>1</u> DRUMS OF WASTE WERE GENERATED AT THIS SITE TODAY (ID CARDS COMPLETED)	Y
_____ DRUMS OF WASTE WERE TRANSPORTED TO THE (MP, CW, EV) HWSA	N/A
_____ GALLONS OF X _____ WASTE WERE REMOVED (MANIFEST#: _____)	↓
_____ CUBIC YARDS OF PETROL. CONT. SOIL WERE EXCAVATED+TRANS TO (T-80, 2524)	↓
THE DPW WAS NOTIFIED OF ANY DISCHARGE TO THE ENVIRONMENT. (WHO) _____	↓
ALL PETROL. CONT. SOILS WERE SECURED FROM THE WEATHER BY CLOSE OF BUSINESS TODAY	↓
THE SSE AUTHORIZED BACKFILLING THE EXCAVATION. SSE INITIAL REQUIRED: <b>**</b>	Y
THE UST WAS TRANSPORTED TO _____ FOR DISPOSAL (ATTACH SCRAP TICKET)	N/A
ADDITIONAL NOTES WERE TAKEN AND RECORDED ON THE BACK OF THIS FORM	↓
THE FOLLOWING DOCUMENTS WERE GIVEN TO THE SSE TODAY: (CIRCLE EACH OR ADD ITEMS)	↓
SCRAP TICKET, CSE PERMIT, ACCIDENT REPORT, _____	↓

CHECK ALL BOXES, LEAVE NO BLANK

I certify under penalty of law that tank decommissioning activities were performed in compliance with N.J.A.C. 7:14B-9.2(b)3. I am aware that there are significant penalties for submitting false, inaccurate, or incomplete information, including fines and/or imprisonment.

SIGNATURE: *GD* DATE: 5-5-98

ca\ms\ust\removal\sitecells.doc

**\*\* = C. Appleby (on-site)**



**\* TUS ACTIVITY AT THIS SITE WAS LIMITED TO VERIFYING THAT THE TANK WAS REMOVED + AIR TESTING + CAPPING THE REMOTE FILL.**

**APPENDIX C**  
**WASTE MANIFEST**

# #1 CASIE PROTANK ENVIRONMENTAL SERVICES

1006

Please type or print in block letters. (Form designed for use on elite (12-pitch) typewriter.)
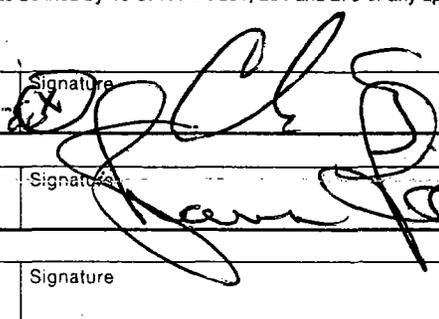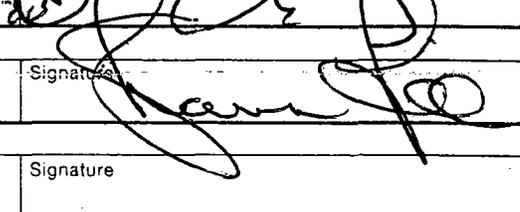
<b>NON-HAZARDOUS MANIFEST</b>		1. Generator's US EPA ID No. <b>NJ32.100205991</b>		2. Page 1 of <b>13637</b>	
3. Generator's Name and Mailing Address <b>US ARMY COMMUNICATIONS ELECTRONICS COMMAND MAIN POST, C/O Jett Fallon, Bldg 173, SELFM-PW-EV</b>		A. Non-hazardous Manifest Document Number <b>NHZ020 18100</b>			
4. Generator's Phone ( <b>609</b> ) <b>696-4401</b>		B. State Generator's ID <b>SAME</b>			
5. Transporter 1 Company Name <b>Casie Ecology Oil Salvage, Inc.</b>		6. US EPA ID Number <b>N J D 0 4 5 9 9 5 6 9 3</b>			
7. Transporter 2 Company Name		8. US EPA ID Number			
9. Designated Facility Name and Site Address <b>Casie Ecology Oil Salvage, Inc. T/A 3209 N. Mill Rd / Casie Protank Vineland NJ 08360</b>		10. US EPA ID Number <b>N J D 0 4 5 9 9 5 6 9 3</b>			
11. US DOT Description (Including Proper Shipping Name, Hazard Class, and ID Number) <b>FUEL 3.0 Combustible liquid, n.o.s. (Lube Oil) NA1993, III</b>		12. Containers No. Type	13. Total Quantity	14. Unit Wt/Vol	15. Waste No.
		<b>0 0 1 T T</b>	<b>xx957 SL</b>	<b>G I D 7 2</b>	
J. Additional Descriptions for Materials Listed Above <b>(L, 85% oil/seal wtr)</b>		K. Handling Codes for Wastes Listed Above			
a.		c.	a.	c.	
b.		d.	b.	d.	
15. Special Handling Instructions and Additional Information <b>BPA Contract Bldg # <del>3209</del> - 800-875-447-812 UST Closure</b>					
a. ERG# <b>128</b>					
b. <b>24 hr emergency response #609-696-4401 K. Ambrosia</b>					
16. GENERATOR'S CERTIFICATION: I hereby declare that the contents of this consignment are fully and accurately described above by proper shipping name and are classified, packed, marked, and labeled, and are in all respects in proper condition for transport by highway according to applicable international and national government regulations. I hereby certify that the above-named material is not hazardous waste as defined by 40 CFR Part 261, 264 and 279 or any applicable state law.					
Printed/Typed Name <b>Charles Apple, SELFM-PW</b>		Signature 			
17. Transporter 1 Acknowledgement of Receipt of Materials Printed/Typed Name <b>Chandler</b>		Signature 			
18. Transporter 2 Acknowledgement of Receipt of Materials Printed/Typed Name		Signature Month Day Year			
19. Discrepancy Indication Space					
20. Facility Owner or Operator: Certification of receipt of non-hazardous materials covered by this manifest except as noted in Item 19. Printed/Typed Name		Signature Month Day Year			

**APPENDIX D**

**SOIL ANALYTICAL DATA PACKAGE**

# FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT  
Fort Monmouth Environmental Laboratory  
ENVIRONMENTAL DIVISION  
Fort Monmouth, New Jersey  
PROJECT: UST Program

## Bldg. 1006

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
Trip Blank	4937.01	Aqueous	13-Nov-99	11/15/99
Field Blank	4937.02	Aqueous	13-Nov-99 09:00	11/15/99
1006-1 8.5'	4937.03	Soil	13-Nov-99 09:30	11/15/99
1006-2 8.5'	4937.04	Soil	13-Nov-99 09:50	11/15/99
1006-3 8.5'	4937.05	Soil	13-Nov-99 10:15	11/15/99
1006-4 8.5'	4937.06	Soil	13-Nov-99 10:30	11/15/99
Field Dup. 8.5'	4937.07	Soil	13-Nov-99	11/15/99
1006-GW-9-12'	4937.08	Aqueous	13-Nov-99 11:00	11/15/99

ANALYSIS:  
FORT MONMOUTH ENVIRONMENTAL LAB  
VOA+15, BN+15, TPHC, %SOLIDS

ENCLOSURE:  
CHAIN OF CUSTODY  
RESULTS

 4-8-00  
Daniel Wright/Date  
Laboratory Director


## Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-8
Laboratory Chronicle	9-10
Volatile Organics	11-12
Analytical Results Summary	13-20
Tune Results Summary	23-28
Method Blank Results Summary	21-22
Calibration Summary	29-30
Surrogate Recovery Summary	31
MS/MSD Results Summary	32-33
Internal Standard Area & RT Summary	34-35
Chromatograms	36-43
Base Neutrals	44
Analytical Results Summary	45-53
Tune Results Summary	55-8
Method Blank Results Summary	54
Calibration Summary	59-62
Surrogate Recovery Summary	63
MS/MSD Results Summary	64-67
Internal Standard Area & RT Summary	68-71
Chromatograms	72-77
TPHC	78
Analytical Results Summary	79
Method Blank Summary	79
Standards Summary	80-82
Surrogate Recovery Summary	83
MS/MSD Results Summary	84-85
Chromatograms	86-97
Laboratory Deliverables Checklist	98
Laboratory Authentication Statement	99

11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
100

# CHAIN OF CUSTODY

000001

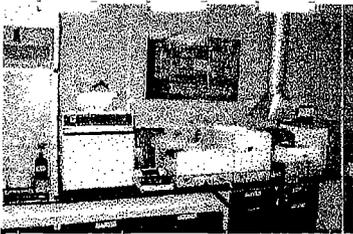

# Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:appleby@mail1.monmouth.army.mil

NJDEP Certification #13461

## Chain of Custody Record

Customer: <b>D. DESAI</b>		Project No:		Analysis Parameters							Comments:		
Phone #: <b>X21475</b>		Location: <b>BLOG. 1006</b>		V A + 15	B + 2 15	T C H I P T	% S E L E C T E D			H N U A PPM	O V A PPM	Cal. TVA-1000 PID/FID c.c. (M)	
( ) DERA ( ) MOA ( ) Other: _____		Samplers Name / Company: <b>Mark Laura - TVS - PWS 07</b>											Sample #
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles								
<b>4937</b>	1 Trip BLANK	11-13-99	-	AQ.	2	X					-	-	<400
	2 Field BLANK	"	0900	"	2	X	X				-	-	HCL/400
	3 1006-1 - 8.5'	"	0930	SOIL	1			X	X		0.15	0.00	<400
<b>1</b>	4 1006-2 - "	"	0950	"	1			X	X		1.46	.46	"
	5 1006-3 - "	"	1015	"	1			X	X		1.40	1.00	"
	6 1006-4 - "	"	1030	"	1			X	X		0.96	0.10	"
	7 F.D. - 8.5'	"	-	"	1			X	X		-	-	"
	8 1006-3-GW - 9-12'	"	1100	AQ.	3	X	X				0.13	0.93	HCL/400

Relinquished by (signature): <i>Mark Laura</i>	Date/Time: 11-15-99 0730	Received by (signature): <i>[Signature]</i>	Relinquished by (signature):	Date/Time:	Received by (signature):
Relinquished by (signature):	Date/Time:	Received by (signature):	Relinquished by (signature):	Date/Time:	Received by (signature):

Report Type: ( ) Full, ( ) Reduced, ( ) Standard, ( ) Screen / non-certified

Turnaround time: ( ) Standard 3 wks, ( ) Rush Days, ( ) ASAP Verbal Hrs.

Remarks:

000002

5 11  
6 12  
7 13  
8 14  
9 15  
10 16  
11 17  
12 18  
13 19  
14 20  
15 21  
16 22  
17 23  
18 24  
19 25  
20 26  
21 27  
22 28  
23 29  
24 30  
25 31  
26 32  
27 33  
28 34  
29 35  
30 36  
31 37  
32 38  
33 39  
34 40  
35 41  
36 42  
37 43  
38 44  
39 45  
40 46  
41 47  
42 48  
43 49  
44 50  
45 51  
46 52  
47 53  
48 54  
49 55  
50 56  
51 57  
52 58  
53 59  
54 60  
55 61  
56 62  
57 63  
58 64  
59 65  
60 66  
61 67  
62 68  
63 69  
64 70  
65 71  
66 72  
67 73  
68 74  
69 75  
70 76  
71 77  
72 78  
73 79  
74 80  
75 81  
76 82  
77 83  
78 84  
79 85  
80 86  
81 87  
82 88  
83 89  
84 90  
85 91  
86 92  
87 93  
88 94  
89 95  
90 96  
91 97  
92 98  
93 99  
94 100

# TPHC

Report of Analysis  
 U.S. Army, Fort Monmouth Environmental Laboratory  
 NJDEP Certification # 13461

**Client :** U.S. Army  
 DPW. SELFM-PW-EV  
 Bldg. 173  
 Ft. Monmouth, NJ 07703


**Lab. ID # :** 4937  
**Date Rec'd:** 15-Nov-99  
**Analysis Start:** 17-Nov-99  
**Analysis Complete:** 17-Nov-99

**Analysis:** OQA-QAM-025  
**Matrix:** Soil  
**Analyst:** B.Patel  
**Inst. ID.** GC TPHC INST. #1  
**Column Type** RTX 5  
**Ext. Meth:** Shake

**UST Reg. #:**  
**Closure #:**  
**DICAR #:**  
**Injection Volume** 1 ul  
**Column ID** 0.32 mm  
**Location #:** Bldg. 1006

Sample	Field ID	Dilution Factor	Weight (g)	% Solid	MDL (mg/kg)	TPHC Result (mg/kg)
4937.03	1006-1	1.00	16.98	95.29	145	157.44
4937.04	1006-2	1.00	15.18	92.86	167	177.07
4937.05	1006-3	1.00	15.03	93.79	167	ND
4937.06	1006-4	1.00	15.59	94.61	159	192.96
4937.07	Field Dup	1.00	15.30	94.24	163	ND
<b>METHOD BLANK</b>	TBLK283	1.00	15.00	100.00	157	ND

ND = Not Detected  
 MDL = Method Detection Limit

  
 Daniel K. Wright  
 Laboratory Director

# LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS


The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

- |  |                                     |
|--|-------------------------------------|
| 1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted | <input checked="" type="checkbox"/> |
| 2. Table of Contents submitted   | <input checked="" type="checkbox"/> |
| 3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted           | <input checked="" type="checkbox"/> |
| 4. Document paginated and legible  | <input checked="" type="checkbox"/> |
| 5. Chain of Custody submitted  | <input checked="" type="checkbox"/> |
| 6. Samples submitted to lab within 48 hours of sample collection   | <input checked="" type="checkbox"/> |
| 7. Methodology Summary submitted   | <input checked="" type="checkbox"/> |
| 8. Laboratory Chronicle and Holding Time Check submitted   | <input checked="" type="checkbox"/> |
| 9. Results submitted on a dry weight basis   | <input checked="" type="checkbox"/> |
| 10. Method Detection Limits submitted  | <input checked="" type="checkbox"/> |
| 11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP | <input checked="" type="checkbox"/> |

Laboratory Manager or Environmental Consultant's Signature

Date 4/8/00

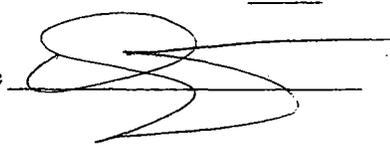


Laboratory Certification #13461

\*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance.

000098

## Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

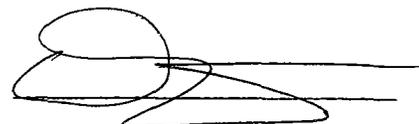

Daniel K. Wright  
Laboratory Manager

000099

F 1 4  
E 2 8  
F 1 0  
E 2 2  
F 1 4  
E 2 6  
F 1 8  
E 3 0  
F 2 2  
E 3 4  
F 2 6  
E 3 8  
F 3 0  
E 4 2  
F 3 4  
E 4 6  
F 3 8  
E 5 0  
F 4 2  
E 5 4  
F 4 6  
E 5 8  
F 5 0  
E 6 2  
F 5 4  
E 6 6  
F 5 8  
E 7 0  
F 6 2  
E 7 4  
F 6 6  
E 7 8  
F 7 0  
E 8 2  
F 7 4  
E 8 6  
F 7 8  
E 9 0  
F 8 2  
E 9 4  
F 8 6  
E 9 8

**APPENDIX E**  
**GROUNDWATER ANALYTICAL DATA PACKAGE**

# FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT  
Fort Monmouth Environmental Laboratory  
ENVIRONMENTAL DIVISION  
Fort Monmouth, New Jersey  
PROJECT: UST Program

## Bldg. 1006

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
Trip Blank	4937.01	Aqueous	13-Nov-99	11/15/99
Field Blank	4937.02	Aqueous	13-Nov-99 09:00	11/15/99
1006-1 8.5'	4937.03	Soil	13-Nov-99 09:30	11/15/99
1006-2 8.5'	4937.04	Soil	13-Nov-99 09:50	11/15/99
1006-3 8.5'	4937.05	Soil	13-Nov-99 10:15	11/15/99
1006-4 8.5'	4937.06	Soil	13-Nov-99 10:30	11/15/99
Field Dup. 8.5'	4937.07	Soil	13-Nov-99	11/15/99
1006-GW-9-12'	4937.08	Aqueous	13-Nov-99 11:00	11/15/99

ANALYSIS:  
FORT MONMOUTH ENVIRONMENTAL LAB  
VOA+15, BN+15, TPHC, %SOLIDS

ENCLOSURE:  
CHAIN OF CUSTODY  
RESULTS

 4-8-00  
Daniel Wright/Date  
Laboratory Director

## Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-2
Methodology Summary	3-4
Conformance/Non-Conformance Summary	5-8
Laboratory Chronicle	9-10
Volatile Organics	11-12
Analytical Results Summary	13-20
Tune Results Summary	23-28
Method Blank Results Summary	21-22
Calibration Summary	29-30
Surrogate Recovery Summary	31
MS/MSD Results Summary	32-33
Internal Standard Area & RT Summary	34-35
Chromatograms	36-43
Base Neutrals	44
Analytical Results Summary	45-53
Tune Results Summary	55-8
Method Blank Results Summary	54
Calibration Summary	59-62
Surrogate Recovery Summary	63
MS/MSD Results Summary	64-67
Internal Standard Area & RT Summary	68-71
Chromatograms	72-77
TPHC	78
Analytical Results Summary	79
Method Blank Summary	79
Standards Summary	80-82
Surrogate Recovery Summary	83
MS/MSD Results Summary	84-85
Chromatograms	86-97
Laboratory Deliverables Checklist	98
Laboratory Authentication Statement	99

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
100

# CHAIN OF CUSTODY

000001



# Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:appleby@mail1.monmouth.army.mil

NJDEP Certification #13461

## Chain of Custody Record

Customer: <b>D. DESAI</b>		Project No:				Analysis Parameters						Comments:			
Phone #: <b>X21475</b>		Location: <b>BL06.1006</b>				V A + 15	B + 15	P I P T	% S O I L D			H N L A	O V A	Cal. TVA-1000 PID/FID O.K. (M)	
( )DERA ( )MOMA ( )Other: _____		Samplers Name / Company: <b>Mark Laura - TVS - PWS 07</b>		Sample #											
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles						PPM	PPM	Remarks / Preservation Method		
<b>49137. 1</b>	<b>Trip BLANK</b>	<b>11-13-99</b>	<b>-</b>	<b>AQ.</b>	<b>2</b>	<b>X</b>					<b>-</b>	<b>-</b>	<b>&lt;400</b>		
<b>2</b>	<b>FIELD BLANK</b>	<b>"</b>	<b>0900</b>	<b>"</b>	<b>2</b>	<b>X</b>	<b>X</b>				<b>-</b>	<b>-</b>	<b>HCL/400</b>		
<b>3</b>	<b>1006-1 - 8.5'</b>	<b>"</b>	<b>0930</b>	<b>SOIL</b>	<b>1</b>			<b>X</b>	<b>X</b>		<b>0.15</b>	<b>0.00</b>	<b>&lt;400</b>		
<b>4</b>	<b>1006-2 - "</b>	<b>"</b>	<b>0950</b>	<b>"</b>	<b>1</b>			<b>X</b>	<b>X</b>		<b>1.46</b>	<b>.46</b>	<b>"</b>		
<b>5</b>	<b>1006-3 - "</b>	<b>"</b>	<b>1015</b>	<b>"</b>	<b>1</b>			<b>X</b>	<b>X</b>		<b>1.40</b>	<b>1.00</b>	<b>"</b>		
<b>6</b>	<b>1006-4 - "</b>	<b>"</b>	<b>1030</b>	<b>"</b>	<b>1</b>			<b>X</b>	<b>X</b>		<b>0.96</b>	<b>0.00</b>	<b>"</b>		
<b>7</b>	<b>F.D. - 8.5'</b>	<b>"</b>	<b>-</b>	<b>"</b>	<b>1</b>			<b>X</b>	<b>X</b>		<b>-</b>	<b>-</b>	<b>"</b>		
<b>8</b>	<b>1006-3-GW - 9-12'</b>	<b>"</b>	<b>1100</b>	<b>AQ.</b>	<b>3</b>	<b>X</b>	<b>X</b>				<b>0.13</b>	<b>0.93</b>	<b>HCL/400</b>		
Relinquished by (signature): <b>Matthew</b>		Date/Time: <b>11-15-99 0730</b>	Received by (signature): <b>[Signature]</b>		Relinquished by (signature):		Date/Time:	Received by (signature):							
Relinquished by (signature):		Date/Time:	Received by (signature):		Relinquished by (signature):		Date/Time:	Received by (signature):							
Report Type: ( ) Full, ( ) Reduced, ( ) Standard, ( ) Screen / non-certified					Remarks:										
Turnaround time: ( ) Standard 3 wks, ( ) Rush Days, ( ) ASAP Verbal Hrs.															

000002

# METHOD SUMMARY

000003

## Method Summary

### **EPA Method 624**

#### Gas Chromatographic Determination of Volatiles in Water

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

### **EPA Method 3510/8270**

#### Gas Chromatographic Determination of Semi-volatiles in Water

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

### **NJDEP Method OQA-QAM-025-10/97**

#### Gas Chromatographic Determination of Total Petroleum Hydrocarbons in Soil

Fifteen grams (15g)(wet weight) of a soil sample is added to a 125 mL acid cleaned, solvent rinsed, capped Erlenmeyer flask. 15g anhydrous sodium sulfate is added to dry sample. Surrogate standard spiking solution is then added to the flask.

Twenty-five milliliters (25mL) Methylene Chloride is added to the flask and it is secured on an orbital shaker table. The agitation rate is set to 400rpm and the sample is shaken for 30 minutes. The flask is the removed from the table and the particulate matter is allowed to settle. The extract is transferred to a Teflon capped vial. A second 25mL of Methylene Chloride is added to the flask and shaken for an additional 30 minutes. The flask is again removed and allowed to settle. The extracts are combined in the vial then transferred to a 1mL-autosampler vial.

The extract is then injected directly into a GC-FID for analysis. The sample is analyzed for petroleum hydrocarbons covering a range of C8-C42 including pristane and phytane. Total Petroleum Hydrocarbon concentration is determined by integrating between 5 minutes and 22 minutes. The baseline is established by starting the integration after the end of the solvent peak and stopping after the last peak.

The final concentration of Total Petroleum Hydrocarbons is calculated using percent solid, sample weight and concentration.

000004

F 01  
K 02  
F 03  
K 04  
F 05  
K 06  
F 07  
K 08  
F 09  
K 10  
F 11  
K 12  
F 13  
K 14  
F 15  
K 16  
F 17  
K 18  
F 19  
K 20  
F 21  
K 22  
F 23  
K 24  
F 25  
K 26  
F 27  
K 28  
F 29  
K 30  
F 31  
K 32  
F 33  
K 34  
F 35  
K 36  
F 37  
K 38  
F 39  
K 40  
F 41  
K 42  
F 43  
K 44  
F 45  
K 46  
F 47  
K 48  
F 49  
K 50  
F 51  
K 52  
F 53  
K 54  
F 55  
K 56  
F 57  
K 58  
F 59  
K 60  
F 61  
K 62  
F 63  
K 64  
F 65  
K 66  
F 67  
K 68  
F 69  
K 70  
F 71  
K 72  
F 73  
K 74  
F 75  
K 76  
F 77  
K 78  
F 79  
K 80  
F 81  
K 82  
F 83  
K 84  
F 85  
K 86  
F 87  
K 88  
F 89  
K 90  
F 91  
K 92  
F 93  
K 94  
F 95  
K 96  
F 97  
K 98  
F 99  
K 00

# **CONFORMANCE/NON- CONFORMANCE SUMMARY**

**000005**

**GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT**

Indicate  
Yes, No, N/A

- 1. Chromatograms labeled/Compounds identified  
(Field samples and method blanks) yes
- 2. Retention times for chromatograms provided yes
- 3. GC/MS Tune Specifications
  - a. BFB Meet Criteria yes
  - b. DFTPP Meet Criteria yes
- 4. GC/MS Tuning Frequency – Performed every 24 hours for 600 series and 12 hours for 8000 series yes
- 5. GC/MS Calibration – Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
- 6. GC/MS Calibration requirements
  - a. Calibration Check Compounds Meet Criteria yes
  - b. System Performance Check Compounds Meet Criteria yes
- 7. Blank Contamination – If yes, List compounds and concentrations in each blank: NO
  - a. VOA Fraction \_\_\_\_\_
  - b. B/N Fraction \_\_\_\_\_
  - c. Acid Fraction \_\_\_\_\_
- 8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

  - a. VOA Fraction \_\_\_\_\_
  - b. B/N Fraction \_\_\_\_\_
  - c. Acid Fraction \_\_\_\_\_

If not met, were the calculations checked and the results qualified as “estimated”?

\_\_\_\_\_
- 9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

  - a. VOA Fraction \_\_\_\_\_
  - b. B/N Fraction \_\_\_\_\_
  - c. Acid Fraction \_\_\_\_\_

**GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT (cont.)**

Indicate  
Yes, No, N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria  
(If not met, list those compounds, which fall outside the acceptable range)

yes

- a. VOA Fraction \_\_\_\_\_
- b. B/N Fraction \_\_\_\_\_
- c. Acid Fraction \_\_\_\_\_

11. Extraction Holding Time Met

yes

If not met, list the number of days exceeded for each sample: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

12. Analysis Holding Time Met

yes

If not met, list the number of days exceeded for each sample: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

Additional Comments:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Laboratory Manager: \_\_\_\_\_

Date: 4-8-00

000007

**TPHC CONFORMANCE/NON - CONFORMANCE SUMMARY REPORT**

Indicate  
Yes, No, N/A

- |    |   |            |
|----|---|------------|
| 1. | Method Detection Limits Provided  | <u>yes</u> |
| 2. | Method Blank Contamination – If yes, list the sample and the corresponding concentrations in each blank<br>_____<br>_____   | <u>NO</u>  |
| 3. | Matrix Spike Results Summary Meet Criteria<br>(If not met, list the sample and corresponding recovery which falls outside the acceptable range)<br>_____<br>_____ | <u>yes</u> |
| 4. | Duplicate Results Summary Meet Criteria<br>_____<br>_____   | <u>yes</u> |
| 5. | IR Spectra submitted for standards, blanks and samples  | <u>NA</u>  |
| 6. | Chromatograms submitted for standards, blanks and samples if GC fingerprinting was conducted  | <u>yes</u> |
| 7. | Analysis holding time met<br>(If not met, list number of days exceeded for each sample)<br>_____<br>_____   | <u>yes</u> |

Additional comments: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Laboratory Manager:  Date: 4-8-00

# LABORATORY CHRONICLE

000009

# Laboratory Chronicle

**Lab ID:** 4937

**Site:** Bldg. 1006

	<b>Date</b>	<b>Hold Time</b>
<b>Date Sampled</b>	11/13/99	NA
<b>Receipt/Refrigeration</b>	11/13/99	NA

## **Extractions**

1. Base Neutrals	11/16/99	14 Days
2. TPHC	11/17/99	14 Days

## **Analyses**

1. Volatile Organics	11/15,16/99	14 Days
2. Base Neutrals	11/19/99	40 Days
3. TPHC	11/17/99	14 Days

**000010**

# VOLATILES ORGANIC

000011

**US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY**  
**NJDEPE # 13461**

**Definition of Qualifiers**

**MDL** : Method Detection Limit  
**J** : Compound identified below detection limit  
**B** : Compound in both sample and blank  
**D** : Results from dilution of sample  
**U** : Compound searched for but not detected  
**E** : Compound exceeds calibration limit

**000012**

**Volatile Analysis Report**  
**U.S. Army, Fort Monmouth Environmental Laboratory**  
**NJDEP Certification #13461**

Data File **VB004794.D**  
 Operator **Skelton**  
 Date Acquired **15 Nov 1999 3:31 pm**

Sample Name **Vblk147**  
 Field ID **Vblk147**  
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

\*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

**Qualifiers**

B = Compound found in related blank  
 E = Value above linear range  
 D = Value from dilution  
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit  
 NLE = No Limit Established  
 R.T. = Retention Time

VOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

**Vblk147**

Lab Name: FMETL Project: 100004

NJDEP#: 13461 Case No.: 4937 Location: Bldg10 SDG No.: \_\_\_\_\_

Matrix: (soil/water) WATER Lab Sample ID: Vblk147

Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB004794.D

Level: (low/med) LOW Date Received: 11/15/99

% Moisture: not dec. \_\_\_\_\_ Date Analyzed: 11/15/99

GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0

Soil Extract Volume: \_\_\_\_\_ (uL) Soil Aliquot Volume: \_\_\_\_\_ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

**Volatile Analysis Report**  
**U.S. Army, Fort Monmouth Environmental Laboratory**  
**NJDEP Certification #13461**

Data File **VB004811.D**  
 Operator **Skelton**  
 Date Acquired **16 Nov 1999 3:03 am**

Sample Name **4937.01**  
 Field ID **Trip Blank**  
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

\*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

**Qualifiers**

B = Compound found in related blank  
 E = Value above linear range  
 D = Value from dilution  
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit  
 NLE = No Limit Established  
 R.T. = Retention Time

VOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

**Trip Blank**

Lab Name: FMETL Project: 100004  
 NJDEP#: 13461 Case No.: 4937 Location: Bldg10 SDG No.: \_\_\_\_\_  
 Matrix: (soil/water) WATER Lab Sample ID: 4937.01  
 Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB004811.D  
 Level: (low/med) LOW Date Received: 11/15/99  
 % Moisture: not dec. \_\_\_\_\_ Date Analyzed: 11/16/99  
 GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0  
 Soil Extract Volume: \_\_\_\_\_ (uL) Soil Aliquot Volume: \_\_\_\_\_ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

**Volatile Analysis Report**  
**U.S. Army, Fort Monmouth Environmental Laboratory**  
**NJDEP Certification #13461**

Data File **VB004812.D**  
 Operator **Skelton**  
 Date Acquired **16 Nov 1999 3:42 am**

Sample Name **4937.02**  
 Field ID **Field Blank**  
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

\*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

**Qualifiers**

B = Compound found in related blank  
 E = Value above linear range  
 D = Value from dilution  
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit  
 NLE = No Limit Established  
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

Field Blank

Lab Name: FMETL Project: 100004

NJDEP#: 13461 Case No.: 4937 Location: Bldg10 SDG No.: \_\_\_\_\_

Matrix: (soil/water) WATER Lab Sample ID: 4937.02

Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB004812.D

Level: (low/med) LOW Date Received: 11/15/99

% Moisture: not dec. \_\_\_\_\_ Date Analyzed: 11/16/99

GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0

Soil Extract Volume: \_\_\_\_\_ (uL) Soil Aliquot Volume: \_\_\_\_\_ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

**Volatile Analysis Report**  
**U.S. Army, Fort Monmouth Environmental Laboratory**  
**NJDEP Certification #13461**

Data File **VB004813.D**  
 Operator **Skelton**  
 Date Acquired **16 Nov 1999 4:21 am**

Sample Name **4937.08**  
 Field ID **1006-3-GW**  
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	686	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

\*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6.2-Sept-9

**Qualifiers**

B = Compound found in related blank  
 E = Value above linear range  
 D = Value from dilution  
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit  
 NLE = No Limit Established  
 R.T. = Retention Time

1E  
VOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

Lab ID.

1006-3-GW

Lab Name: FMETL Project: 100004  
NJDEP#: 13461 Case No.: 4937 Location: Bldg10 SDG No.: \_\_\_\_\_  
Matrix: (soil/water) WATER Lab Sample ID: 4937.08  
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VB004813.D  
Level: (low/med) LOW Date Received: 11/15/99  
% Moisture: not dec. \_\_\_\_\_ Date Analyzed: 11/16/99  
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0  
Soil Extract Volume: \_\_\_\_\_ (uL) Soil Aliquot Volume: \_\_\_\_\_ (uL)

CONCENTRATION UNITS:

Number TICs found: 0

(ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

VOLATILE METHOD BLANK SUMMARY

Vblk147

Lab Name: FMETL Project: 100004  
 NJDEP#: 13461 Case No.: 4937 Location: Bldg10 SDG No.: \_\_\_\_\_  
 Lab File ID: VB004794.D Lab Sample ID: Vblk147  
 Date Analyzed: 11/15/99 Time Analyzed: 15:31  
 GC Column: RTX502 ID: 0.25 (mm) Heated Purge: (Y/N) N  
 Instrument ID: GCMS#2

THIS METHOD BLANK APPLIES TO THE FOLLOWING SAMPLES, MS AND MSD:

	Lab ID.	LAB SAMPLE ID	LAB FILE ID	TIME ANALYZED
01	TRIP BLANK	4937.01	VB004811.D	3:03
02	FIELD BLANK	4937.02	VB004812.D	3:42
03	1006-3-GW	4937.08	VB004813.D	4:21

COMMENTS:

\_\_\_\_\_

VOLATILE METHOD BLANK SUMMARY

Vblk145

Lab Name: FMETL Project: 100004  
 NJDEP#: 13461 Case No.: 4937 Location: Bldg10 SDG No.: \_\_\_\_\_  
 Lab File ID: VB004723.D Lab Sample ID: Vblk145  
 Date Analyzed: 11/8/99 Time Analyzed: 17:50  
 GC Column: RTX502 ID: 0.25 (mm) Heated Purge: (Y/N) N  
 Instrument ID: GCMS#2

THIS METHOD BLANK APPLIES TO THE FOLLOWING SAMPLES, MS AND MSD:

	Lab ID.	LAB SAMPLE ID	LAB FILE ID	TIME ANALYZED
01	4913.01MS	4913.01MS	VB004746.D	9:22
02	4913.01MSD	4913.01MSD	VB004747.D	10:01

COMMENTS:

\_\_\_\_\_

VOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK  
BROMOFLUOROBENZENE (BFB)

Lab Name: FMETL Project: 100004  
 NJDEP#: 13461 Case No.: 4937 Location: Bldg10 SDG No.: \_\_\_\_\_  
 Lab File ID: VB004715.D BFB Injection Date: 11/8/99  
 Instrument ID: GCMS#2 BFB Injection Time: 11:22  
 GC Column: RTX502.2 ID: 0.25 (mm) Heated Purge: (Y/N) N

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
50	8.0 - 40.0% of mass 95	20.0
75	30.0 - 66.0% of mass 95	50.9
95	Base peak, 100% relative abundance	100.0
96	5.0 - 9.0% of mass 95	7.7
173	Less than 2.0% of mass 174	0.0 ( 0.0)1
174	50.0 - 120.0% of mass 95	75.2
175	4.0 - 9.0% of mass 174	5.3 ( 7.0)1
176	93.0 - 101.0% of mass 174	72.3 ( 96.2)1
177	5.0 - 9.0% of mass 176	4.3 ( 6.0)2

1-Value is % mass 174

2-Value is % mass 176

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	Lab ID.	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	VSTD020	VSTD020	VB004721.D	11/8/99	16:32
02	VBLK145	VBLK145	VB004723.D	11/8/99	17:50
03	4913.01MS	4913.01MS	VB004746.D	11/9/99	9:22
04	4913.01MSD	4913.01MSD	VB004747.D	11/9/99	10:01

Data File : C:\HPCHEM\1\DATA\991108\VB004715.D

Vial: 1

Acq On : 8 Nov 1999 11:22 am

Operator: Skelton

Sample : BFB Tune

Inst : GC VOA 2


Misc : BFB Tune

Multiplr: 1.00

MS Integration Params: GAS1.P

Method : C:\HPCHEM\1\METHODS\M262439.M (RTE Integrator)

Title : Volatile Organics by GC/MS Method 624/8260/TCLP

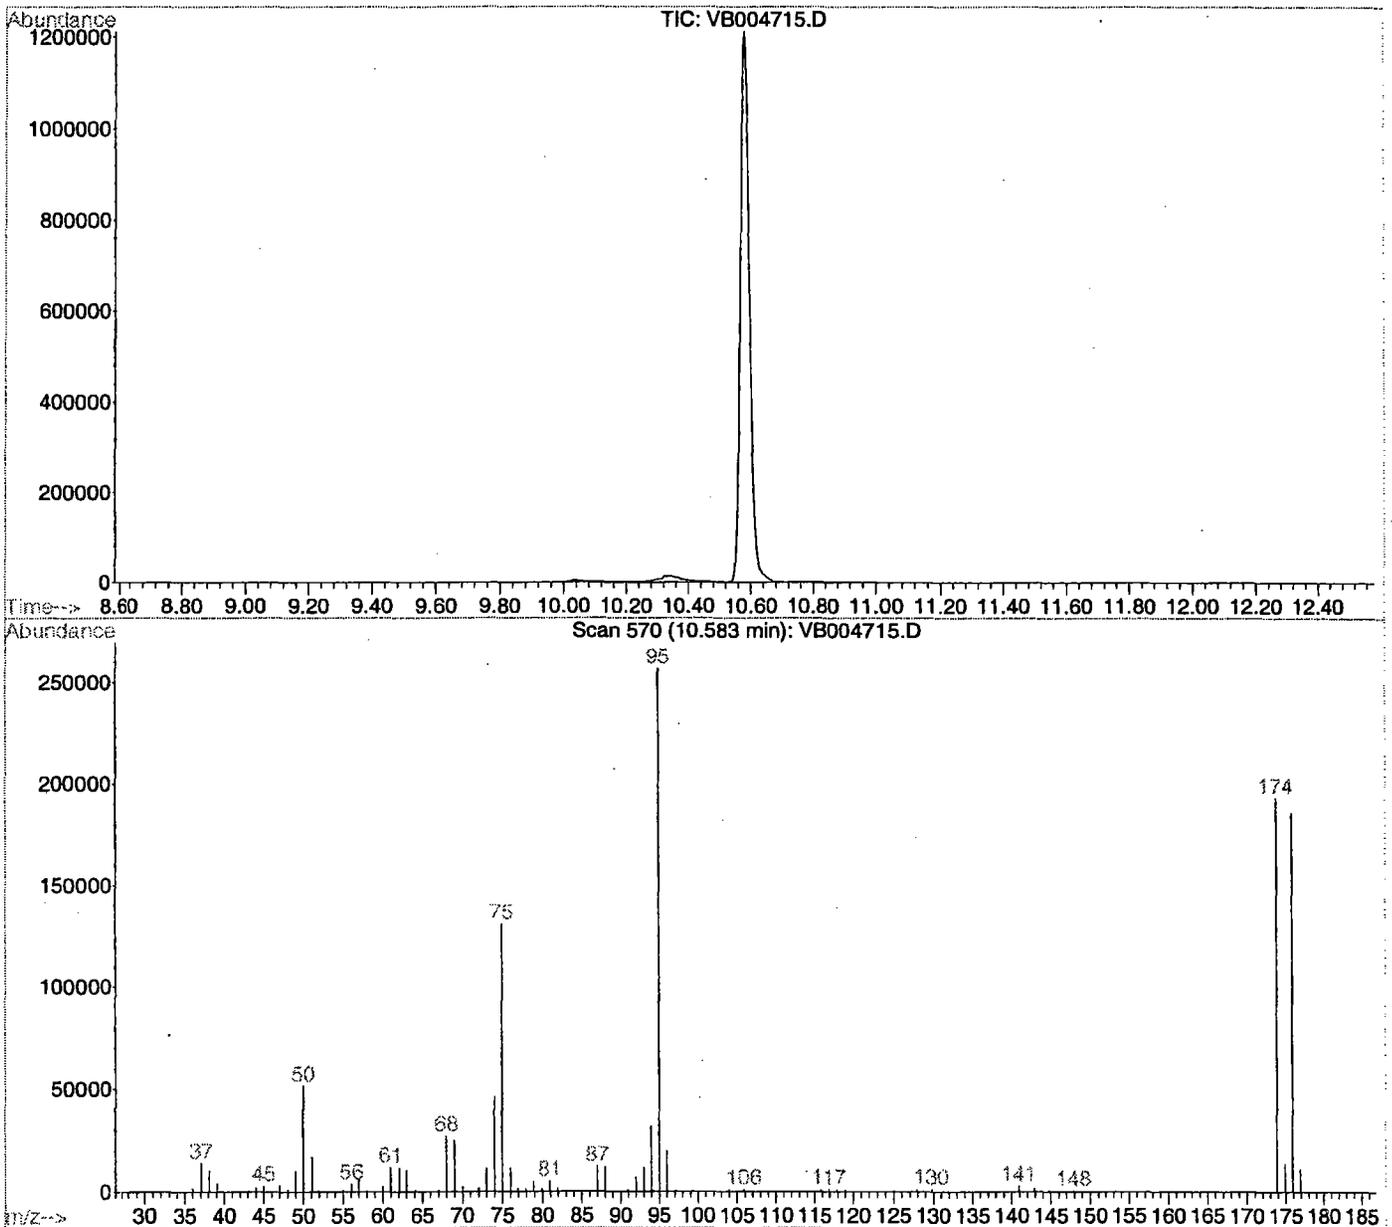

## Spectrum Information: Scan 570

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
50	95	15	40	20.0	51464	PASS
75	95	30	60	50.9	130752	PASS
95	95	100	100	100.0	256896	PASS
96	95	5	9	7.7	19656	PASS
173	174	0.00	2	0.0	0	PASS
174	95	50	100	75.2	193152	PASS
175	174	5	9	7.0	13505	PASS
176	174	95	101	96.2	185728	PASS
177	176	5	9	6.0	11156	PASS

# BASE NEUTRAL

000044

**Semi-Volatile Analysis Report**  
**U.S. Army, Fort Monmouth Environmental Laboratory**  
**NJDEP Certification #13461**

Data File Name **BNA03387.D**  
 Operator **Bhaskar**  
 Date Acquired **19-Nov-99**

Sample Name **Sblk321**  
 Misc Info **Sblk321 A 991116**  
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

## Semi-Volatile Analysis Report

### Page 2

Data File Name **BNA03387.D**  
 Operator **Bhaskar**  
 Date Acquired **19-Nov-99**

Sample Name **Sblk321**  
 Misc Info **Sblk321 A 991116**  
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

\* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

#### Qualifiers

E= Value Exceeds Linear Range  
 D= Value from dilution  
 B= Compound in Related Blank  
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit  
 NLE= No Limit Established  
 R.T.=Retention Time

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

**Sblk321**

Lab Name: FMETL Lab Code 13461

Project UST Case No.: 4937 Location 1106 SDG No.: \_\_\_\_\_

Matrix: (soil/water) WATER Lab Sample ID: Sblk321

Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03387.D

Level: (low/med) LOW Date Received: 11/15/99

% Moisture: \_\_\_\_\_ decanted: (Y/N) N Date Extracted: 11/16/99

Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/19/99

Injection Volume: 1.0 (uL) Dilution Factor: 1.0

GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

## Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BNA03390.D**  
 Operator **Bhaskar**  
 Date Acquired **19-Nov-99**

Sample Name **4937.02**  
 Misc Info **Field Blank**  
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

## Semi-Volatile Analysis Report

### Page 2

Data File Name **BNA03390.D**  
 Operator **Bhaskar**  
 Date Acquired **19-Nov-99**

Sample Name **4937.02**  
 Misc Info **Field Blank**  
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate	26.78	378597	23.21 ug/L	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

\* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

#### Qualifiers

E= Value Exceeds Linear Range  
 D= Value from dilution  
 B= Compound in Related Blank  
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit  
 NLE= No Limit Established  
 R.T.=Retention Time

**000049**

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

Field Blank

Lab Name: FMETL Lab Code 13461  
 Project UST Case No.: 4937 Location 1106 SDG No.: \_\_\_\_\_  
 Matrix: (soil/water) WATER Lab Sample ID: 4937.02  
 Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03390.D  
 Level: (low/med) LOW Date Received: 11/15/99  
 % Moisture: \_\_\_\_\_ decanted: (Y/N) N Date Extracted: 11/16/99  
 Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/19/99  
 Injection Volume: 1.0 (uL) Dilution Factor: 1.0  
 GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

# Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BNA03391.D**  
 Operator **Bhaskar**  
 Date Acquired **19-Nov-99**

Sample Name **4937.08**  
 Misc Info **1006-3-GW**  
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

000051

# Semi-Volatile Analysis Report

## Page 2

Data File Name **BNA03391.D**  
 Operator **Bhaskar**  
 Date Acquired **19-Nov-99**

Sample Name **4937.08**  
 Misc Info **1006-3-GW**  
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

\* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

### Qualifiers

E= Value Exceeds Linear Range  
 D= Value from dilution  
 B= Compound in Related Blank  
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit  
 NLE= No Limit Established  
 R.T.=Retention Time

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

**1006-3-GW**

Lab Name: FMETL Lab Code 13461

Project UST Case No.: 4937 Location 1106 SDG No.:           

Matrix: (soil/water) WATER Lab Sample ID: 4937.08

Sample wt/vol: 900 (g/ml) ML Lab File ID: BNA03391.D

Level: (low/med) LOW Date Received: 11/15/99

% Moisture:            decanted: (Y/N) N Date Extracted: 11/16/99

Concentrated Extract Volume: 1000 (uL) Date Analyzed: 11/19/99

Injection Volume: 1.0 (uL) Dilution Factor: 1.0

GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

## SEMIVOLATILE METHOD BLANK SUMMARY

Sblk321

Lab Name: FMETL Lab Code 13461

Project UST Case No.: 4937 Location 1106 SDG No.: \_\_\_\_\_

Lab File ID: BNA03387.D Lab Sample ID: Sblk321

Instrument ID: GC BNA 2 Date Extracted: 11/16/99

Matrix: (soil/water) WATER Date Analyzed: 11/19/99

Level: (low/med) LOW Time Analyzed: 16:39

THIS METHOD BLANK APPLIES TO THE FOLLOWING SAMPLES, MS AND MSD:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED
01	FIELD BLANK	4937.02	BNA03390.D	11/19/99
02	1006-3-GW	4937.08	BNA03391.D	11/19/99

COMMENTS:

---



---

**SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK  
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)**

Lab Name: FMETL Lab Code 13461  
 Project UST Case No.: 4937 Location 1106 SDG No.: \_\_\_\_\_  
 Lab File ID: BNA03321.D DFTPP Injection Date: 10/27/99  
 Instrument ID: BNA#2 DFTPP Injection Time: 9:32

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	60.0
68	Less than 2.0% of mass 69	0.0 ( 0.0)1
69	Mass 69 Relative abundance	56.4
70	Less than 2.0% of mass 69	0.3 ( 0.6)1
127	25.0 - 75.0% of mass 198	53.8
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	7.1
275	10.0 - 30.0% of mass 198	19.9
365	Greater than 0.75% of mass 198	2.0
441	Present, but less than mass 443	8.7
442	40.0 - 110.0% of mass 198	59.1
443	15.0 - 24.0% of mass 442	12.0 ( 20.4)2



1-Value is % mass 69

2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BNA03323.D	10/27/99	10:55
02	SSTD080	80 PPM CAL	BNA03324.D	10/27/99	11:50
03	SSTD050	50 PPM CAL	BNA03325.D	10/27/99	12:40
04	SSTD010	10 PPM CAL	BNA03326.D	10/27/99	13:31
05	SSTD020	20 PPM CAL	BNA03327.D	10/27/99	14:20
06	4871.04DUP	4871.04DUP	BNA03332.D	10/27/99	18:28
07	4871.04MS	4871.04MS	BNA03333.D	10/27/99	19:17

Data File : C:\HPCHEM\1\DATA\991027\BNA03321.D Vial: 99  
 Acq On : 27 Oct 1999 9:32 am Operator: Bhaskar  
 Sample : DFTPP TUNE Inst : GC BNA 2  
 Misc : 50NG/2UL Multiplr: 1.00  
 MS Integration Params: RTEINT.P  
 Method : C:\HPCHEM\1\METHODS\M262534.M (RTE Integrator)  
 Title : BNA Calibration

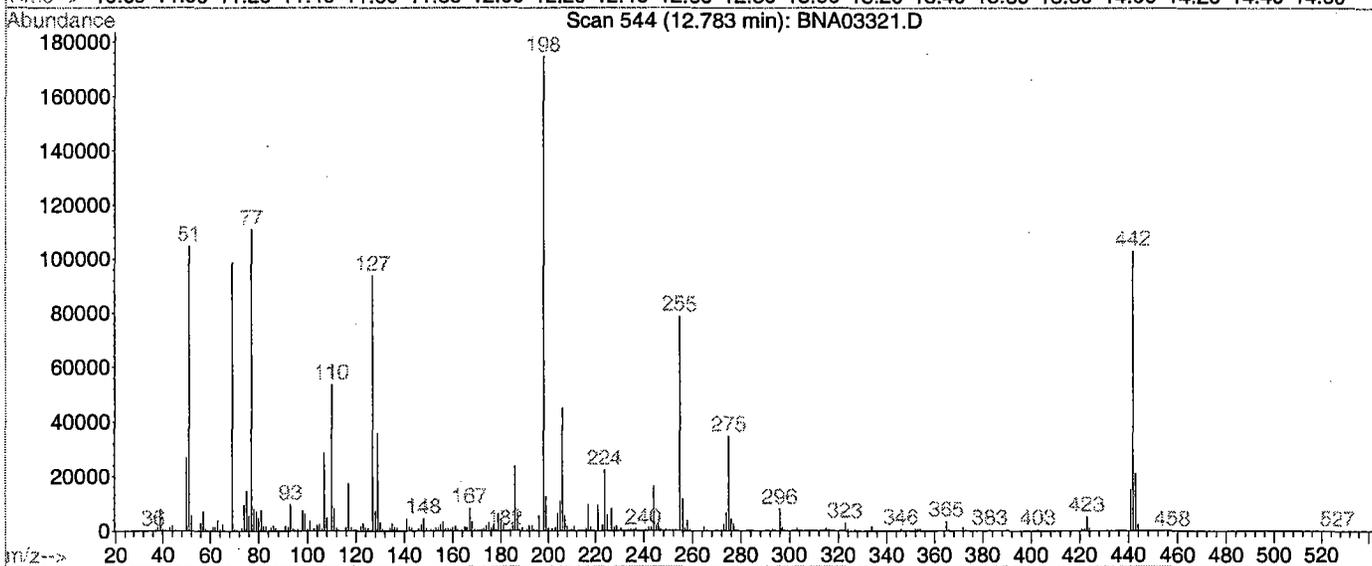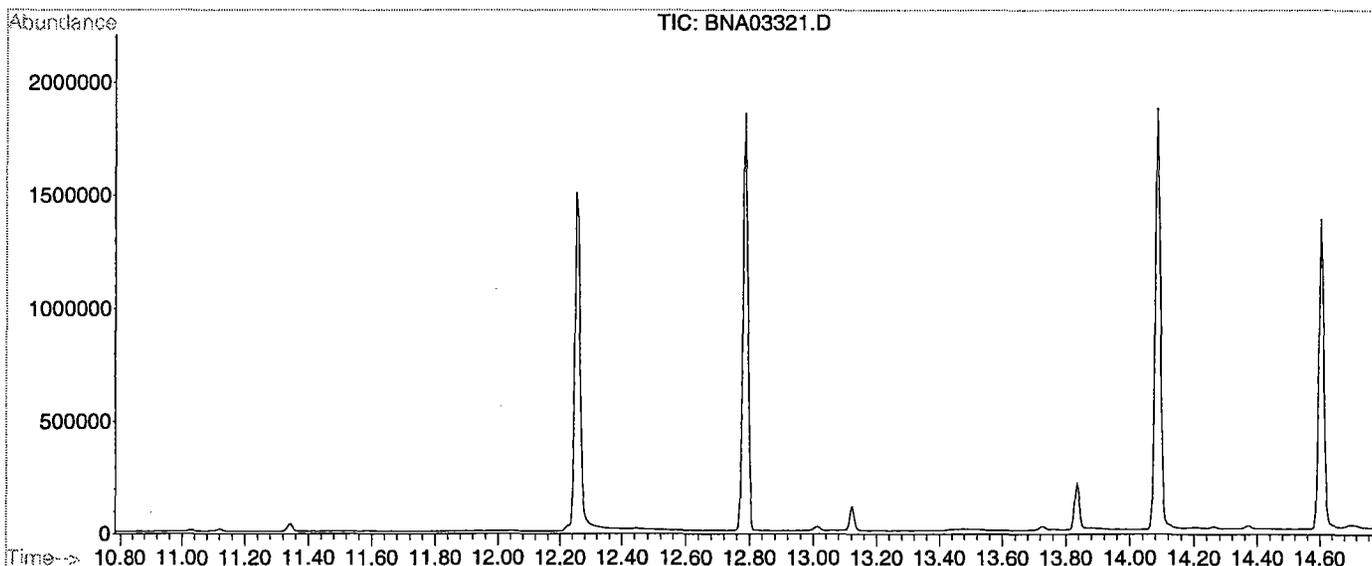

Spectrum Information: Scan 544

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	60.0	104832	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	56.4	98600	PASS
70	69	0.00	2	0.6	593	PASS
127	198	40	60	53.8	94000	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	174720	PASS
199	198	5	9	7.1	12479	PASS
275	198	10	30	19.9	34848	PASS
365	198	1	100	2.0	3527	PASS
441	443	1	99	72.0	15134	PASS
442	198	40	100	59.1	103184	PASS
443	442	17	23	20.4	21008	PASS

# LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS


The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

Laboratory Manager or Environmental Consultant's Signature

Date 4/8/00

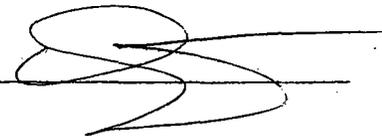


Laboratory Certification #13461

\*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance.

000098

## Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.

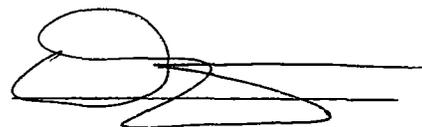

Daniel K. Wright  
Laboratory Manager

000099

# FORT MONMOUTH ENVIRONMENTAL TESTING LABORATORY

DIRECTORATE OF PUBLIC WORKS

PHONE: (732) 532-6224 FAX: (732) 532-6263

WET-CHEM - METALS - ORGANICS - FIELD SAMPLING

CERTIFICATIONS: NJDEP #13461, NYSDOH #11699



ANALYTICAL DATA REPORT  
Fort Monmouth Environmental Laboratory  
ENVIRONMENTAL DIVISION  
Fort Monmouth, New Jersey  
PROJECT: UST Program

## Bldg. 1006

Field Sample Location	Laboratory Sample ID#	Matrix	Date and Time of Collection	Date Received
1006-1 8-13'	5009.01	Aqueous	11-Dec-99 10:40	12/13/99
1006 12-17'	5081.01	Aqueous	08-Jan-00 09:15	01/10/00

ANALYSIS:  
FORT MONMOUTH ENVIRONMENTAL LAB  
VOA+15, BN+15

ENCLOSURE:  
CHAIN OF CUSTODY  
RESULTS

 5-4-00  
Daniel Wright/Date  
Laboratory Director

## Table of Contents

<u>Section</u>	<u>Pages</u>
Chain of Custody	1-3
Methodology Summary	4-5
Conformance/Non-Conformance Summary	6-8
Laboratory Chronicle	9-10
Volatile Organics	11-12
Analytical Results Summary	13-16
Tune Results Summary	17-20
Method Blank Results Summary	21
Calibration Summary	22-23
Surrogate Recovery Summary	24
MS/MSD Results Summary	25-26
Internal Standard Area & RT Summary	27
Chromatograms	28-31
Base Neutrals	32
Analytical Results Summary	33-38
Tune Results Summary	39-42
Method Blank Results Summary	43
Calibration Summary	44-47
Surrogate Recovery Summary	48
MS/MSD Results Summary	49-52
Internal Standard Area & RT Summary	53-54
Chromatograms	55-63
Laboratory Deliverables Checklist	64
Laboratory Authentication Statement	65

**CHAIN  
OF  
CUSTODY**

**000001**



# Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703


Tel (732)532-4359 Fax (732)532-6263 EMail:appleby@mail1.monmouth.army.mil

NJDEP Certification #13461

## Chain of Custody Record

Customer: <i>D. DESAI</i>		Project No:				Analysis Parameters						Comments:			
Phone #: <i>121475</i>		Location: <i>BLDG. 1006</i>				V O A +	B N +								
( ) DERA (X) OMA ( ) Other: _____															
Samplers Name / Company: <i>Mark Landa - TVS - PWS 07</i>						Sample #									Remarks / Preservation Method
Lab Sample ID.	Sample Location			Date	Time	Type	bottles								
<i>5009. 1</i>	<i>1006-1</i>	<i>8-13'</i>	<i>12-11-99</i>	<i>1040</i>	<i>AQ.</i>	<i>3</i>	<i>15</i>	<i>15</i>							<i>Hold, 240C.</i>
Relinquished by (signature): <i>[Signature]</i>		Date/Time: <i>12-13-99 730</i>	Received by (signature): <i>[Signature]</i>				Relinquished by (signature):		Date/Time:	Received by (signature):					
Relinquished by (signature):		Date/Time:	Received by (signature):				Relinquished by (signature):		Date/Time:	Received by (signature):					
Report Type: ( ) Full, (X) Reduced, ( ) Standard, ( ) Screen / non-certified						Remarks: <i>SHARED T.B. + F.B. W / BLDG. 800</i>									
Turnaround time: (X) Standard 3 wks, ( ) Rush Days, ( ) ASAP Verbal Hrs.															

000002

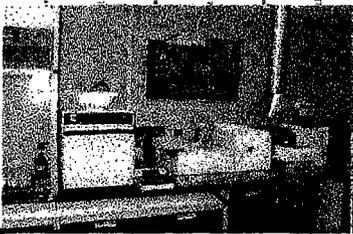

# Fort Monmouth Environmental Testing Laboratory

Bldg. 173, SELFM-PW-EV, Fort Monmouth, NJ 07703

Tel (732)532-4359 Fax (732)532-6263 EMail:wrightd@mail1.monmouth.army.mil

NJDEP Certification #13461

## Chain of Custody Record

Customer: <i>D. DESAL</i>		Project No:		Analysis Parameters							Comments:	
Phone #: <i>X21475</i>		Location: <i>BL06.1006</i>		<i>B N + 15</i>								
( ) DERA ( <input checked="" type="checkbox"/> ) OMA ( ) Other: _____												
Samplers Name / Company: <i>MARK LAUCA - TVS - PWS 07</i>		Sample #										
Lab Sample I.D.	Sample Location	Date	Time	Type	bottles							Remarks / Preservation Method
<i>5081 01*</i>	<i>1006 12-17'</i>	<i>1-8-00</i>	<i>0915</i>	<i>AQ.</i>	<i>1</i>	<i>X</i>						
Relinquished by (signature): <i>[Signature]</i>	Date/Time: <i>1-10-00 0800</i>	Received by (signature): <i>[Signature]</i>		Relinquished by (signature):	Date/Time:	Received by (signature):						
Relinquished by (signature):	Date/Time:	Received by (signature):		Relinquished by (signature):	Date/Time:	Received by (signature):						
Report Type: ( ) Full, ( ) Reduced, ( <input checked="" type="checkbox"/> ) Standard, ( ) Screen / non-certified, ( ) EDD						Remarks: <i>*LAB # 500901 RESAMPLE SHIPPED T.B.+F.B. w/BL06.977</i>						
Turnaround time: ( ) Standard 3 wks, ( <input checked="" type="checkbox"/> ) Rush _____ Days, ( ) ASAP Verbal _____ Hrs.												

500003

# METHODOLOGY SUMMARY

000004

## Method Summary

### **EPA Method 624**

#### **Gas Chromatographic Determination of Volatiles in Water**

Surrogates and internal standards are added to a 5-ml aliquot of sample. The sample is then purged and desorbed into a GC/MS system. The organic compounds are separated by the gas chromatograph and detected using the mass spectrometer. Volatiles are identified and quantitated.

### **EPA Method 3510/8270**

#### **Gas Chromatographic Determination of Semi-volatiles in Water**

Surrogates are added to measured volume of sample, usually 1 liter, at a specified pH. The sample is serially extracted with Methylene chloride using a separatory funnel. The extract concentrated and internal standards are added. The sample is injected into a GC/MS system. Semi-volatiles are identified and quantitated.

000005

**CONFORMANCE  
NON-CONFORMANC  
SUMMARY**

000006

**GC/MS ANALYSIS CONFORMANCE/NON-CONFORMANCE SUMMARY FORMAT**

Indicate  
Yes, No, N/A

1. Chromatograms Labeled/Compounds Identified  
(Field Samples and Method Blanks) yes
  
2. Retention times for chromatograms provided yes
  
3. GC/MS Tune Specifications yes
  - a. BFB Meet Criteria yes
  - b. DFTPP Meet Criteria yes
  
4. GC/MS Tuning Frequency - Performed every 24 hours for 600 series and 12 hours for 8000 series yes
  
5. GC/MS Calibration - Initial Calibration performed before sample analysis and continuing calibration performed within 24 hours of sample analysis for 600 series and 12 hours for 8000 series yes
  
6. GC/MS Calibration Requirements yes
  - a. Calibration Check Compounds Meet Criteria yes
  - b. System Performance Check Compounds Meet Criteria yes
  
7. Blank Contamination - If yes, List compounds and concentrations in each blank: NO
  - a. VOA Fraction \_\_\_\_\_
  - b. B/N Fraction \_\_\_\_\_
  - c. Acid Fraction NA
  
8. Surrogate Recoveries Meet Criteria yes

If not met, list those compounds and their recoveries, which fall outside the acceptable range:

  - a. VOA Fraction \_\_\_\_\_
  - b. B/N Fraction \_\_\_\_\_
  - c. Acid Fraction NA

If not met, were the calculations checked and the results qualified as "estimated"?

\_\_\_\_\_
  
9. Matrix Spike/Matrix Spike Duplicate Recoveries Meet Criteria yes

(If not met, list those compounds and their recoveries, which fall outside the acceptable range)

  - a. VOA Fraction \_\_\_\_\_
  - b. B/N Fraction \_\_\_\_\_
  - c. Acid Fraction NA

GC/MS Analysis Conformance/Non-Conformance Summary (cont.)

Indicate  
Yes,  
No,  
N/A

10. Internal Standard Area/Retention Time Shift Meet Criteria  
(If not met, list those compounds, which fall outside the acceptable range)

YES

- a. VOA Fraction \_\_\_\_\_
- b. B/N Fraction \_\_\_\_\_
- c. Acid Fraction NA

11. Extraction Holding Time Met

YES

If not met, list number of days exceeded for each sample: \_\_\_\_\_

\_\_\_\_\_

12. Analysis Holding Time Met

YES

If not met, list number of days exceeded for each sample: \_\_\_\_\_

\_\_\_\_\_

Additional Comments:

\_\_\_\_\_  
\_\_\_\_\_

Laboratory Manager



Date:

5-4-00

# LABORATORY CHRONICLE

000009

# Laboratory Chronicle

Lab ID: 5009/5081

Site: Bldg. 1006

	Date	Hold Time
Date Sampled	12/13/99, 01/08/00	NA
Receipt/Refrigeration	12/13/99, 01/08/00	NA

## Extractions

1. Base Neutral*	01/10/00	14 days
------------------	----------	---------

## Analyses

1. Volatile Organics	12/13,14/99	14 days
2. Base Neutral	01/11/00	40 days

- Samples collected and refrigerated on 12/11/99 for VOA, Laboratory received the sample on Monday 12/13/99.

Samples collected and refrigerated on 01/08/00 for BN, Laboratory received the Sample on Monday 01/10/00.

\* BN bottle collected on 12/11/99 was broken in Lab. Resample on 01/08/00.

000010

# VOLATILE ORGANICS

000011

**US ARMY FT. MONMOUTH ENVIRONMENTAL LABORATORY  
NJDEPE # 13461**

**Definition of Qualifiers**

**MDL** : Method Detection Limit  
**J** : Compound identified below detection limit  
**B** : Compound in both sample and blank  
**D** : Results from dilution of sample  
**U** : Compound searched for but not detected  
**E** : Compound exceeds calibration limit

000012

**Volatile Analysis Report**  
**U.S. Army, Fort Monmouth Environmental Laboratory**  
**NJDEP Certification #13461**

Data File **VC001540.D**  
 Operator **Skelton**  
 Date Acquired **13 Dec 1999 5:42 pm**

Sample Name **Vblk41**  
 Field ID **Vblk41**  
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m+p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

\*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7-9-6 2-Sept-9

**Qualifiers**

B = Compound found in related blank  
 E = Value above linear range  
 D = Value from dilution  
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit  
 NLE = No Limit Established  
 R.T. = Retention Time

1E

VOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

Vblk41

Lab Name: FMETL NJDEP#: 13461  
Project: 100004 Case No.: 5009 Location: Bldg10 SDG No.: \_\_\_\_\_  
Matrix: (soil/water) WATER Lab Sample ID: Vblk41  
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001540.D  
Level: (low/med) LOW Date Received: 12/13/99  
% Moisture: not dec. \_\_\_\_\_ Date Analyzed: 12/13/99  
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0  
Soil Extract Volume: \_\_\_\_\_ (uL) Soil Aliquot Volume: \_\_\_\_\_ (uL)

CONCENTRATION UNITS:

(ug/L or ug/Kg) UG/L

Number TICs found: 0

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

**Volatile Analysis Report**  
**U.S. Army, Fort Monmouth Environmental Laboratory**  
**NJDEP Certification #13461**

Data File **VC001564.D**  
 Operator **Skelton**  
 Date Acquired **14 Dec 1999 9:56 am**

Sample Name **5009.01**  
 Field ID **1006-1**  
 Sample Multiplier **1**

CAS#	Compound Name	R.T.	Response	Result	Regulatory Level (ug/l)*	MDL	Qualifier
107028	Acrolein			not detected	50	1.85 ug/L	
107131	Acrylonitrile			not detected	50	2.78 ug/L	
75650	tert-Butyl alcohol			not detected	nle	8.52 ug/L	
1634044	Methyl-tert-Butyl ether			not detected	70	0.16 ug/L	
108203	Di-isopropyl ether			not detected	nle	0.25 ug/L	
	Dichlorodifluoromethane			not detected	nle	1.68 ug/L	
74-87-3	Chloromethane			not detected	30	1.16 ug/L	
75-01-4	Vinyl Chloride			not detected	5	1.06 ug/L	
74-83-9	Bromomethane			not detected	10	1.10 ug/L	
75-00-3	Chloroethane			not detected	nle	1.01 ug/L	
75-69-4	Trichlorofluoromethane			not detected	nle	0.50 ug/L	
75-35-4	1,1-Dichloroethene			not detected	2	0.24 ug/L	
67-64-1	Acetone			not detected	700	1.36 ug/L	
75-15-0	Carbon Disulfide			not detected	nle	0.46 ug/L	
75-09-2	Methylene Chloride			not detected	2	0.24 ug/L	
156-60-5	trans-1,2-Dichloroethene			not detected	100	0.16 ug/L	
75-35-3	1,1-Dichloroethane			not detected	70	0.12 ug/L	
108-05-4	Vinyl Acetate			not detected	nle	0.78 ug/L	
78-93-3	2-Butanone			not detected	300	0.62 ug/L	
	cis-1,2-Dichloroethene			not detected	10	0.17 ug/L	
67-66-3	Chloroform			not detected	6	0.30 ug/L	
75-55-6	1,1,1-Trichloroethane			not detected	30	0.23 ug/L	
56-23-5	Carbon Tetrachloride			not detected	2	0.47 ug/L	
71-43-2	Benzene			not detected	1	0.23 ug/L	
107-06-2	1,2-Dichloroethane			not detected	2	0.18 ug/L	
79-01-6	Trichloroethene			not detected	1	0.23 ug/L	
78-87-5	1,2-Dichloropropane			not detected	1	0.40 ug/L	
75-27-4	Bromodichloromethane			not detected	1	0.55 ug/L	
110-75-8	2-Chloroethyl vinyl ether			not detected	nle	0.65 ug/L	
10061-01-5	cis-1,3-Dichloropropene			not detected	nle	0.69 ug/L	
108-10-1	4-Methyl-2-Pentanone			not detected	400	0.59 ug/L	
108-88-3	Toluene			not detected	1000	0.37 ug/L	
10061-02-6	trans-1,3-Dichloropropene			not detected	nle	0.87 ug/L	
79-00-5	1,1,2-Trichloroethane			not detected	3	0.48 ug/L	
127-18-4	Tetrachloroethene			not detected	1	0.32 ug/L	
591-78-6	2-Hexanone			not detected	nle	0.71 ug/L	
126-48-1	Dibromochloromethane			not detected	10	0.86 ug/L	
108-90-7	Chlorobenzene			not detected	4	0.39 ug/L	
100-41-4	Ethylbenzene			not detected	700	0.65 ug/L	
1330-20-7	m-p-Xylenes			not detected	nle	1.14 ug/L	
1330-20-7	o-Xylene			not detected	nle	0.62 ug/L	
100-42-5	Styrene			not detected	100	0.56 ug/L	
75-25-2	Bromoform			not detected	4	0.70 ug/L	
79-34-5	1,1,2,2-Tetrachloroethane			not detected	2	0.47 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	0.55 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	0.57 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	0.64 ug/L	

\*Higher of PQL's and Ground Water Quality Criteria as per N.J.A.C. 7:9-6 2-Sept-9

**Qualifiers**

B = Compound found in related blank  
 E = Value above linear range  
 D = Value from dilution  
 PQL = Practical Quantitation Limit

MDL = Method Detection Limit  
 NLE = No Limit Established  
 R.T. = Retention Time

1E  
VOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID:

1006-1

Lab Name: FMETL NJDEP#: 13461  
Project: 100004 Case No.: 5009 Location: Bldg10 SDG No.: \_\_\_\_\_  
Matrix: (soil/water) WATER Lab Sample ID: 5009.01  
Sample wt/vol: 5.0 (g/ml) ML Lab File ID: VC001564.D  
Level: (low/med) LOW Date Received: 12/13/99  
% Moisture: not dec. \_\_\_\_\_ Date Analyzed: 12/14/99  
GC Column: RTX502 ID: 0.25 (mm) Dilution Factor: 1.0  
Soil Extract Volume: \_\_\_\_\_ (uL) Soil Aliquot Volume: \_\_\_\_\_ (uL)

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NO.	COMPOUND NAME	RT	EST. CONC.	Q
---------	---------------	----	------------	---

# BASE NEUTRAL

000032

## Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BNA03543.D**  
 Operator **Bhaskar**  
 Date Acquired **11-Jan-00**

Sample Name **Sblk335**  
 Misc Info **Sblk335 A 000110**  
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

## Semi-Volatile Analysis Report

### Page 2

Data File Name **BNA03543.D**  
 Operator **Bhaskar**  
 Date Acquired **11-Jan-00**

Sample Name **Sblk335**  
 Misc Info **Sblk335 A 000110**  
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

\* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

#### Qualifiers

E= Value Exceeds Linear Range  
 D= Value from dilution  
 B= Compound in Related Blank  
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit  
 NLE= No Limit Established  
 R.T.=Retention Time

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

**Sbik335**

Lab Name: FMETL Lab Code 13461

Project 100004 Case No.: 5081 Location Bl.1006 SDG No.: \_\_\_\_\_

Matrix: (soil/water) WATER Lab Sample ID: Sbik335

Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03543.D

Level: (low/med) LOW Date Received: 1/10/00

% Moisture: \_\_\_\_\_ decanted: (Y/N) N Date Extracted: 1/10/00

Concentrated Extract Volume: 1000 (uL) Date Analyzed: 1/11/00

Injection Volume: 1.0 (uL) Dilution Factor: 1.0

GPC Cleanup: (Y/N) N pH: 7

CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

## Semi-Volatile Analysis Report

U.S. Army, Fort Monmouth Environmental Laboratory

NJDEP Certification #13461

Data File Name **BNA03539.D**  
 Operator **Bhaskar**  
 Date Acquired **11-Jan-00**

Sample Name **5081.01**  
 Misc Info **1006**  
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
110-86-1	Pyridine			not detected	NLE	1.83 ug/L	
62-75-9	N-nitroso-dimethylamine			not detected	20	0.91 ug/L	
62-53-3	Aniline			not detected	NLE	1.63 ug/L	
111-44-4	bis(2-Chloroethyl)ether			not detected	10	1.28 ug/L	
541-73-1	1,3-Dichlorobenzene			not detected	600	1.21 ug/L	
106-46-7	1,4-Dichlorobenzene			not detected	75	1.19 ug/L	
100-51-6	Benzyl alcohol			not detected	NLE	1.02 ug/L	
95-50-1	1,2-Dichlorobenzene			not detected	600	1.13 ug/L	
108-60-1	bis(2-chloroisopropyl)ether			not detected	300	1.39 ug/L	
621-64-7	n-Nitroso-di-n-propylamine			not detected	20	0.80 ug/L	
67-72-1	Hexachloroethane			not detected	10	1.50 ug/L	
98-95-3	Nitrobenzene			not detected	10	0.97 ug/L	
78-59-1	Isophorone			not detected	100	1.01 ug/L	
111-91-1	bis(2-Chloroethoxy)methane			not detected	NLE	1.21 ug/L	
120-82-1	1,2,4-Trichlorobenzene			not detected	9	1.22 ug/L	
91-20-3	Naphthalene			not detected	NLE	1.27 ug/L	
106-47-8	4-Chloroaniline			not detected	NLE	1.09 ug/L	
87-68-3	Hexachlorobutadiene			not detected	1	0.71 ug/L	
91-57-6	2-Methylnaphthalene			not detected	NLE	1.08 ug/L	
77-47-4	Hexachlorocyclopentadiene			not detected	50	1.32 ug/L	
91-58-7	2-Chloronaphthalene			not detected	NLE	1.01 ug/L	
88-74-4	2-Nitroaniline			not detected	NLE	0.96 ug/L	
131-11-3	Dimethylphthalate			not detected	7000	1.52 ug/L	
208-96-8	Acenaphthylene			not detected	NLE	0.96 ug/L	
606-20-2	2,6-Dinitrotoluene			not detected	NLE	0.81 ug/L	
99-09-2	3-Nitroaniline			not detected	NLE	0.79 ug/L	
83-32-9	Acenaphthene			not detected	400	1.10 ug/L	
132-64-9	Dibenzofuran			not detected	NLE	1.00 ug/L	
121-14-2	2,4-Dinitrotoluene			not detected	10	0.87 ug/L	
84-66-2	Diethylphthalate			not detected	5000	1.62 ug/L	
86-73-7	Fluorene			not detected	300	0.99 ug/L	
7005-72-3	4-Chlorophenyl-phenylether			not detected	NLE	1.10 ug/L	
100-01-6	4-Nitroaniline			not detected	NLE	1.05 ug/L	
86-30-6	n-Nitrosodiphenylamine			not detected	20	1.01 ug/L	
103-33-3	Azobenzene			not detected	NLE	0.67 ug/L	
101-55-3	4-Bromophenyl-phenylether			not detected	NLE	0.76 ug/L	
118-74-1	Hexachlorobenzene			not detected	10	0.94 ug/L	
85-01-8	Phenanthrene			not detected	NLE	1.23 ug/L	
120-12-7	Anthracene			not detected	2000	1.12 ug/L	
84-74-2	Di-n-butylphthalate			not detected	900	1.70 ug/L	
206-44-0	Fluoranthene			not detected	300	1.64 ug/L	

## Semi-Volatile Analysis Report

### Page 2

Data File Name **BNA03539.D**  
 Operator **Bhaskar**  
 Date Acquired **11-Jan-00**

Sample Name **5081.01**  
 Misc Info **1006**  
 Sample Multiplier **1**

CAS#	Name	R.T.	Response	Result	Regulatory Level (ug/L)*	MDL	Qualifiers
92-87-5	Benzidine			not detected	50	4.18 ug/L	
129-00-0	Pyrene			not detected	200	1.25 ug/L	
85-68-7	Butylbenzylphthalate			not detected	100	1.05 ug/L	
56-55-3	Benzo[a]anthracene			not detected	10	1.19 ug/L	
91-94-1	3,3'-Dichlorobenzidine			not detected	60	1.75 ug/L	
218-01-9	Chrysene			not detected	20	1.38 ug/L	
117-81-7	bis(2-Ethylhexyl)phthalate			not detected	30	1.74 ug/L	
117-84-0	Di-n-octylphthalate			not detected	100	1.44 ug/L	
205-99-2	Benzo[b]fluoranthene			not detected	10	1.25 ug/L	
207-08-9	Benzo[k]fluoranthene			not detected	2	1.29 ug/L	
50-32-8	Benzo[a]pyrene			not detected	20	1.05 ug/L	
193-39-5	Indeno[1,2,3-cd]pyrene			not detected	20	0.83 ug/L	
53-70-3	Dibenz[a,h]anthracene			not detected	20	0.64 ug/L	
191-24-2	Benzo[g,h,i]perylene			not detected	NLE	0.84 ug/L	

\* Higher of PQL's and Ground Water Criteria as per NJAC 7:9-6 2-Sept-97

#### Qualifiers

E= Value Exceeds Linear Range  
 D= Value from dilution  
 B= Compound in Related Blank  
 PQL= Practical Quantitation Limit

MDL= Method Detection Limit  
 NLE= No Limit Established  
 R.T.=Retention Time

SEMIVOLATILE ORGANICS ANALYSIS DATA SHEET  
TENTATIVELY IDENTIFIED COMPOUNDS

FIELD ID

1006

Lab Name: FMETL Lab Code 13461

Project 100004 Case No.: 5081 Location Bl.1006 SDG No.: \_\_\_\_\_

Matrix: (soil/water) WATER Lab Sample ID: 5081.01

Sample wt/vol: 1000 (g/ml) ML Lab File ID: BNA03539.D

Level: (low/med) LOW Date Received: 1/10/00

% Moisture: \_\_\_\_\_ decanted: (Y/N) N Date Extracted: 1/10/00

Concentrated Extract Volume: 1000 (uL) Date Analyzed: 1/11/00

Injection Volume: 1.0 (uL) Dilution Factor: 1.0

GPC Cleanup: (Y/N) N pH: 7

## CONCENTRATION UNITS:

Number TICs found: 0 (ug/L or ug/Kg) UG/L

CAS NUMBER	COMPOUND NAME	RT	EST. CONC.	Q
------------	---------------	----	------------	---

SEMIVOLATILE ORGANIC INSTRUMENT PERFORMANCE CHECK  
DECAFLUOROTRIPHENYLPHOSPHINE (DFTPP)

Lab Name: FMETL Lab Code 13461  
 Project 100004 Case No.: 5081 Location Bl.1006 SDG No.: \_\_\_\_\_  
 Lab File ID: BNA03470.D DFTPP Injection Date: 12/22/99  
 Instrument ID: BNA#2 DFTPP Injection Time: 9:53

m/e	ION ABUNDANCE CRITERIA	% RELATIVE ABUNDANCE
51	30.0 - 80.0% of mass 198	45.5
68	Less than 2.0% of mass 69	0.0 ( 0.0)1
69	Mass 69 Relative abundance	43.9
70	Less than 2.0% of mass 69	0.2 ( 0.5)1
127	25.0 - 75.0% of mass 198	50.1
197	Less than 1.0% of mass 198	0.0
198	Base Peak, 100% relative abundance	100.0
199	5.0 to 9.0% of mass 198	6.4
275	10.0 - 30.0% of mass 198	22.5
365	Greater than 0.75% of mass 198	2.5
441	Present, but less than mass 443	13.5
442	40.0 - 110.0% of mass 198	89.7
443	15.0 - 24.0% of mass 442	17.5 ( 19.5)2

1-Value is % mass 69



2-Value is % mass 442

THIS CHECK APPLIES TO THE FOLLOWING SAMPLES, MS, MSD, BLANKS, AND STANDARDS:

	FIELD ID	LAB SAMPLE ID	LAB FILE ID	DATE ANALYZED	TIME ANALYZED
01	SSTD120	120 PPM CAL	BNA03471.D	12/22/99	10:20
02	SSTD080	80 PPM CAL	BNA03472.D	12/22/99	11:07
03	SSTD050	50 PPM CAL	BNA03473.D	12/22/99	11:55
04	SSTD020	20 PPM CAL	BNA03474.D	12/22/99	12:42
05	SSTD010	10 PPM CAL	BNA03475.D	12/22/99	13:30

Data File : C:\HPCHEM\1\DATA\991222\BNA03470.D  
 Acq On : 22 Dec 1999 9:53 am  
 Sample : DFTPP TUNE  
 Misc : 50 NG/2UL  
 MS Integration Params: RTEINT.P  
 Method : C:\HPCHEM\1\METHODS\M262535.M (RTE Integrator)  
 Title : BNA Calibration

Vial: 99  
 Operator: Bhaskar  
 Inst : GC BNA 2  
 Multiplr: 1.00

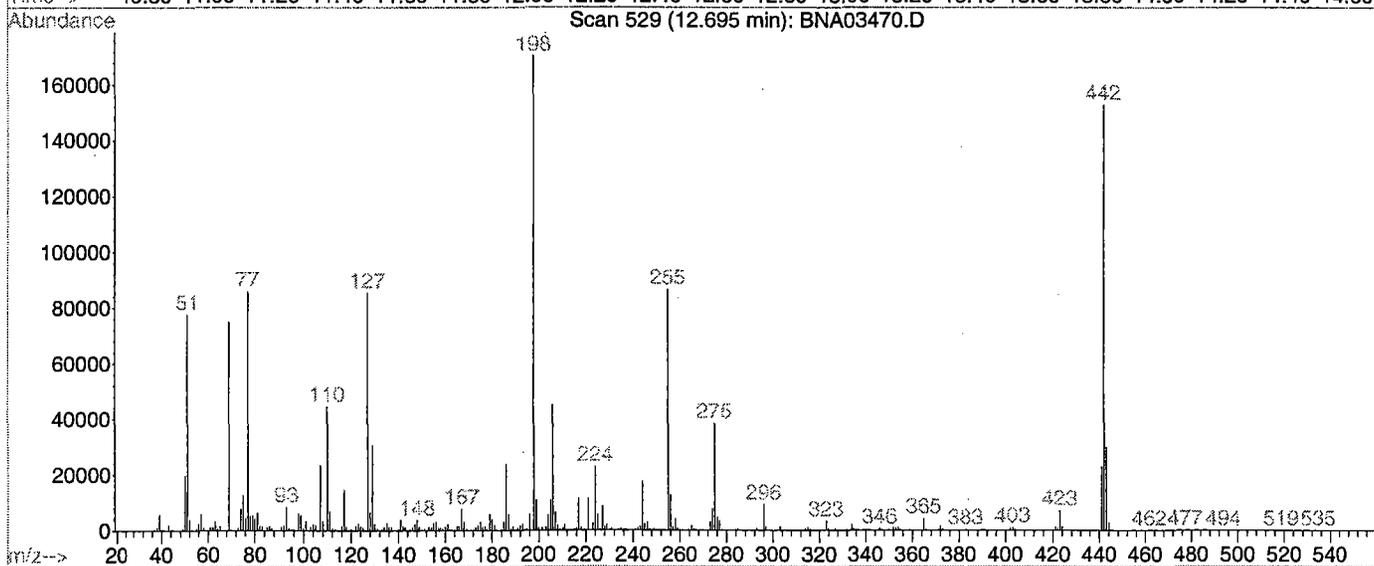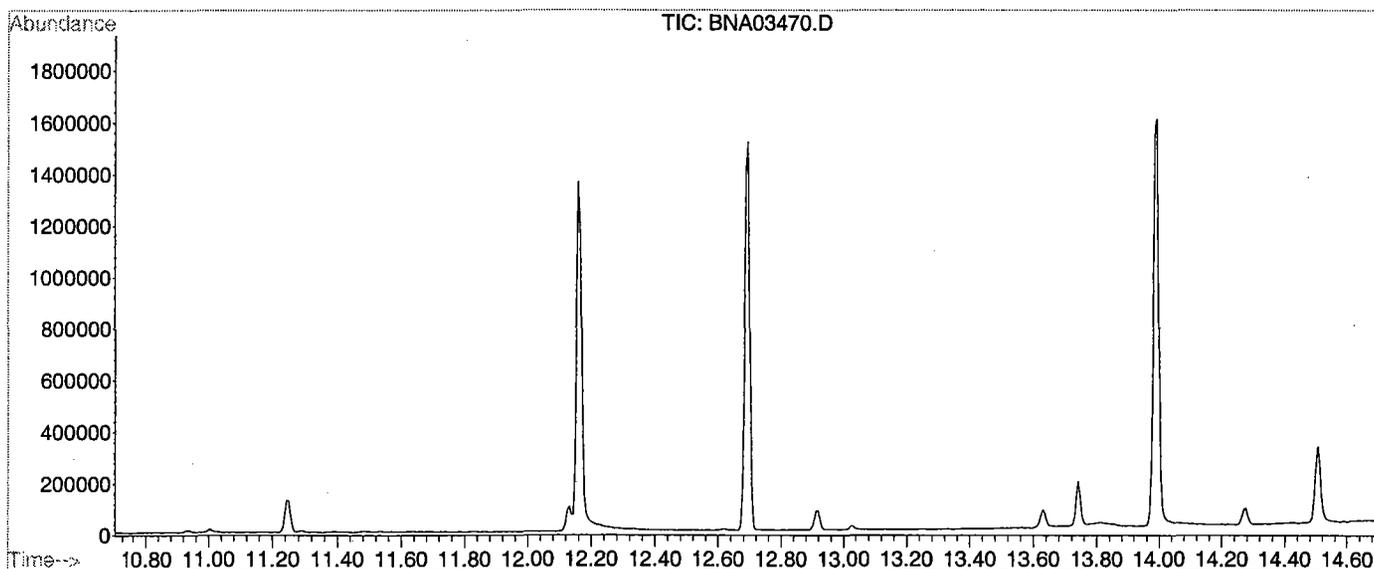

Spectrum Information: Scan 529

Target Mass	Rel. to Mass	Lower Limit%	Upper Limit%	Rel. Abn%	Raw Abn	Result Pass/Fail
51	198	30	60	45.5	77600	PASS
68	69	0.00	2	0.0	0	PASS
69	198	0.00	100	43.9	74840	PASS
70	69	0.00	2	0.5	381	PASS
127	198	40	60	50.1	85376	PASS
197	198	0.00	1	0.0	0	PASS
198	198	100	100	100.0	170496	PASS
199	198	5	9	6.4	10917	PASS
275	198	10	30	22.5	38408	PASS
365	198	1	100	2.5	4279	PASS
441	443	1	99	77.1	23000	PASS
442	198	40	100	89.7	152896	PASS
443	442	17	23	19.5	29848	PASS

# LABORATORY DELIVERABLES CHECKLIST AND NON-CONFORMANCE SUMMARY

THIS FORM MUST BE COMPLETED BY THE LABORATORY OR ENVIRONMENTAL CONSULTANT AND ACCOMPANY ALL DATA SUBMISSIONS

The following Laboratory Deliverables checklist and Non-Conformance Summary shall be included in the data submission. All deviations from the accepted methodology and procedures, of performance values outside acceptable ranges shall be summarized in the Non-Conformance Summary. The Technical Requirements for Site Remediation, effective June 7, 1993, provides further details. The document shall be bound and paginated, contain a table of contents, and all pages shall be legible. Incomplete packages will be returned or held without review until the data package is completed.

It is recommended that the analytical results summary sheets listing all targeted and non-targeted compounds with the method detection limits, practical quantitation limits, and the laboratory and/or sample numbers be included in one section of the data package and in the main body of the report.

1. Cover page, Title Page listing Lab Certification #, facility name and address, & date of report submitted
2. Table of Contents submitted
3. Summary Sheets listing analytical results for all targeted and non-targeted compounds submitted
4. Document paginated and legible
5. Chain of Custody submitted
6. Samples submitted to lab within 48 hours of sample collection
7. Methodology Summary submitted
8. Laboratory Chronicle and Holding Time Check submitted
9. Results submitted on a dry weight basis  NA ✓
10. Method Detection Limits submitted
11. Lab certified by NJDEP for parameters of appropriate category of parameters or a member of the USEPA CLP

Laboratory Manager or Environmental Consultant's Signature \_\_\_\_\_

Date 5/4/00

Laboratory Certification #13461

\*Refer to NJAC 7:26E - Appendix A, Section IV - Reduced Data Deliverables - Non-USEPA/CLP Methods for further guidance.

000064


## Laboratory Authentication Statement

I certify under penalty of law, where applicable, that this laboratory meets the Laboratory Performance Standards and Quality Control requirements specified in N.J.A.C. 7:18 and 40 CFR Part 136 for Water and Wastewater Analyses and SW-846 for Solid Waste Analysis. I have personally examined the information contained in this report and to the best of my knowledge, I believe that the submitted information is true, accurate, complete and meets the above referenced standards where applicable. I am aware that there are significant penalties for purposefully submitting falsified information, including the possibility of a fine and imprisonment.




Daniel K. Wright  
Laboratory Manager

000065

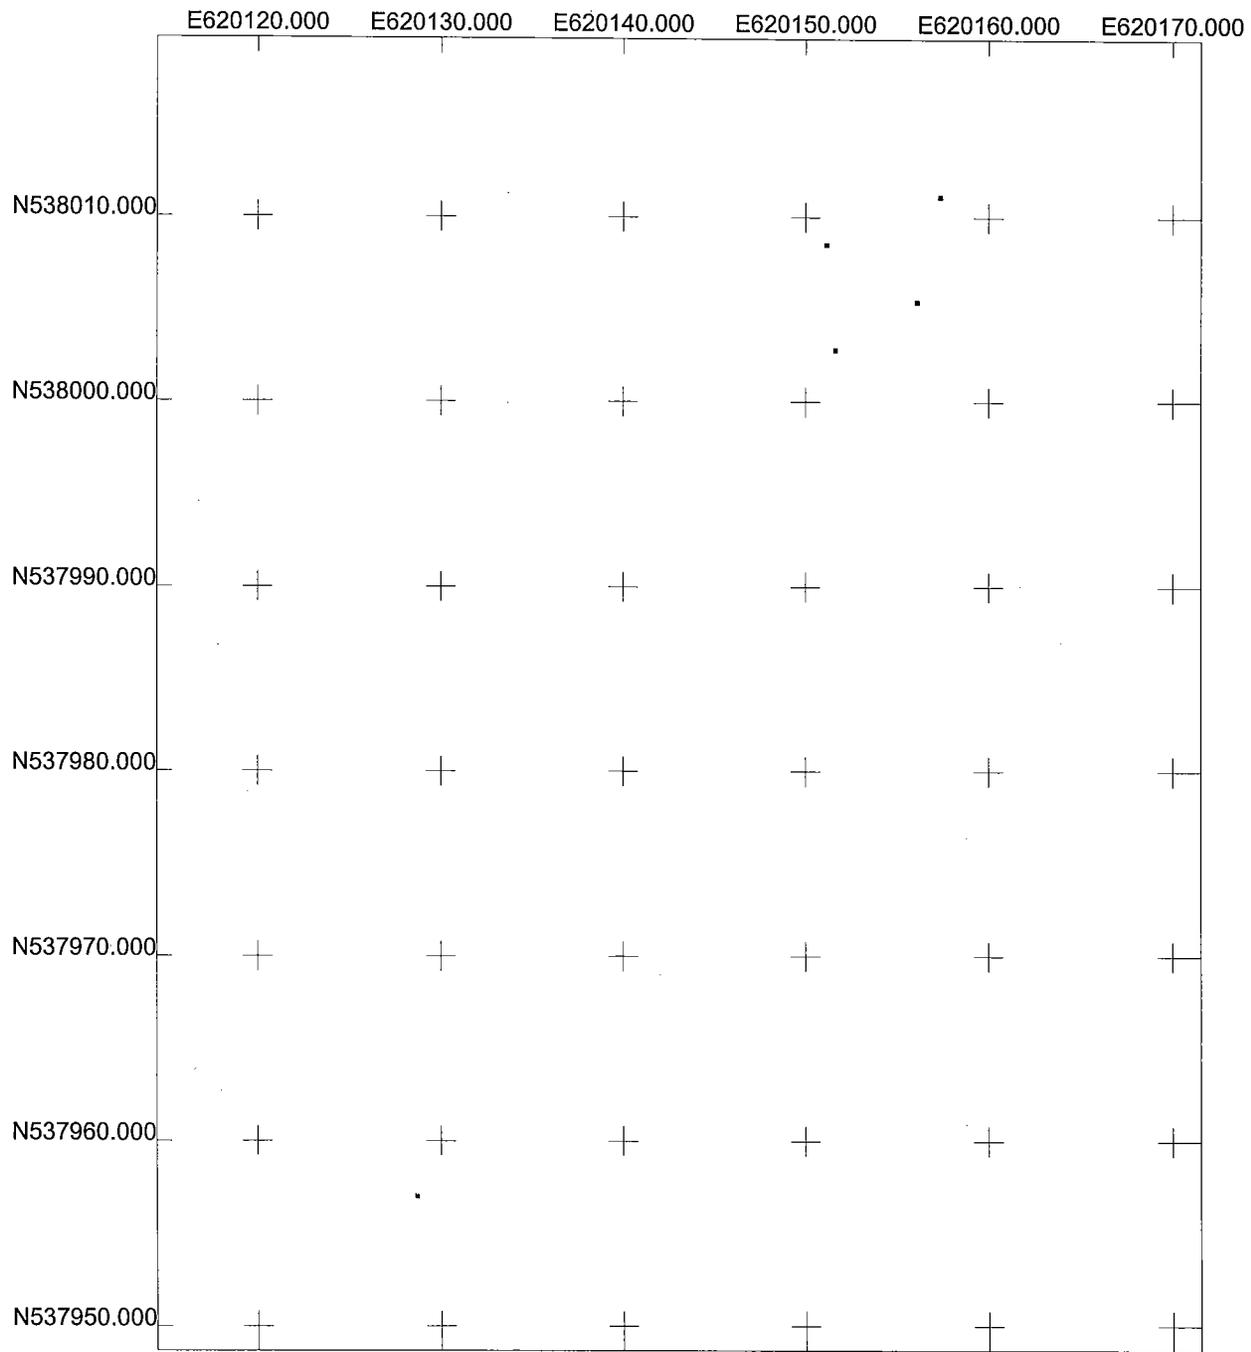

# Bldg. 1006 UST Ground Water and Soil Samples GPS map

US State Plane 1983  
 New Jersey (NY East) 2900  
 NAD 1983 (Conus)



r070715a.cor  
 7/10/2000  
 Pathfinder Office  
**Trimble**

**BLDG. 1006 UST GROUND WATER AND SOIL SAMPLES GPS POSITION & COORDINATES**

US STATE PLANE 1983 NJ ( NY EAST ) 2900 NAD 1983 ( CONUS )

( IN US SURVEY FEET )

**SAMPLE POINTS**

<b><u>POSITION / DESC.</u></b>	<b><u>Y COORD. ( NORTHING )</u></b>	<b><u>X COORD. ( EASTING )</u></b>
1006 SL AND GW 01	538008.585	620151.088
1006 SL 02	538002.863	620151.586
1006 SL 03	538005.477	620156.038
1006 SL 04	538011.18	620157.314

**REFERENCE POINTS**

<b><u>POSITION / DESC.</u></b>	<b><u>Y COORD. ( NORTHING )</u></b>	<b><u>X COORD. ( EASTING )</u></b>
TELE POLE	537957.041	620128.645